

ANNUAL GROUNDWATER MONITORING AND
CORRECTIVE ACTION REPORT
SEDIMENTATION POND
A.B. BROWN GENERATING STATION
POSEY COUNTY, INDIANA

by
Haley & Aldrich, Inc.
Greenville, South Carolina

for
Southern Indiana Gas and Electric Company
Evansville, Indiana

File No. 129420
January 2024

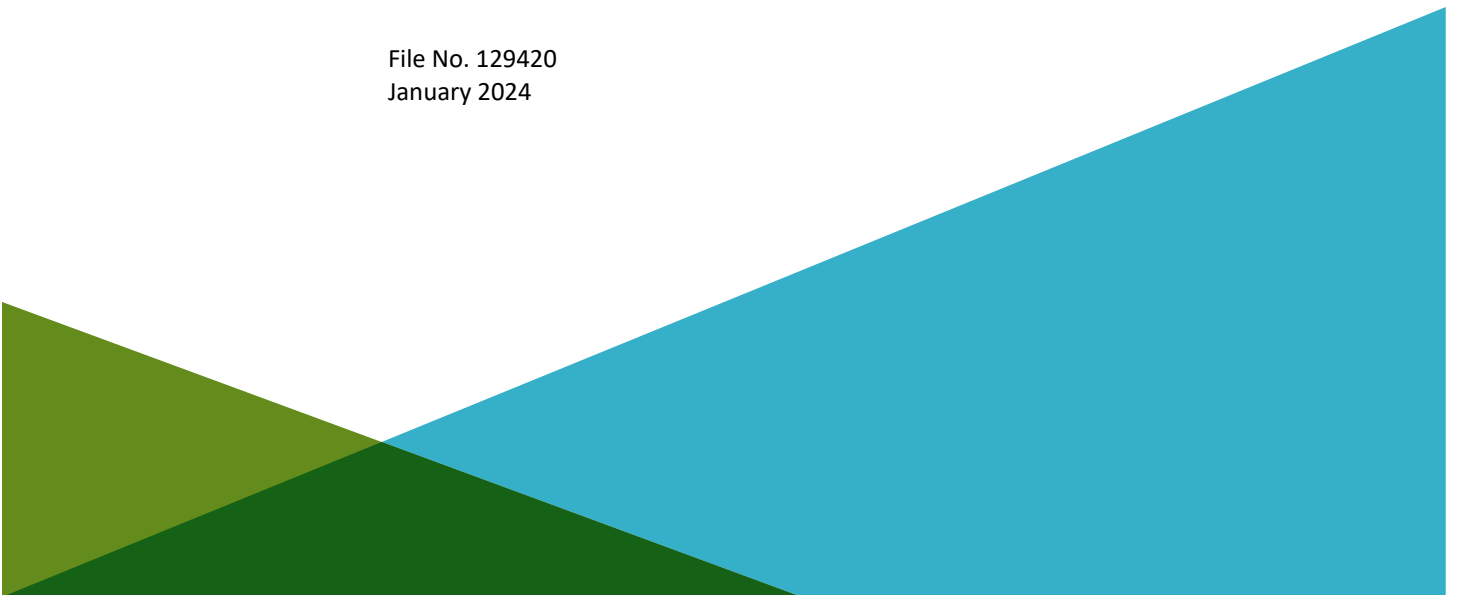


Table of Contents

	Page
List of Tables	ii
List of Figures	ii
List of Appendices	ii
1. Annual Groundwater Monitoring Report Summary	1
1.1 CODE OF FEDERAL REGULATIONS TITLE 40 (40 CFR) § 257.90(E)(6) SUMMARY	1
1.1.1 40 CFR § 257.90(e)(6)(i) – Status of Monitoring Program at Start of Reporting Period	1
1.1.2 40 CFR § 257.90(e)(6)(ii) – Status of Monitoring Program at End of Reporting Period	1
1.1.3 40 CFR § 257.90(e)(6)(iii) – Statistically Significant Increases	1
1.1.4 40 CFR § 257.90(e)(6)(iv) – Statistically Significant Levels	2
1.1.5 40 CFR § 257.90(e)(6)(v) – Selection of Remedy	3
1.1.6 40 CFR § 257.90(e)(6)(vi) – Remedial Activities	3
1.2 40 CFR § 257.90(A)	3
1.3 40 CFR § 257.90(E) – SUMMARY	3
1.3.1 Status of the Groundwater Monitoring Program	4
1.3.2 Key Actions Completed	4
1.3.3 Problems Encountered	5
1.3.4 Actions to Resolve Problems	5
1.3.5 Project Key Activities for Upcoming Year	5
1.4 40 CFR § 257.90(E) – INFORMATION	6
1.4.1 40 CFR § 257.90(e)(1)	6
1.4.2 40 CFR § 257.90(e)(2)	6
1.4.3 40 CFR § 257.90(e)(3)	6
1.4.4 40 CFR § 257.90(e)(4)	7
1.4.5 40 CFR § 257.90(e)(5)	7

List of Tables

Table No.	Title
1	Groundwater Monitoring Well Location and Construction Details
2	Summary of Groundwater Quality Data – May and November 2023

List of Figures

Figure No.	Title
1	Groundwater Monitoring Well Locations – Sedimentation Pond
2	Water Table Configuration – Sedimentation Pond – 5 May 2023
3	Water Table Configuration – Sedimentation Pond – 6 November 2023

List of Appendices

Appendix	Title
A	Summary of Statistical Analysis
B	Field Forms
C	Laboratory Analytical Reports

1. Annual Groundwater Monitoring Report Summary

1.1 CODE OF FEDERAL REGULATIONS TITLE 40 (40 CFR) § 257.90(e)(6) SUMMARY

A section at the beginning of the annual report that provides an overview of the current status of groundwater monitoring and corrective action programs for the [coal combustion residuals] CCR unit. At a minimum, the summary must specify all of the following.

1.1.1 40 CFR § 257.90(e)(6)(i) – Status of Monitoring Program at Start of Reporting Period

At the start of the current annual reporting period, whether the CCR unit was operating under the detection monitoring program in § 257.94 or the assessment monitoring program in § 257.95.

At the start of the current annual reporting period (1 January 2023), the Sedimentation Pond at A.B. Brown Generating Station (ABB) was operating under an assessment monitoring program in compliance with Code of Federal Regulations 40 CFR (40 CFR) § 257.95.

1.1.2 40 CFR § 257.90(e)(6)(ii) – Status of Monitoring Program at End of Reporting Period

At the end of the current annual reporting period, whether the CCR unit was operating under the detection monitoring program in § 257.94 or the assessment monitoring program in § 257.95.

At the end of the current annual reporting period (31 December 2023), the Sedimentation Pond was operating under an assessment monitoring program in compliance with 40 CFR § 257.95.

1.1.3 40 CFR § 257.90(e)(6)(iii) – Statistically Significant Increases

If it was determined that there was a statistically significant increase over background for one or more constituents listed in appendix III to this part pursuant to § 257.94(e).

1.1.3.1 40 CFR § 257.90(e)(6)(iii)(A)

Identify those constituents listed in appendix III to this part and the names of the monitoring wells associated with such an increase.

The Sedimentation Pond was operating under an assessment monitoring program throughout 2023; therefore, no statistical evaluations were conducted on Appendix III constituents in 2023.

1.1.3.2 40 CFR § 257.90(e)(6)(iii)(B)

Provide the date when the assessment monitoring program was initiated for the CCR unit.

An assessment monitoring program was established on 15 August 2018 for the Sedimentation Pond to meet the requirements of 40 CFR § 257.95. The Sedimentation Pond has remained in assessment monitoring since that time.

1.1.4 40 CFR § 257.90(e)(6)(iv) – Statistically Significant Levels

If it was determined that there was a statistically significant level above the groundwater protection standard for one or more constituents listed in appendix IV to this part pursuant to § 257.95(g) include all of the following.

1.1.4.1 40 CFR § 257.90(e)(6)(iv)(A) – Statistically Significant Level Constituents

Identify those constituents listed in appendix IV to this part and the names of the monitoring wells associated with such an increase.

Statistical analyses of Appendix IV constituents were completed in 2023 following the November 2022 and May 2023 semiannual assessment monitoring events as described in § 257.93(h)(2). Statistically significant levels (SSLs) were not identified in any of the Sedimentation Pond monitoring wells in 2023. A summary of statistical analysis is provided in Appendix A.

1.1.4.2 40 CFR § 257.90(e)(6)(iv)(B) – Initiation of the Assessment of Corrective Measures

Provide the date when the assessment of corrective measures was initiated for the CCR unit.

An assessment of corrective measures has not been initiated for this unit as no SSLs were identified during the 2023 reporting period. The Sedimentation Pond remained in assessment monitoring during 2023.

1.1.4.3 40 CFR § 257.90(e)(6)(iv)(C) – Assessment of Corrective Measures Public Meeting

Provide the date when the public meeting was held for the assessment of corrective measures for the CCR unit.

An assessment of corrective measures is not required and therefore has not been initiated for the Sedimentation Pond during the 2023 reporting period; therefore, a public meeting was not held.

1.1.4.4 40 CFR § 257.90(e)(6)(iv)(D) – Completion of the Assessment of Corrective Measures

Provide the date when the assessment of corrective measures was completed for the CCR unit.

An assessment of corrective measures has not been completed for this unit since no SSLs have been identified during the 2023 reporting period. The Sedimentation Pond remained in assessment monitoring during 2023.

1.1.5 40 CFR § 257.90(e)(6)(v) – Selection of Remedy

Whether a remedy was selected pursuant to § 257.97 during the current annual reporting period, and if so, the date of remedy selection.

Since an assessment of corrective measures has not been required, the selection of remedy under § 257.97 is not required.

1.1.6 40 CFR § 257.90(e)(6)(vi) – Remedial Activities

Whether remedial activities were initiated or are ongoing pursuant to § 257.98 during the current annual reporting period.

Remedial activities were not required in 2023; therefore, no demonstration or certification is applicable.

1.2 40 CFR § 257.90(a)

Except as provided for in § 257.100 for inactive CCR surface impoundments, all CCR landfills, CCR surface impoundments, and lateral expansions of CCR units are subject to the groundwater monitoring and corrective action requirements under § 257.90 through § 257.98.

The Sedimentation Pond at ABB is subject to the groundwater monitoring and corrective action requirements described under 40 CFR § 257.90 through § 257.98 (the Rule). The remainder of this document addresses the requirement for the Owner/Operator to prepare an Annual Groundwater Monitoring and Corrective Action Report per § 257.90(e).

1.3 40 CFR § 257.90(e) – SUMMARY

Annual groundwater monitoring and corrective action report. For existing CCR landfills and existing CCR surface impoundments, no later than January 31, 2018, and annually thereafter, the owner or operator must prepare an annual groundwater monitoring and corrective action report. For new CCR landfills, new CCR surface impoundments, and all lateral expansions of CCR units, the owner or operator must prepare the initial annual groundwater monitoring and corrective action report no later than January 31 of the year following the calendar year a groundwater monitoring system has been established for such CCR unit as required by this subpart, and annually thereafter. For the preceding calendar year, the annual report must document the status of the groundwater monitoring and corrective action program for the CCR unit, summarize key actions completed, describe any problems encountered, discuss actions to resolve the problems, and project key activities for the upcoming year. For purposes of this section, the owner or operator has prepared the annual report when the report is placed in the facility's operating record as required by § 257.105(h)(1).

This 2023 Annual Groundwater Monitoring and Corrective Action Report documents the activities completed during the 2023 reporting period for the Sedimentation Pond as required by the Rule. Semiannual groundwater sampling and analysis was conducted per the requirements described in § 257.93, and the status of the groundwater monitoring program is provided in this report as required by § 257.95. Field forms for the groundwater sampling events are provided in Appendix B. Laboratory analytical reports are provided in Appendix C.

1.3.1 Status of the Groundwater Monitoring Program

Semiannual groundwater sampling activities continued in 2023 to satisfy requirements of § 257.95(b) and 257.95(d)(1). Groundwater samples were collected from the monitoring wells at the Sedimentation Pond on 11 May 2023 and again on 9 and 10 November 2023.

Statistical analyses of Appendix IV constituents collected during the November 2022 sampling event was completed on 13 March 2023, within 90-days following the receipt of laboratory analytical results on 13 December 2022, per the requirements of § 257.93(h)(2). Statistical analysis of Appendix IV constituents collected during the May 2023 sampling event was completed on 25 September 2023, within 90-days following the receipt of laboratory analytical results on 27 June 2023, per the requirements of § 257.93(h)(2). Statistical analysis of Appendix IV constituents collected during the November 2023 sampling event will be completed within the 2024 reporting period and will therefore be included in the 2024 annual report.

Statistical analysis of Appendix IV constituents during the 2023 reporting period continued to demonstrate that SSLs of Appendix IV constituents are not present in groundwater downgradient of the Sedimentation Pond. Although SSLs were not identified, some concentrations remain above background, therefore in accordance with 257.95(f), the Sedimentation Pond will continue with semiannual assessment monitoring.

1.3.2 Key Actions Completed

The following key actions were completed in 2023:

- 31 January 2023 – Prepared 2022 Annual Groundwater Monitoring and Corrective Action Report (2022 Annual Report) including:
 - Pursuant to § 257.105(h)(1), the 2022 Annual Report was placed in the facility's operating record on 31 January 2023;
 - Pursuant to § 257.106(h)(1), the notification was sent to the relevant State Director and/or Tribal authority within 30 days of the 2022 Annual Report being placed in the facility's operating record [§ 257.106(d)];
 - Pursuant to § 257.107(h)(1), the 2022 Annual Report was posted to the CCR Website within 30 days of the 2022 Annual Report being placed in the facility's operating record [§ 257.107(d) and 257.107(h)(1)];
- 13 March 2023 – Completed statistical analysis of the November 2022 assessment monitoring laboratory analytical results received on 13 December 2022.
- 8 May 2023 – Measured static water levels in groundwater monitoring wells at the site before the May 2023 sampling event and again immediately prior to collecting each sample to evaluate groundwater flow direction and rate per the requirements of § 257.93(c).

- 11 May 2023 – Collected groundwater samples from monitoring wells at the Sedimentation Pond for laboratory analysis in accordance with § 257.95.
- 25 September 2023 – Completed statistical analysis of May 2023 assessment monitoring laboratory analytical results received on 27 June 2023.
- 6 November 2023 – Measured static water levels in groundwater monitoring wells at the site before beginning the November 2023 sampling event and again immediately prior to collecting each sample to evaluate groundwater flow direction and rate per the requirements of § 257.93(c).
- 9 to 10 November 2023 – Collected groundwater samples from monitoring wells at the Sedimentation Pond for laboratory analysis in accordance with § 257.95.

1.3.3 Problems Encountered

Problems encountered during the May 2023 and November 2023 sampling events include:

- During the November 2023 sampling event, monitoring well CCR-SP-1 was discovered to have damage and therefore was unable to be used for synoptic groundwater level gauging at the start of the semiannual sampling event.
- No other problems were encountered at the Sedimentation Pond during the 2023 reporting period.

1.3.4 Actions to Resolve Problems

During the November 2023 sampling event, monitoring well CCR-SP-1 was found to be damaged and a preliminary assessment of the damage indicated the monitoring well remained sufficiently in-tact to facilitate the collection of a groundwater sample. Debris was cleared from the ground surface and damage was documented prior to well redevelopment and purging. Groundwater was sampled from CCR-SP-1 on 10 November 2023, at least 24 hours after re-development was completed. Laboratory analytical results reported some constituent concentrations that were elevated compared to typically observed concentrations and may not be representative of groundwater due to potential influence from surface water while the monitoring well was damaged.

Monitoring well CCR-SP-1 will be abandoned and replaced as soon as possible and a confirmation sample will be collected from the replacement monitoring well CCR-SP-1R to determine if error occurred during sampling or laboratory analysis of the initial sample per § 257.24(c)(3). Confirmation sample results will be included in the statistical analysis of Appendix IV constituents from the November 2023 sampling event when it is completed in the 2024 reporting period and included in the 2024 annual report.

1.3.5 Project Key Activities for Upcoming Year

Key activities to be completed in 2024 include the following:

- Continue semiannual groundwater monitoring in accordance with § 257.95.
- Complete statistical analyses of the semiannual groundwater sampling results within 90-days of sampling and analysis as required by § 257.93(h)(2).

1.4 40 CFR § 257.90(e) – INFORMATION

At a minimum, the annual groundwater monitoring and corrective action report must contain the following information, to the extent available.

1.4.1 40 CFR § 257.90(e)(1)

A map, aerial image, or diagram showing the CCR unit and all background (or upgradient) and downgradient monitoring wells, to include the well identification numbers, that are part of the groundwater monitoring program for the CCR unit.

As required by § 257.90(e)(1), a map showing the locations of the Sedimentation Pond and associated upgradient, and downgradient wells is presented on Figure 1. Groundwater elevation contours for the May 2023 sampling event are presented on Figure 2. Groundwater elevation contours created for the November 2023 sampling event are presented on Figure 3.

1.4.2 40 CFR § 257.90(e)(2)

Identification of any monitoring wells that were installed or decommissioned during the preceding year, along with a narrative description of why those actions were taken.

There was no installation or decommissioning of monitoring wells during 2023. Groundwater monitoring well location and construction details for the existing monitoring well network are summarized in Table 1.

1.4.3 40 CFR § 257.90(e)(3)

In addition to all the monitoring data obtained under § 257.90 through § 257.98, a summary including the number of groundwater samples that were collected for analysis for each background and downgradient well, the dates the samples were collected, and whether the sample was required by the detection monitoring or assessment monitoring programs.

In accordance with § 257.95(b) and § 257.95(d)(1), two independent samples from each background and downgradient monitoring well were collected and analyzed. A summary table including the sample names, dates of sample collection, reason for sample collection (detection or assessment), and monitoring data obtained for the groundwater monitoring program for the Sedimentation Pond is presented in Table 2.

1.4.4 40 CFR § 257.90(e)(4)

A narrative discussion of any transition between monitoring programs (e.g., the date and circumstances for transitioning from detection monitoring to assessment monitoring in addition to identifying the constituent(s) detected at a statistically significant increase over background levels).

The results of the statistical analyses for the November 2022 and May 2023 sampling events continued to demonstrate that SSLs of Appendix IV constituents were not present in groundwater downgradient of the Sedimentation Pond. Although SSLs were not present, three monitoring well had constituent concentrations above background in May 2023; therefore, in accordance with 257.95(f), the Sedimentation Pond will continue with semiannual assessment monitoring. Statistical analysis for the November 2023 sampling event is ongoing and will be completed within 90-days following the receipt of laboratory analytical results on 21 December 2023 to determine if a statistically significant increase over background has occurred.

1.4.5 40 CFR § 257.90(e)(5)

Other information required to be included in the annual report as specified in § 257.90 through § 257.98.

Other information including development of groundwater protection standards and recording of groundwater monitoring results in the operating record were discussed in prior annual reports.

TABLES

TABLE 1

GROUNDWATER MONITORING WELL LOCATION AND CONSTRUCTION DETAILS

SEDIMENTATION POND

A.B. BROWN GENERATING STATION

POSEY COUNTY, INDIANA

Well	CCR Unit	Date Installed	Easting	Northing	Top of Pad Elevation (ft msl)	Top of Riser Elevation (ft msl)	Surface Grout (ft bgs)	Bentonite (ft bgs)	Sand Pack (ft bgs)	Screen Zone (ft bgs)	Screen Length (ft)	Well Radius (in)	Status
Background Wells													
CCR-BK-1R	Background	March 2016	2770919.08	974083.40	480.10	483.39	0.0 - 50.0	50.0 - 52.0	52.0 - 64.0	54.00 - 64.00	10	2	Active
CCR-BK-2	Background	March 2016	2769728.14	972854.33	427.50	430.60	0.0 - 11.5	11.5 - 13.5	13.5 - 25.5	15.50 - 25.50	10	2	Active
Sedimentation Pond Wells													
CCR-SP-1	Sediment Pond	March 2016	2770030.26	970981.89	403.90	403.51	1.0 - 6.0	6.0 - 8.0	8.0 - 20.0	10.00 - 20.00	10	2	Active
CCR-SP-2	Sediment Pond	March 2016	2769939.51	970887.25	403.60	403.23	1.0 - 6.0	6.0 - 8.0	8.0 - 20.0	10.00 - 20.00	10	2	Active
CCR-SP-3	Sediment Pond	March 2016	2770027.64	970735.02	403.90	403.57	1.0 - 6.0	6.0 - 8.0	8.0 - 20.0	10.00 - 20.00	10	2	Active

Notes and Abbreviations:

bgs: below ground surface

ccr: coal combustion residual

ft: feet

in: inches

msl: mean sea level

TABLE 2
SUMMARY OF GROUNDWATER QUALITY DATA - MAY AND NOVEMBER 2023

A.B. BROWN GENERATING STATION
 SEDIMENTATION POND
 POSEY COUNTY, INDIANA

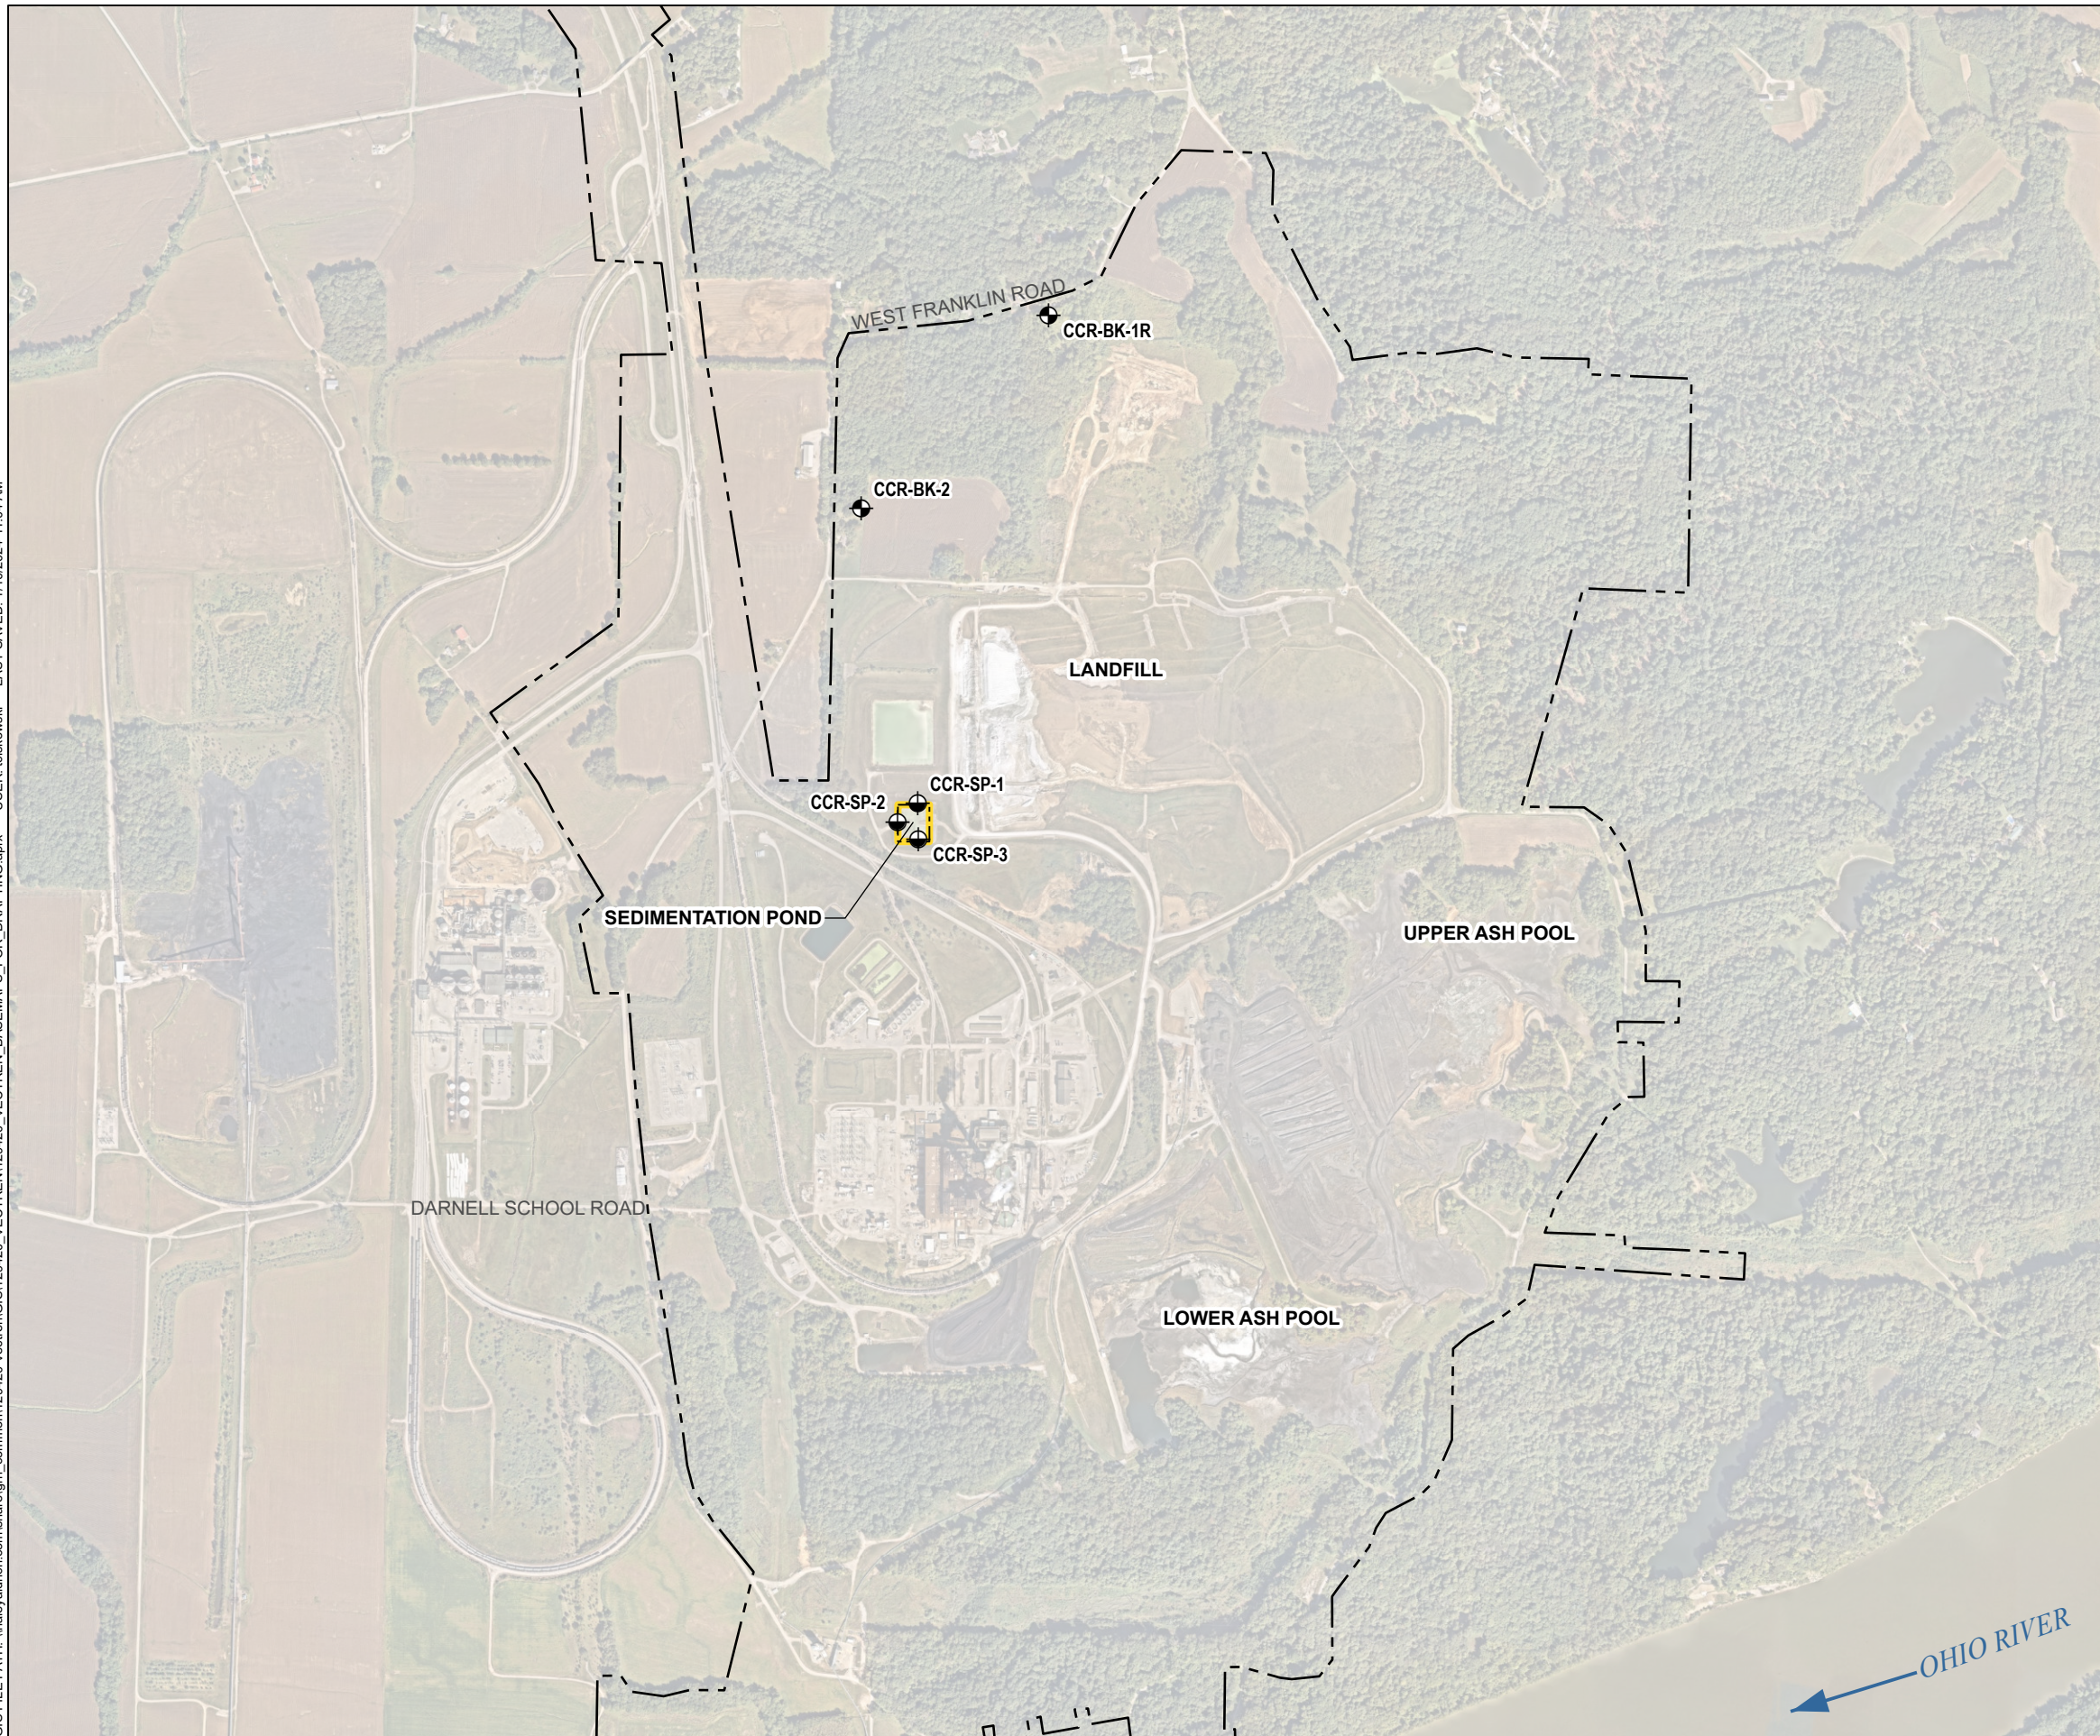
Location Group Location Name Sample Name Sample Date Lab Sample ID	Action Level GWPS	Background				Downgradient							
		CCR-BK-1R	CCR-BK-1R	CCR-BK-2	CCR-BK-2	CCR-SP-1	CCR-SP-1	CCR-SP-2	CCR-SP-2	CCR-SP-2	CCR-SP-2	CCR-SP-3	CCR-SP-3
		CCR-BK-1R-051123	CCR-BK-1R-110823	CCR-BK-2-051023	CCR-BK-2-110923	CCR-SP-1-051123	CCR-SP-1-111023	CCR-SP-2-051123	DUP2-051123	CCR-SP-2-110923	DUP-2-110923	CCR-SP-3-051123	CCR-SP-3-110923
		05/11/2023	11/08/2023	05/10/2023	11/09/2023	05/11/2023	11/10/2023	05/11/2023	05/11/2023	11/09/2023	11/09/2023	05/11/2023	11/09/2023
Detection Monitoring - USEPA Appendix III Constituents (mg/L)													
Boron, Total	NA	0.1 U	0.2 U	0.1 U	0.2 U	0.4	0.41	0.27	0.26	0.2 U	0.2 U	0.016 J	0.2 U
Calcium, Total	NA	51	46	40	40	260	360 J+	250	240	220 J+	220 J+	87	77 J+
Chloride	NA	9	10	18	17	75	54	60	62	69	70	10	6.2
Fluoride	4	0.18 J+	0.17	0.1 U	0.15	0.083 J	0.1 U	0.16	0.19	0.2 J+	0.19 J+	0.3	0.33
pH (lab) (pH units)	NA	7.2 J	7.3 J	7 J	7.1 J	-	6.9 J	-	-	7.2 J	7 J	-	7.3 J
Sulfate	NA	39	37	22	21	750	560	460	450	410	420	24	3.8
Total Dissolved Solids (TDS)	NA	280	290	240	230	1700	2800 J	1200	1200	1200 J	1200 J	410	370
Assessment Monitoring - USEPA Appendix IV Constituents (mg/L)													
Antimony, Total	0.006	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U
Arsenic, Total	0.01	0.005 U	0.00041 J	0.005 U	0.001 U	0.0039	0.0025	0.008	0.0076	0.0061	0.0077	0.0037	0.0085
Barium, Total	2	0.074	0.087	0.032	0.032	0.1	0.063	0.11	0.11	0.13	0.14	0.072	0.062
Beryllium, Total	0.004	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U
Cadmium, Total	0.005	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.00028 J	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U
Chromium, Total	0.1	0.0017 J	0.0016 J	0.005 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.0015 J	0.0041 J	0.002 U	0.002 U
Cobalt, Total	0.006	0.00026 J	0.0005 U	0.001 U	0.0005 U	0.0052	0.011	0.00085	0.00085	0.001 J	0.0019 J	0.001	0.0005
Fluoride	4	0.18 J+	0.17	0.1 U	0.15	0.083 J	0.1 U	0.16	0.19	0.2 J+	0.19 J+	0.3	0.33
Lead, Total	0.015	0.001 U	0.00041 J	0.001 U	0.001 U	0.00057 J	0.001 U	0.00055 J	0.00046 J	0.00095 J	0.0027 J	0.001 U	0.001 U
Lithium, Total	0.04	0.0084	0.011	0.0022 J	0.0016 J	0.0046 J	0.0058	0.0054	0.0049 J	0.0064	0.0078	0.005 U	0.005 U
Mercury, Total	0.002	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U
Molybdenum, Total	0.1	0.0014 J	0.0017 J	0.005 U	0.005 U	0.00091 J	0.0014 J	0.00089 J	0.00069 J	0.0014 J	0.0017 J	0.0036 J	0.0037 J
Selenium, Total	0.05	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Thallium, Total	0.002	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U
Radiological (pCi/L)													
Radium-226	NA	0.482 ± 0.333	0.679 U ± 0.299	1 U ± 0.192	1 U ± 0.109	1 U ± 0.21	1 U ± 0.1	1 U ± 0.164	1 U ± 0.209	0.324 U ± 0.186	0.471 U ± 0.289	1 U ± 0.165	1 U ± 0.105
Radium-228	NA	1 U ± 0.633	1 U ± 0.379	1 U ± 0.347	1 U ± 0.455	1 U ± 0.381	1 U ± 0.38	1 U ± 0.36	1 U ± 0.386	1 U ± 0.439	1 U ± 0.689	1 U ± 0.299	1 U ± 0.374
Radium-226 & 228	5	1.39 J ± 0.715	0.959 UJ ± 0.483	5 U ± 0.397	0.723 ± 0.468	5 U ± 0.435	5 U ± 0.393	5 U ± 0.396	5 U ± 0.439	5 UJ ± 0.477	5 UJ ± 0.747	5 U ± 0.342	5 U ± 0.388
Field Parameters													
Temperature (Deg C)	NA	17.03	25.2	17.84	23.79	17.16	25.65	16.92	16.92	25.65	25.65	17.13	25.63
Dissolved Oxygen, Field (mg/L)	NA	5.03	3.21	0.58	0.51	1.1	0.05	0	0	0	0	0	0.47
Conductivity, Field (mS/cm)	NA	0.441	0.43	0.379	0.38	2.11	3.55	1.75	1.75	1.72	1.72	0.67	0.67
Oxidation Reduction Potential (ORP), Field (mv)	NA	238	222	184	235	-133	23	-81	-81	-69	-69	-66	-28
Turbidity, Field (NTU)	NA	4.8	2.4	0	0	8.9	0	44.9	44.9	52.3	52.3	0	0
pH, Field (SU)	NA	6.89	6.97	6.73	6.41	6.59	6.1	6.64	6.64	6.6	6.6	6.96	6.74

Notes and Abbreviations:





CCR: Coal Combustion Residuals
 mg/L: milligram per liter
 pCi/L: picoCurie per liter
 Deg C: Degrees Celsius
 mS/cm: milliSiemen per centimeter
 mv: millivolts
 NTU: Nephelometric Turbidity Units
 SU: Standard Units (pH)
 U: not detected, value is the laboratory reporting limit
 J: value is estimated
 J+: value is estimated with a potential high bias
 USEPA: United States Environmental Protection Agency
 GWPS: Ground Water Protection Standard
 Results in **bold** are detected.
 Shaded values indicate an exceedance of the GWPS.
 USEPA. 2020. Final Rule: Disposal of Coal Combustion Residuals from Electric Utilities. December 14. 40 CFR Part 257.
<https://www.epa.gov/coalash/coal-ash-rule>

FIGURES

GIS FILE PATH: \\haleyaldrich.com\share\gim\common\129420_Vectren\GIS\129420_Vectren\BASEMAPS_FOR_DRAFTING.aprx — USER: iciekowski — LAST SAVED: 1/10/2024 11:04 AM




LEGEND

-  DOWNGRADIENT GROUNDWATER MONITORING WELL
-  UPGRADIENT GROUNDWATER MONITORING WELL
-  PROPERTY BOUNDARY
-  APPROXIMATE UNIT BOUNDARY

NOTES

1. ALL LOCATIONS AND DIMENSIONS ARE APPROXIMATE
2. AERIAL IMAGERY SOURCE: HEXAGON, 21 JULY 2023



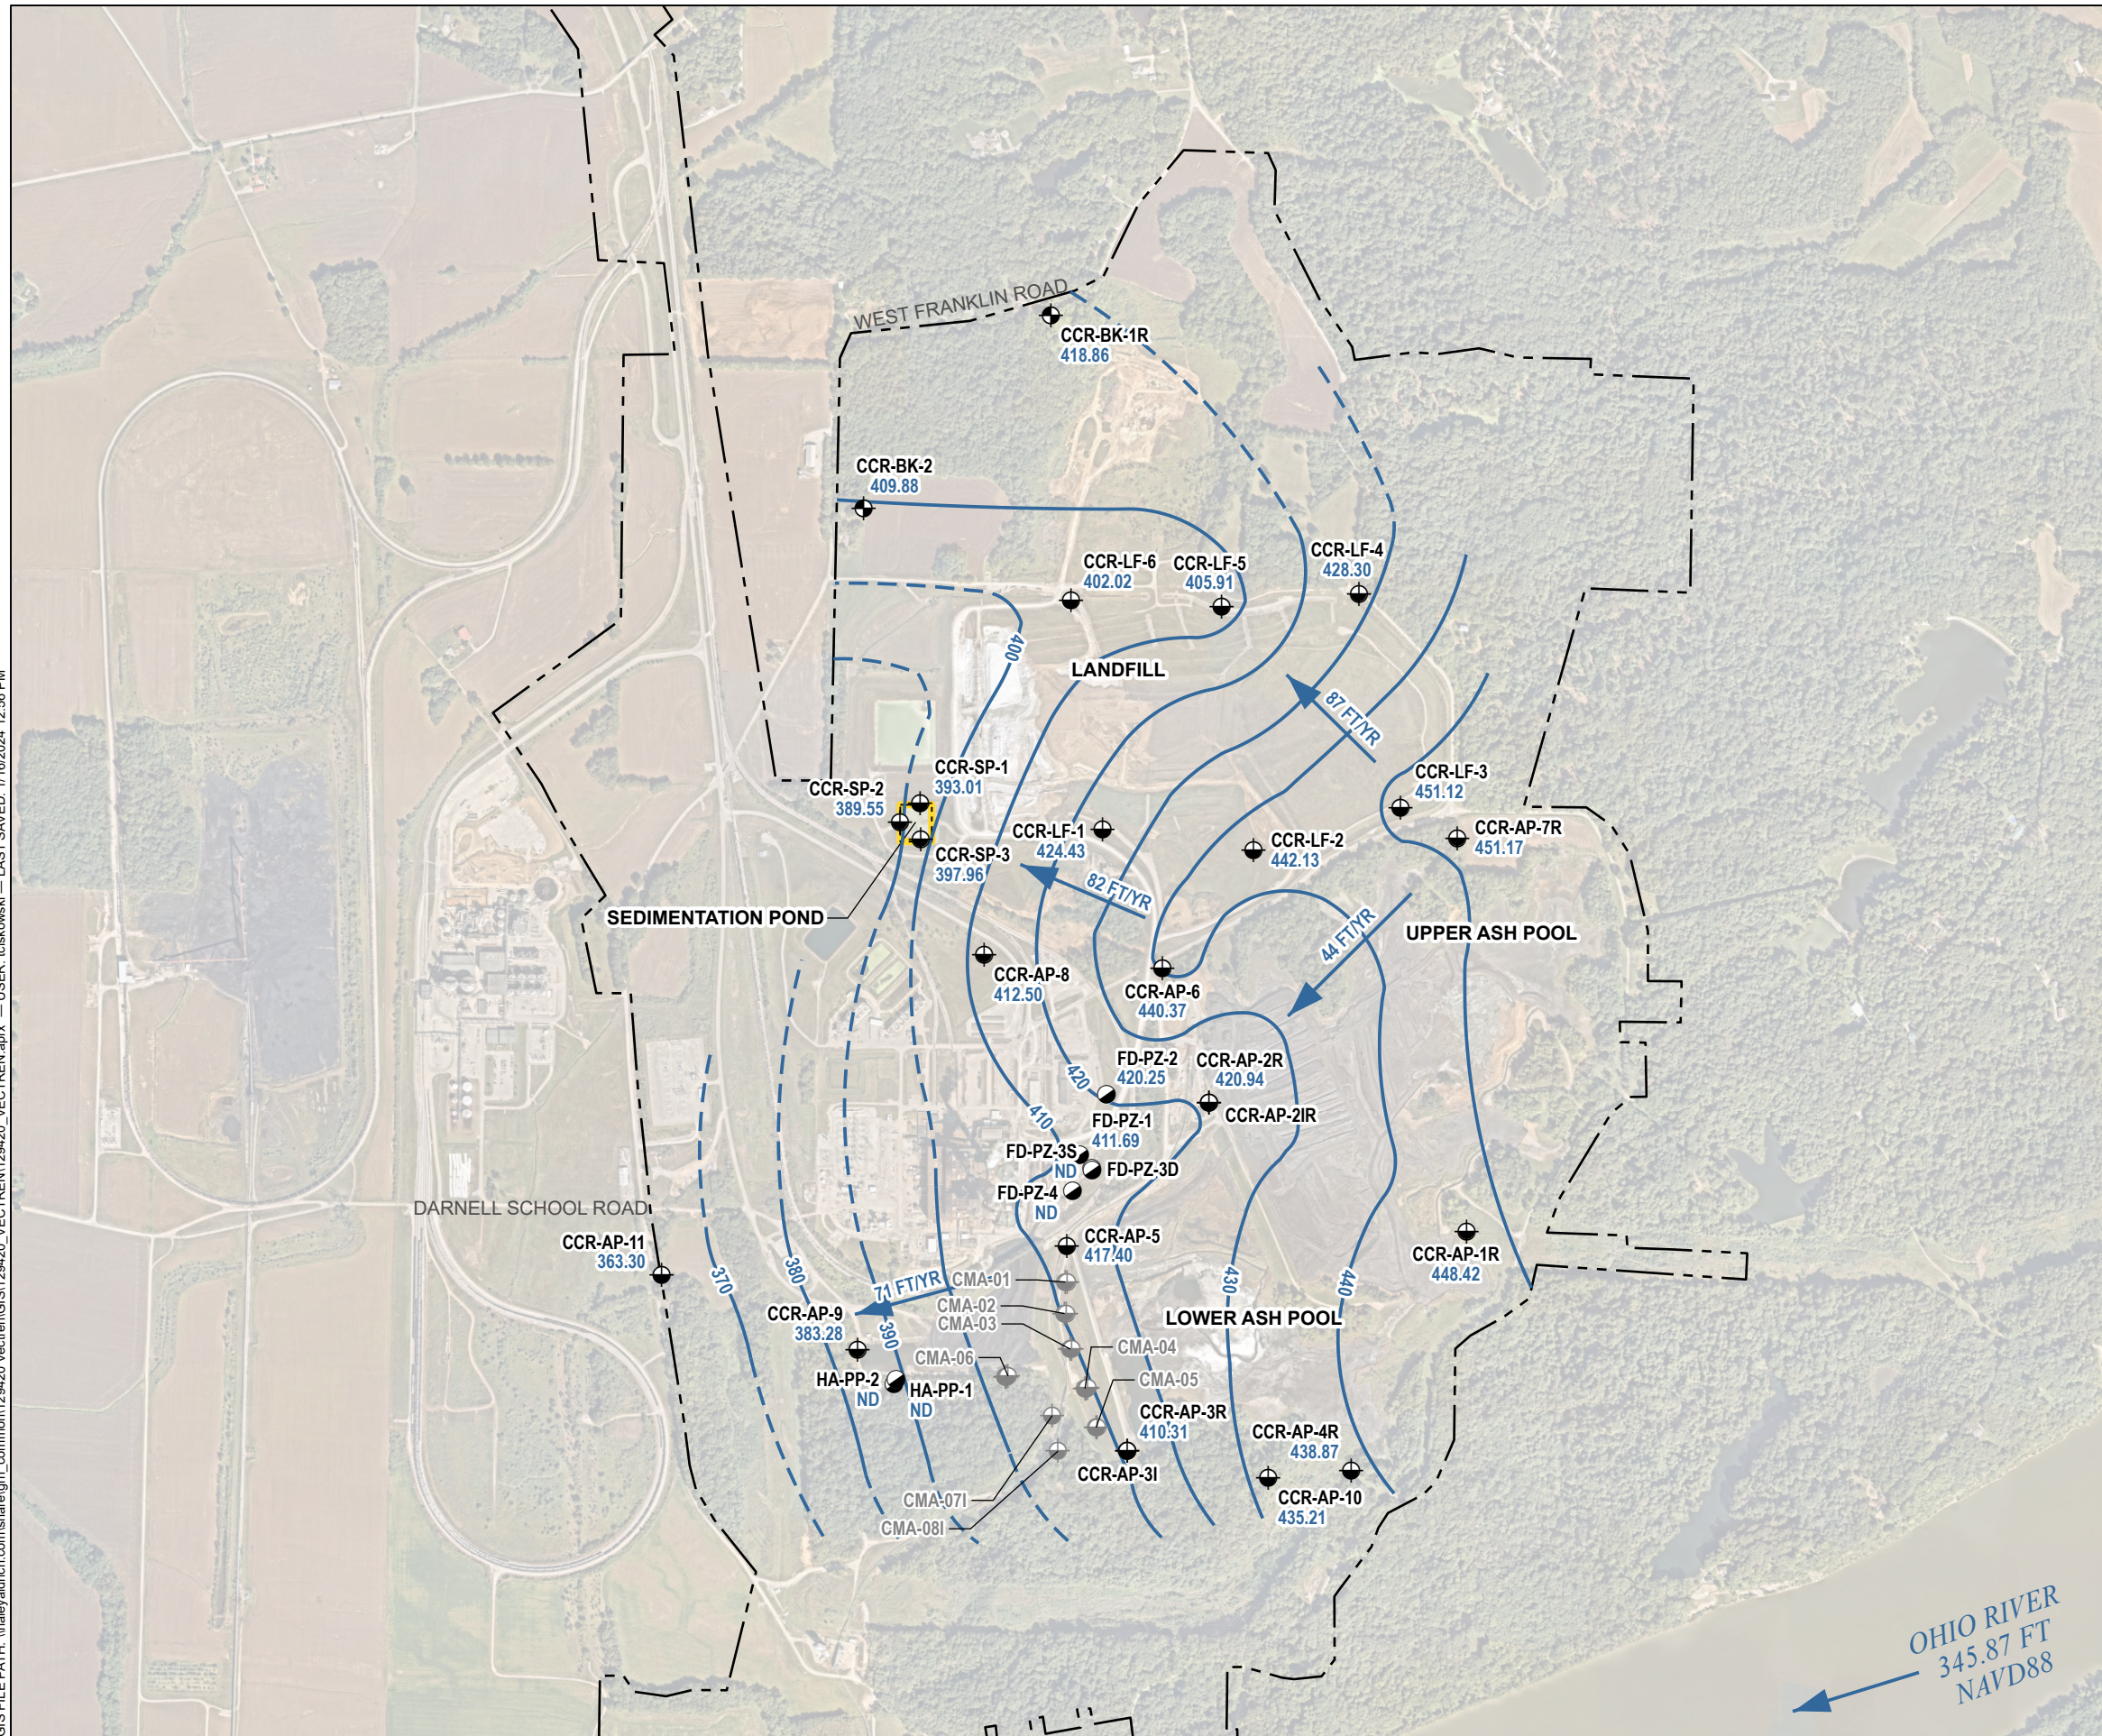
HALEY ALDRICH SOUTHERN INDIANA GAS AND ELECTRIC COMPANY
 A.B. BROWN GENERATING STATION
 MOUNT VERNON, INDIANA

**GROUNDWATER MONITORING
 WELL LOCATIONS -
 SEDIMENTATION POND**








JANUARY 2024

FIGURE 1

GIS FILE PATH: \\haleyaldrich.com\share\gfm_common\129420_Vectren\GIS129420_Vectren.aprx — USER: tciskowski — LAST SAVED: 1/16/2024 12:56 PM




LEGEND

-  PIEZOMETER
-  UPGRADIENT GROUNDWATER MONITORING WELL
-  DOWNGRADIENT GROUNDWATER MONITORING WELL
-  GROUNDWATER ELEVATION CONTOUR, 10-FT INTERVAL, DASHED WHERE INFERRED
-  GROUNDWATER FLOW DIRECTION
-  PROPERTY BOUNDARY
-  APPROXIMATE UNIT BOUNDARY

NOTES

1. ALL LOCATIONS AND DIMENSIONS ARE APPROXIMATE
2. WATER LEVELS GAGED 5 MAY 2023
3. OHIO RIVER STAGE MEASURED ON 5 MAY 2023 BY USGS GAGE 03322190 AT HENDERSON, KY, APPROXIMATELY 13.5 MILES UPSTREAM FROM A.B. BROWN GENERATING STATION.
4. GROUNDWATER VELOCITY SHOWN IN FEET PER YEAR
5. $V = \frac{K(i)}{n_e}$
 V = GROUNDWATER VELOCITY (FT/YR)
 K = HYDRAULIC CONDUCTIVITY (FT/YR)
 i = GROUNDWATER GRADIENT
 n_e = EFFECTIVE POROSITY
6. SHADED WELLS WERE NOT INCLUDED IN WATER LEVEL GAGING
7. AERIAL IMAGERY SOURCE: HEXAGON, 21 JULY 2023.



HALEY ALDRICH

A.B. BROWN GENERATING STATION
 SEDIMENTATION POND
 POSEY COUNTY, INDIANA

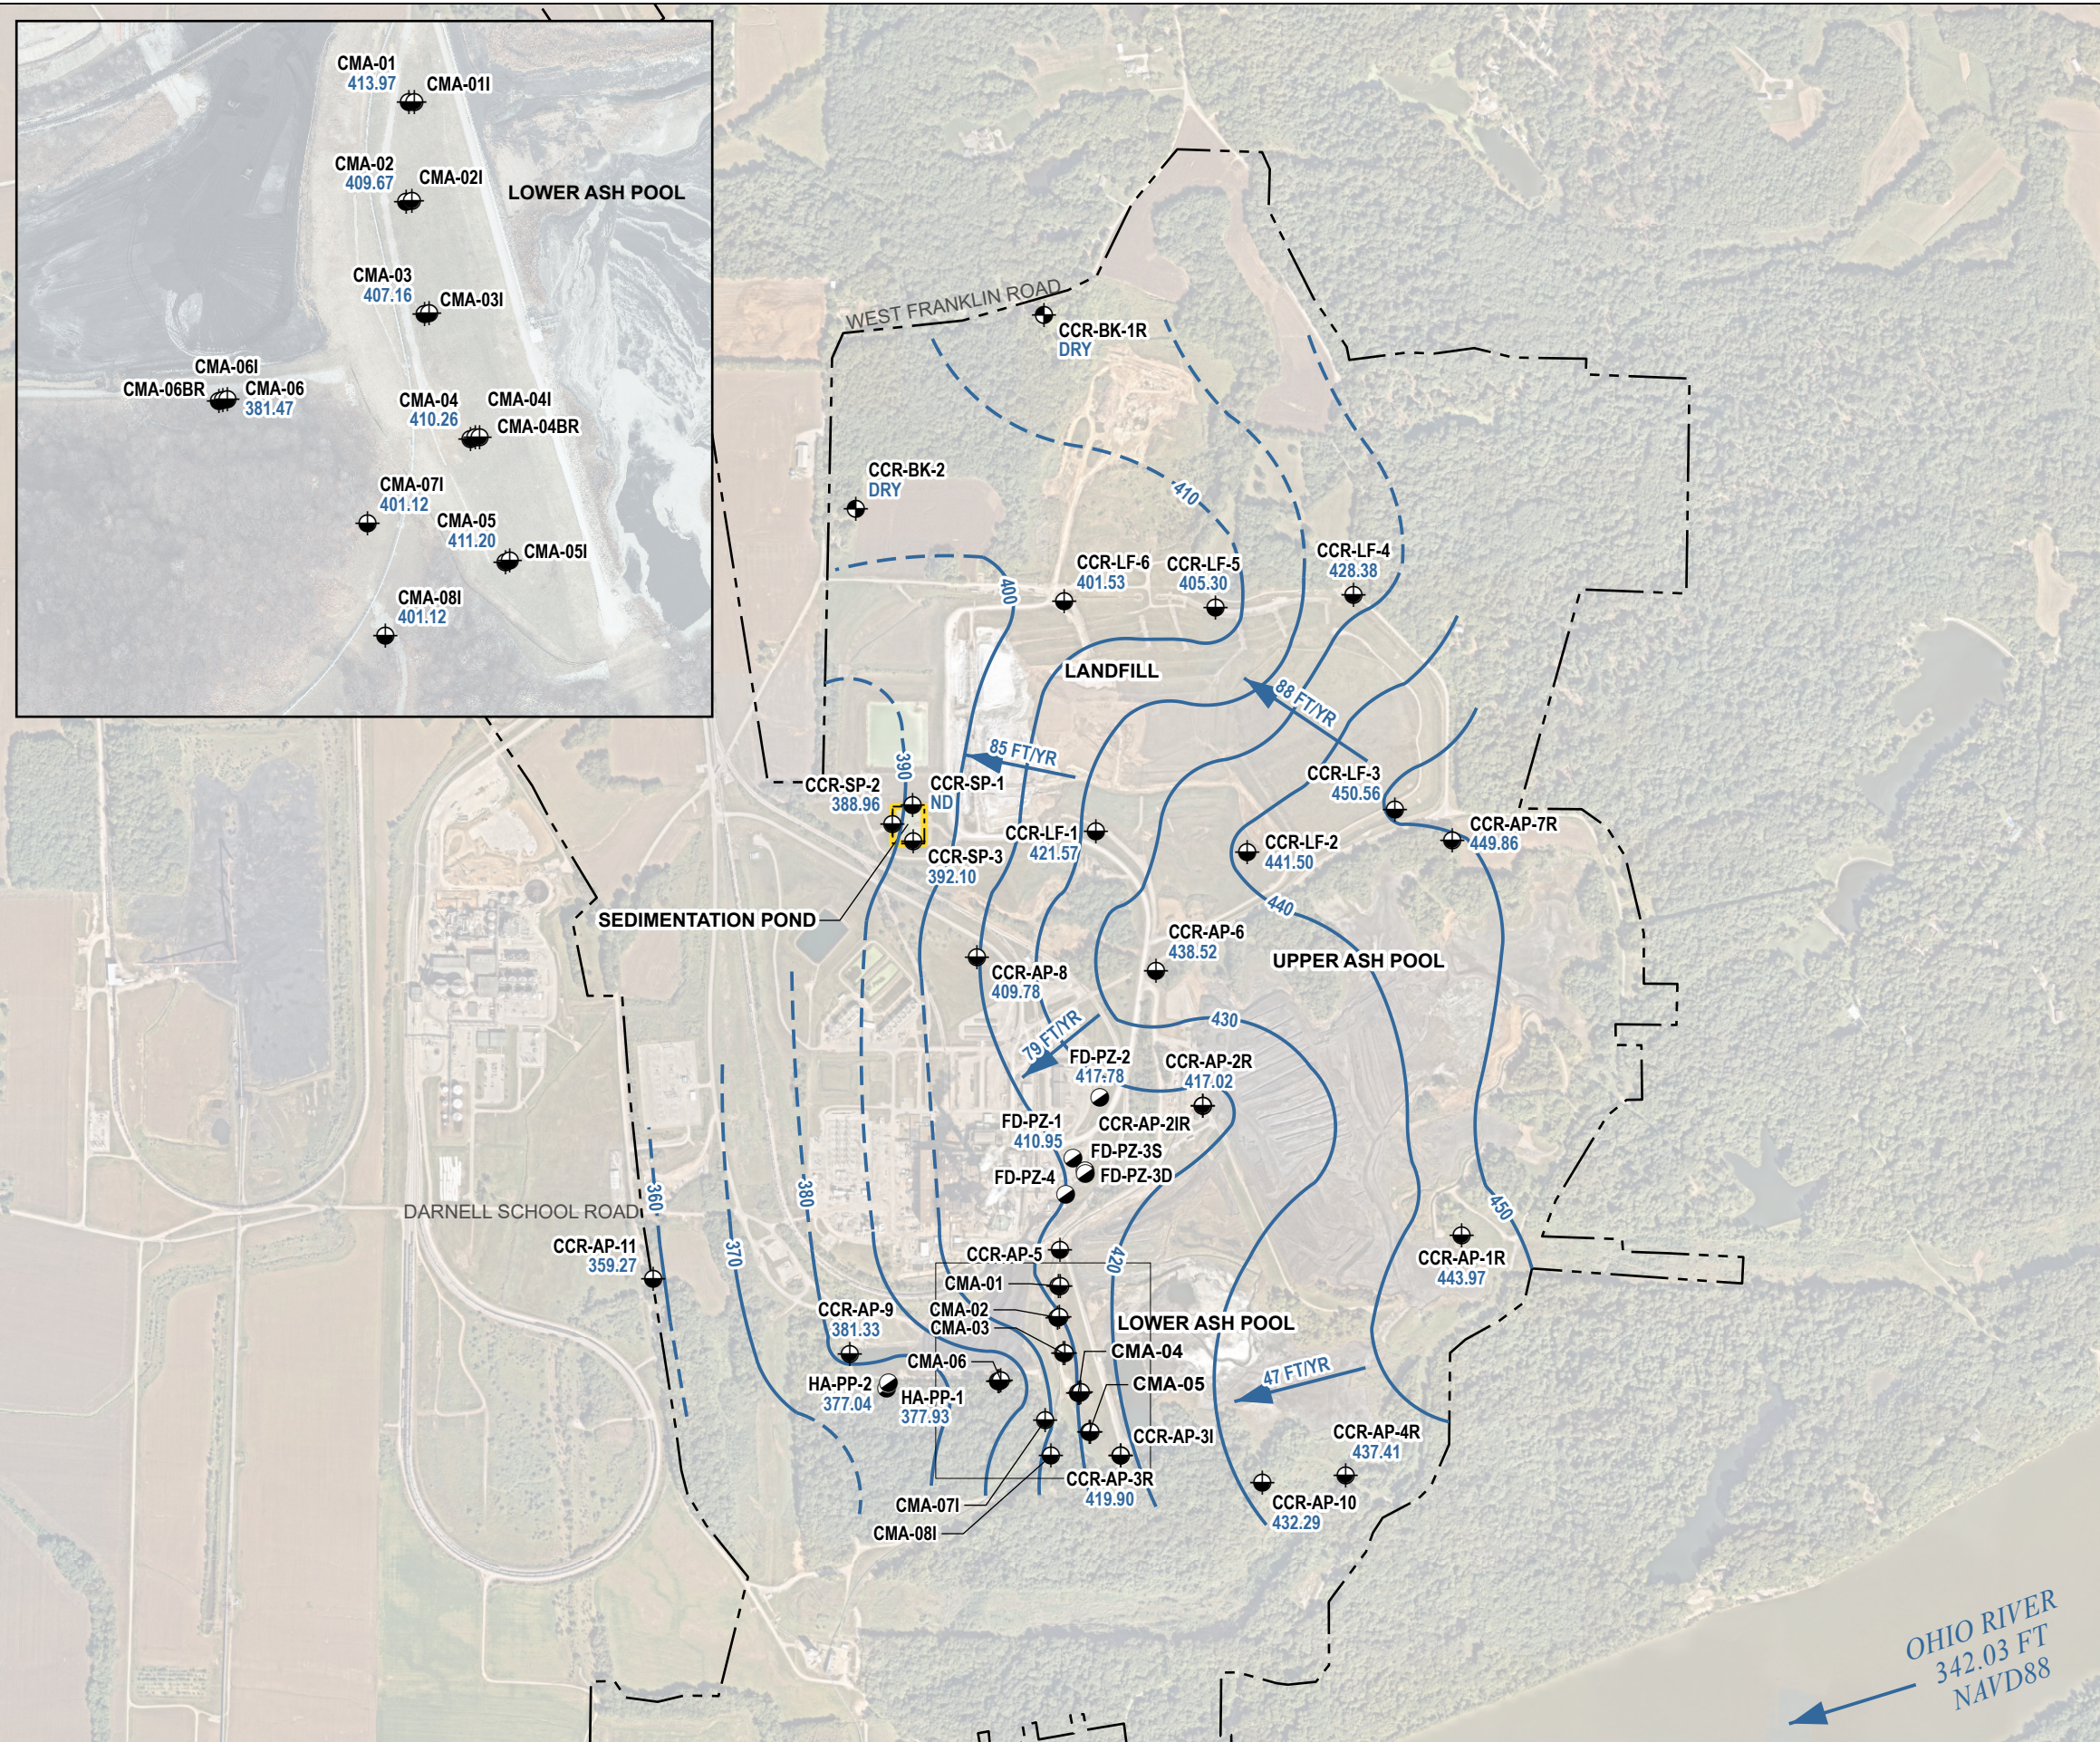
**WATER TABLE CONFIGURATION
 SEDIMENTATION POND
 5 MAY 2023**

JANUARY 2024








FIGURE 2

OHIO RIVER
 345.87 FT
 NAVD88

GIS FILE PATH: \\haleyaldrich.com\share\gim\common\129420_Vectren\GIS\129420_Vectren\129420_Vectren.aprx — USER: tciskowski — LAST SAVED: 1/16/2024 2:37 PM




LEGEND

-  PIEZOMETER
-  UPGRADIENT GROUNDWATER MONITORING WELL
-  DOWNGRADIENT GROUNDWATER MONITORING WELL
-  GROUNDWATER ELEVATION CONTOUR, 10-FT INTERVAL, DASHED WHERE INFERRED
-  GROUNDWATER FLOW DIRECTION
-  PROPERTY BOUNDARY
-  APPROXIMATE UNIT BOUNDARY

NOTES

1. ALL LOCATIONS AND DIMENSIONS ARE APPROXIMATE
2. WATER LEVELS GAGED 6 NOVEMBER 2023
3. OHIO RIVER STAGE MEASURED ON 6 NOVEMBER 2023 BY USGS GAGE 03322190 AT HENDERSON, KY, APPROXIMATELY 13.5 MILES UPSTREAM FROM A.B. BROWN GENERATING STATION.
4. GROUNDWATER VELOCITY SHOWN IN FEET PER YEAR
5. $V = \frac{K(i)}{n_e}$
 V = GROUNDWATER VELOCITY (FT/YR)
 K = HYDRAULIC CONDUCTIVITY (FT/YR)
 i = GROUNDWATER GRADIENT
 n_e = EFFECTIVE POROSITY
6. AERIAL IMAGERY SOURCE: HEXAGON, 21 JULY 2023.



HALEY ALDRICH

A.B. BROWN GENERATING STATION
 SEDIMENTATION POND
 POSEY COUNTY, INDIANA

**WATER TABLE CONFIGURATION
 SEDIMENTATION POND
 6 NOVEMBER 2023**

JANUARY 2024

FIGURE 3

OHIO RIVER
 342.03 FT
 NAVD88

APPENDIX A
Summary of Statistical Analysis



HALEY & ALDRICH, INC.
6500 Rockside Road
Suite 200
Cleveland, OH 44131
216.739.0555

TECHNICAL MEMORANDUM

13 March 2023
File No. 129420

TO: Southern Indiana Gas and Electric Company

FROM: Haley & Aldrich, Inc.
Todd Plating, Sr. Project Manager
Steven F. Putrich, P.E., Project Principal

SUBJECT: Statistical Evaluation of the November 2022 Semi-annual Groundwater Assessment Monitoring Data
Southern Indiana Gas and Electric Company
Sedimentation Pond
A.B. Brown Generating Station; Posey County, Indiana

Pursuant to Title 40 Code of Federal Regulations (40 CFR) § 257.93 and § 257.95 (Rule), this memorandum summarizes the statistical evaluation of the analytical results for the November 2022 semi-annual assessment monitoring event for the A.B. Brown Generating Station Sedimentation Pond. Haley & Aldrich, Inc. (Haley & Aldrich) completed this statistical evaluation to determine if Appendix IV groundwater monitoring constituents have been detected in downgradient wells at statistically significant levels (SSL) greater than Groundwater Protection Standards (GWPS), consistent with the requirements in 40 CFR § 257.95.

Methods used during this statistical analysis are described in the *Statistical Data Analysis Plan for the A.B Brown Generating Station Sediment Pond* (Haley & Aldrich, 2017). A summary of how applicable performance standards described in § 257.93 (g) were achieved include:

- § 257.93 (g) (1) – Data set distribution was evaluated using basic summary statistics, graphical methods, and the Shapiro-Wilks Test of Normality. Parametric methods were used where normal distributions were identified. Those data sets were evaluated for outliers using box plots, Dixon’s test and Rosner’s test. Outlier identification and data set distribution groups are summarized in Attachment A.
- § 257.93 (g) (2) – Not applicable
- § 257.93 (g) (3) – Not applicable
- § 257.93 (g) (4) – Levels of confidence and additional supporting information for the use of tolerance intervals and prediction limits are included in Attachment A.

- § 257.93 (g) (5) – Non-detect values were accounted for by simple substitution, where the detection limit replaced the non-detect result. Non-detect values are identified and summarized in Attachment A.
- § 257.93 (g) (6) – Time series plots for groundwater monitoring wells included in this evaluation were reviewed to identify potential seasonal variability. No additional statistics to account for seasonality of spatial variability were necessary.

Data from the groundwater sampling event for the downgradient monitoring wells (CCR-SP-1 through CCR-SP-3) were compared to the GWPS established from the background dataset for the upgradient monitoring wells (CCR-BK-1 and CCR-BK-2) for detected Appendix IV constituents. GWPS for each of the Appendix IV constituents have been set equal to the highest value of the maximum contaminant level, regional screening level, or background concentration. The results of the assessment monitoring statistical evaluation are discussed below and provided in Attachment A.

Development of GWPS

The Rule provides four specific options for statistical evaluation of groundwater quality data collected at a coal combustion residual (CCR) unit (40 CFR §257.93(f) (1-4)). Haley & Aldrich certified the tolerance limit (TL) as the statistical method used for developing background concentration for the GWPS on 14 January 2019. As noted above, the GWPS for each of the Appendix IV constituents have been set equal to the highest value of the maximum contaminant level, regional screening level, or background concentration. The most recent groundwater sampling result from each compliance well was compared to the GWPS to determine if additional statistical testing is warranted.

STATISTICAL EVALUATION

An interwell statistical evaluation was used to identify SSLs. An interwell evaluation compares the most recent values from downgradient compliance wells to a background dataset composed of upgradient well data. Because the CCR unit is in assessment monitoring, no statistical evaluations were conducted on Appendix III (detection monitoring) constituents.

The parametric TL method was used to complete statistical evaluations of the referenced dataset. The TL procedure is one in which a concentration limit for each constituent is established from the distribution of the background data, with a minimum 95 percent confidence level. The upper endpoint of a tolerance interval is called the UTL. Depending on the data distribution, parametric or non-parametric TL procedures are used to evaluate groundwater monitoring data using this method. Parametric TLs utilize normally distributed data or data normalized via a transformation of the sample background data used to construct the limit. If the data are non-normal and a transformation is not indicated, non-parametric procedures (order statistics or bootstrap methods) are used to calculate the TL. If all the background data are non-detect, a maximum reporting limit may serve as an appropriate UTL.

These statistical evaluations were conducted using the background dataset for detected Appendix IV constituents using parametric TL. If an Appendix IV constituent concentration from the November 2022 sampling event was greater than the GWPS, the lower confidence limit (LCL) for the downgradient well constituent was used to evaluate if an SSL was indicated. The LCL is the lower end of the confidence interval range, which is an estimated concentration range intended to contain the true mean or median of the population from which the sample is drawn. The confidence interval range is designed to locate the true population mean or median with a high degree of statistical confidence, or conversely, with a low probability of error.

The UTLs were calculated from the background well dataset using Chemstat software after testing for outlier sample results that would warrant removal from the dataset based on likely error in sampling or measurement. Both visual and statistical outlier tests for the background data were performed using Chemstat and United States Environmental Protection Agency's ProUCL 5.1 software, and a visual inspection of the data was performed using box plots and distribution plots for the downgradient sample data. No sample data were identified as outliers that warranted removal from the dataset.

BACKGROUND DISTRIBUTIONS

The groundwater analytical results for each sampling event from the background sample locations were combined to calculate the UTL for each detected Appendix IV constituent. The variability and distribution of the pooled dataset was evaluated to determine the method for UTL calculation. The background concentrations were periodically updated per the document *Statistical Analysis of Groundwater Monitoring Data at RCRA Facilities, Unified Guidance, March 2009* (Unified Guidance).

TREND SUMMARY

Mann Kendall trend analyses were performed on data sets of sufficient sample size. Results of the trend analysis are included in Attachment A. In summary, 93 percent of trends analyzed are identified as stable or decreasing.

RESULTS OF APPENDIX IV DOWNGRADIANT STATISTICAL COMPARISONS

The sample concentrations from the downgradient wells for each of the detected Appendix IV constituents from the November 2022 assessment monitoring event were compared to their respective GWPS (Attachment A). A sample concentration greater than the GWPS is considered to represent an SSL. Based on previous compliance sampling events and statistical evaluations, interwell comparisons were utilized for downgradient wells and constituents. Based on this statistical evaluation an SSL greater than the GWPS was not identified at the Sedimentation Pond, however, the Sedimentation Pond will remain in Assessment Monitoring.

Attachment A – Summary of Assessment Monitoring Statistical Evaluation – November 2022

ATTACHMENT A
Summary of Assessment Monitoring Statistical
Evaluation – November 2022

Attachment A
 Assessment Monitoring Statistical Summary - November 2022
 A.B. Brown Generating Station
 Sedimentation Pond
 Prepared: 13 March 2023

Location ID	Frequency of Detection	Percent Non-Detect	Range of Non-Detect	Mean	50th Percentile (Median)	95th Percentile	Maximum Detect	Variance	Standard Deviation	Coefficient of Variance	CCR MCL/RSL	Report Result Unit	Detection Exceedances (Y/N)	Number of Detection Exceedances	Number of Non-Detection Exceedances	Outlier Presence	Outlier Removed	Trend	Distribution Group	Inter-well Analysis					GWPS																																
																				November 2022 Concentrations (mg/L)	Detect?	Lower Confidence Level (LCL)	Upper Tolerance Limit (mg/L)	SSI (Exceedance above Background at Individual Well)	Groundwater Protection Standard (Higher of MCL/RSL or Upper Tolerance Limit) (mg/L)	Exceedance above GWPS at Individual Well	SSL																														
CCR Appendix-IV: Antimony, Total (mg/L)																																																									
CCR-BK-1	2/18	89%	0.002-0.002	0.00362	0.004	0.004	0.0009	0.00000629	0.0011216	0.621	0.006	mg/L	N	0	0	N	N	Stable	Non-parametric																																						
CCR-BK-2	1/18	94%	0.002-0.002	0.00384	0.004	0.004	0.00096	2.494E-07	0.0007062	0.3686	0.006	mg/L	N	0	0	N	N	Stable	Non-parametric			0.002								0.006																											
CCR-SP-1	0/17	100%	0.002-0.002	0.004	0.004	0.004		0	0	0	0.006	mg/L	N	0	0	N	N	NA	Non-parametric			0.002	N																																		
CCR-SP-2	0/17	100%	0.002-0.002	0.004	0.004	0.004		0	0	0	0.006	mg/L	N	0	0	N	N	NA	Non-parametric			0.002	N																																		
CCR-SP-3	0/17	100%	0.002-0.002	0.004	0.004	0.004		0	0	0	0.006	mg/L	N	0	0	N	N	NA	Non-parametric			0.002	N																																		
CCR Appendix-IV: Arsenic, Total (mg/L)																																																									
CCR-BK-1	12/19	37%	0.001-0.001	0.001882	0.002	0.0033	0.005	5.078E-07	0.0010076	1.0708	0.01	mg/L	N	0	0	Y	N	Stable	Non-parametric					0.0035																																	
CCR-BK-2	8/19	58%	0.001-0.001	0.0024	0.002	0.00581	0.007	1.4288E-06	0.0016904	1.4056	0.01	mg/L	N	0	0	Y	N	Stable	Non-parametric																																						
CCR-SP-1	19/19	0%	-	0.01006	0.009	0.01648	0.026	0.0000956	0.004372	0.869	0.01	mg/L	Y	2	0	Y	N	Stable	Non-parametric			0.0074	Y																																		
CCR-SP-2	18/19	5%	0.001-0.001	0.00826	0.0032	0.0269	0.032	0.00004794	0.00979	2.372	0.01	mg/L	Y	8	0	N	N	Increase	Non-parametric			0.0110	Y	0.0010																																	
CCR-SP-3	19/19	0%	-	0.0296	0.0194	0.0724	0.086	0.000247	0.02222	1.5062	0.01	mg/L	Y	18	0	N	N	Decrease	Non-parametric			0.0088	Y																																		
CCR Appendix-IV: Barium, Total (mg/L)																																																									
CCR-BK-1	19/19	0%	-	0.0816	0.076	0.1317	0.164	0.0003158	0.02512	0.6152	2	mg/L	N	0	0	Y	N	Stable	Non-parametric					0.150																																	
CCR-BK-2	19/19	0%	-	0.088	0.074	0.1283	0.3	0.0013382	0.05174	1.1758	2	mg/L	N	0	0	Y	N	Stable	Non-parametric																																						
CCR-SP-1	19/19	0%	-	0.1604	0.166	0.206	0.24	0.0007338	0.0383	0.4776	2	mg/L	N	0	0	N	N	Decrease	Non-parametric			0.064	Y																																		
CCR-SP-2	19/19	0%	-	0.21	0.2	0.28	0.28	0.0013172	0.05132	0.489	2	mg/L	N	0	0	N	N	Stable	Non-parametric			0.096	Y																																		
CCR-SP-3	19/19	0%	-	0.1476	0.148	0.169	0.22	0.0002114	0.02056	0.2784	2	mg/L	N	0	0	Y	N	Stable	Non-parametric			0.076	Y																																		
CCR Appendix-IV: Beryllium, Total (mg/L)																																																									
CCR-BK-1	1/18	94%	0.001-0.001	0.001902	0.002	0.002	0.00024	8.358E-08	0.0004088	0.4298	0.004	mg/L	N	0	0	N	N	NA	Non-parametric					0.001																																	
CCR-BK-2	2/18	89%	0.001-0.001	0.001842	0.002	0.002	0.0008	1.0518E-07	0.0004586	0.498	0.004	mg/L	N	0	0	N	N	NA	Non-parametric																																						
CCR-SP-1	0/17	100%	0.001-0.001	0.002	0.002	0.002		0	0	0	0.004	mg/L	N	0	0	N	N	NA	Non-parametric			0.001	N																																		
CCR-SP-2	0/17	100%	0.001-0.001	0.002	0.002	0.002		0	0	0	0.004	mg/L	N	0	0	N	N	NA	Non-parametric			0.001	N																																		
CCR-SP-3	1/17	94%	0.001-0.001	0.001916	0.002	0.002	0.00058	5.75E-08	0.0003392	0.354	0.004	mg/L	N	0	0	N	N	NA	Non-parametric			0.001	N																																		
CCR Appendix-IV: Cadmium, Total (mg/L)																																																									
CCR-BK-1	0/19	100%	0.001-0.001	0.002	0.002	0.002		0	0	0	0.005	mg/L	N	0	0	N	N	NA	Non-parametric					0.001																																	
CCR-BK-2	0/19	100%	0.001-0.001	0.002	0.002	0.002		0	0	0	0.005	mg/L	N	0	0	N	N	NA	Non-parametric																																						
CCR-SP-1	0/17	100%	0.001-0.001	0.002	0.002	0.002		0	0	0	0.005	mg/L	N	0	0	N	N	NA	Non-parametric			0.001	N																																		
CCR-SP-2	2/17	88%	0.001-0.001	0.00179	0.002	0.002	0.00022	1.7174E-07	0.000586	0.6552	0.005	mg/L	N	0	0	N	N	NA	Non-parametric			0.001	N																																		
CCR-SP-3	1/17	94%	0.001-0.001	0.0019	0.002	0.002	0.0003	8.242E-08	0.000406	0.4274	0.005	mg/L	N	0	0	N	N	NA	Non-parametric			0.001	N																																		
CCR Appendix-IV: Chromium, Total (mg/L)																																																									
CCR-BK-1	13/19	32%	0.002-0.002	0.00456	0.004	0.00738	0.0152	0.00004206	0.0029	1.2714	0.1	mg/L	N	0	0	Y	N	Stable	Non-parametric					0.009																																	
CCR-BK-2	6/19	68%	0.002-0.002	0.0056	0.004	0.0106	0.0174	0.00000632	0.003556	1.2682	0.1	mg/L	N	0	0	Y	N	Stable	Non-parametric																																						
CCR-SP-1	1/19	95%	0.0017-0.002	0.00402	0.004	0.00415	0.005	3.652E-08	0.0002702	0.13444	0.1	mg/L	N	0	0	N	N	NA	Non-parametric			0.0020	N																																		
CCR-SP-2	6/19	68%	0.002-0.002	0.00364	0.004	0.00423	0.0044	3.688E-07	0.0008588	0.472	0.1	mg/L	N	0	0	N	N	Stable	Non-parametric			0.0020	N																																		
CCR-SP-3	2/19	89%	0.002-0.0023	0.00492	0.004	0.0073	0.0192	0.00005866	0.003426	1.3936	0.1	mg/L	N	0	0	Y	N	NA	Non-parametric			0.0020	N																																		
CCR Appendix-IV: Cobalt, Total (mg/L)																																																									
CCR-BK-1	15/19	21%	0.0005-0.0005	0.000727	0.0005	0.00226	0.0028	4.938E-07	0.0007027	0.9661	0.006	mg/L	N	0	0	Y	N	Decrease	Non-parametric					0.0062																																	
CCR-BK-2	9/19	53%	0.0005-0.0005	0.000858	0.0005	0.00197	0.0062	0.000001843	0.001358	1.582	0.006	mg/L	Y	1	0	Y	N	Stable	Non-parametric																																						
CCR-SP-1	19/19	0%	-	0.00497	0.0042	0.00783	0.0081	0.00004139	0.002034	0.4095	0.006	mg/L	Y	9	0	Y	N	Increase	Non-parametric			0.00420	Y																																		
CCR-SP-2	19/19	0%	-	0.000959	0.00084	0.00192	0.0021	2.356E-07	0.0004854	0.5059	0.006	mg/L	N	0	0	N	N	Stable	Non-parametric			0.00065	Y																																		
CCR-SP-3	19/19	0%	-	0.000952	0.00072	0.00153	0.0054	0.000001207	0.001099	1.154	0.006	mg/L	N	0	0	Y	N	Decrease	Non-parametric			0.00054	Y																																		
CCR Appendix-III/IV: Fluoride (mg/L)																																																									
CCR-BK-1	17/19	11%	0.23-0.23	0.642	0.66	0.743	0.76	0.005134	0.10134	0.3162	4	mg/L	N	0	0	N	N	Stable	Non-parametric					0.380																																	
CCR-BK-2	17/19	11%	0.11-0.12	0.318	0.3	0.459	0.68	0.006022	0.10974	0.6882	4	mg/L	N	0	0	N	N	Stable	Non-parametric																																						
CCR-SP-1	15/19	21%	0.1-0.25	0.514	0.5	0.71	1.56	0.03652	0.2702	1.0522	4	mg/L	N	0	0	Y	N	Stable	Non-parametric			0.25	N																																		
CCR-SP-2	18/19	5%	0.16-0.16	0.612	0.64	0.76	0.76	0.007702	0.12412	0.4052	4	mg/L	N	0	0	N	N	Decrease	Non-parametric			0.16																																			

Attachment A
Assessment Monitoring Statistical Summary - November 2022
A.B. Brown Generating Station
Sedimentation Pond
Prepared: 13 March 2023

Location ID	Frequency of Detection	Percent Non-Detect	Range of Non-Detect	Mean	50th Percentile (Median)	95th Percentile	Maximum Detect	Variance	Standard Deviation	Coefficient of Variance	CCR MCL/RSL	Report Result Unit	Detection Exceedances (Y/N)	MCL Comparison		Outlier Presence	Outlier Removed	Trend	Distribution Group	Inter-well Analysis				GWPS		
														Number of Detection Exceedances	Number of Non-Detection Exceedances					November 2022 Concentrations (mg/L)	Detect?	Lower Confidence Level (LCL)	Upper Tolerance Limit (mg/L)	SSI (Exceedance above Background at Individual Well)	Groundwater Protection Standard (Higher of MCL/RSL or Upper Tolerance Limit) (mg/L)	Exceedance above GWPS at Individual Well
CCR Appendix-IV: Selenium, Total (mg/L)																										
CCR-BK-1	3/19	84%	0.005-0.005	0.00858	0.01	0.01	0.00134	0.00005494	0.003314	0.7724	0.05	mg/L	N	0	0	N	N	NA	Non-parametric							
CCR-BK-2	2/19	89%	0.005-0.005	0.0091	0.01	0.01	0.00196	0.0000355	0.002664	0.5856	0.05	mg/L	N	0	0	Y	N	NA				0.005			0.050	
CCR-SP-1	1/17	94%	0.005-0.005	0.00946	0.01	0.01	0.00072	0.00002456	0.002216	0.4688	0.05	mg/L	N	0	0	N	N	NA								
CCR-SP-2	1/17	94%	0.005-0.005	0.00948	0.01	0.01	0.00126	0.00002178	0.002088	0.4402	0.05	mg/L	N	0	0	N	N	NA								
CCR-SP-3	1/17	94%	0.005-0.005	0.00946	0.01	0.01	0.00084	0.00002394	0.002188	0.4624	0.05	mg/L	N	0	0	N	N	NA			0.005	N				
CCR Appendix-IV: Thallium, Total (mg/L)																										
CCR-BK-1	2/18	89%	0.001-0.001	0.001812	0.002	0.002	0.00054	1.485E-07	0.000545	0.6016	0.002	mg/L	N	0	0	N	N	NA	Non-parametric							
CCR-BK-2	3/18	83%	0.001-0.001	0.001714	0.002	0.002	0.00038	0.00000211	0.0006498	0.758	0.002	mg/L	N	0	0	N	N	NA								
CCR-SP-1	2/17	88%	0.001-0.001	0.001778	0.002	0.002	0.000186	1.8948E-07	0.0006156	0.6922	0.002	mg/L	N	0	0	N	N	NA								
CCR-SP-2	2/17	88%	0.001-0.001	0.001822	0.002	0.002	0.00086	1.3252E-07	0.0005148	0.5654	0.002	mg/L	N	0	0	N	N	NA								
CCR-SP-3	3/17	82%	0.001-0.001	0.001692	0.002	0.002	0.00044	0.00000023	0.0006784	0.8016	0.002	mg/L	N	0	0	N	N	NA			0.001	N				

Notes:
¹ - Groundwater protection standards compared against lower confidence limit to determine statistically significant levels
CCR - Coal Combustion Residuals
MCL - Maximum Concentration Limit
mg/L - Milligrams per Liter
NA - Not Applicable
pCi/L - Picocurie per Liter
RSL - Regional Screening Level
SSI - Statistically Significant Increase
SSL - Statistically Significant Level



HALEY & ALDRICH, INC.
400 Augusta St.
Suite 100
Greenville, SC. 29601
864.214.8771

TECHNICAL MEMORANDUM

25 September 2023
File No. 0129420-027

TO: Southern Indiana Gas and Electric Company

FROM: Haley & Aldrich, Inc.
Todd Plating, Senior Project Manager
Steven F. Putrich, P.E., Project Principal

SUBJECT: Statistical Evaluation of the May 2023 Semi-Annual Groundwater
Assessment Monitoring Data
Southern Indiana Gas and Electric Company
Sedimentation Pond
A.B. Brown Generating Station; Posey County, Indiana

Pursuant to Title 40 Code of Federal Regulations (40 CFR) § 257.93 and § 257.95 (Rule), this memorandum summarizes the statistical evaluation of the analytical results for the May 2023 semi-annual assessment monitoring event for the A.B. Brown Generating Station Sedimentation Pond. Haley & Aldrich, Inc. (Haley & Aldrich) completed this statistical evaluation to determine if Appendix IV groundwater monitoring constituents have been detected in downgradient wells at statistically significant levels (SSL) greater than the Groundwater Protection Standards (GWPS), consistent with the requirements in 40 CFR § 257.95.

Methods used during this statistical analysis are described in Haley & Aldrich's 2017 *Statistical Data Analysis Plan for the A.B Brown Generating Station Sediment Pond*. A summary of how applicable performance standards described in 40 CFR § 257.93 (g) were achieved include:

- 40 CFR § 257.93 (g) (1) – Data set distribution was evaluated using basic summary statistics, graphical methods, and the Shapiro-Wilks Test of Normality. Parametric methods were used where normal distributions were identified. Those data sets were evaluated for outliers using box plots, Dixon's test and Rosner's test. Outlier identification and data set distribution groups are summarized in Attachment A.
- 40 CFR § 257.93 (g) (2) – Not applicable
- 40 CFR § 257.93 (g) (3) – Not applicable
- 40 CFR § 257.93 (g) (4) – Levels of confidence and additional supporting information for the use of tolerance intervals and prediction limits are included in Attachment A.

- 40 CFR § 257.93 (g) (5) – Non-detect values were accounted for by simple substitution, where the detection limit replaced the non-detect result. Non-detect values are identified and summarized in Attachment A.
- 40 CFR § 257.93 (g) (6) – Time series plots for groundwater monitoring wells included in this evaluation were reviewed to identify potential seasonal variability. No additional statistics to account for seasonality of spatial variability were necessary.

Data from the groundwater sampling event for the downgradient monitoring wells (CCR-SP-1 through CCR-SP-3) were compared to the GWPS established from the background dataset for the upgradient monitoring wells (CCR-BK-1 and CCR-BK-2) for detected Appendix IV constituents. GWPS for each of the Appendix IV constituents have been set equal to the highest value of the maximum contaminant level, regional screening level, or background concentration. The results of the assessment monitoring statistical evaluation are discussed below and provided in Attachment A.

Development of Groundwater Protection Standard

The Rule provides four specific options for statistical evaluation of groundwater quality data collected at a coal combustion residual (CCR) unit (40 CFR §257.93(f) (1-4)). Haley & Aldrich certified the tolerance limit (TL) as the statistical method used for developing background concentration for the GWPS on 14 January 2019. As noted above, the GWPS for each of the Appendix IV constituents have been set equal to the highest value of the maximum contaminant level, regional screening level, or background concentration. The most recent groundwater sampling result from each compliance well was compared to the GWPS to determine if additional statistical testing is warranted.

STATISTICAL EVALUATION

An interwell statistical evaluation was used to identify SSLs. An interwell evaluation compares the most recent values from downgradient compliance wells to a background dataset composed of upgradient well data. Because the CCR unit is in assessment monitoring, no statistical evaluations were conducted on Appendix III (detection monitoring) constituents.

The parametric TL method was used to complete statistical evaluations of the referenced dataset. The TL procedure is one in which a concentration limit for each constituent is established from the distribution of the background data, with a minimum 95 percent confidence level. The upper endpoint of a tolerance interval is called the UTL. Depending on the data distribution, parametric or non-parametric TL procedures are used to evaluate groundwater monitoring data using this method. Parametric TLs utilize normally distributed data or data normalized via a transformation of the sample background data used to construct the limit. If the data are non-normal and a transformation is not indicated, non-parametric procedures (order statistics or bootstrap methods) are used to calculate the TL. If all the background data are non-detect, a maximum reporting limit may serve as an appropriate UTL.

These statistical evaluations were conducted using the background dataset for detected Appendix IV constituents using parametric TL. If an Appendix IV constituent concentration from the May 2023

sampling event was greater than the GWPS, the lower confidence limit (LCL) for the downgradient well constituent was used to evaluate if an SSL was indicated. The LCL is the lower end of the confidence interval range, which is an estimated concentration range intended to contain the true mean or median of the population from which the sample is drawn. The confidence interval range is designed to locate the true population mean or median with a high degree of statistical confidence, or conversely, with a low probability of error.

The UTLs were calculated from the background well dataset using Chemstat software after testing for outlier sample results that would warrant removal from the dataset based on likely error in sampling or measurement. Both visual and statistical outlier tests for the background data were performed using Chemstat and United States Environmental Protection Agency's ProUCL 5.1 software, and a visual inspection of the data was performed using box plots and distribution plots for the downgradient sample data. No sample data were identified as outliers that warranted removal from the dataset.

BACKGROUND DISTRIBUTIONS

The groundwater analytical results for each sampling event from the background sample locations were combined to calculate the UTL for each detected Appendix IV constituent. The variability and distribution of the pooled dataset was evaluated to determine the method for UTL calculation. The background concentrations were periodically updated per the document *Statistical Analysis of Groundwater Monitoring Data at RCRA Facilities, Unified Guidance, March 2009*.

TREND SUMMARY

Mann-Kendall trend analyses were performed on data sets of sufficient sample size. In summary, 93 percent of trends analyzed are identified as stable or decreasing. Results of the trend analysis are included in Attachment A.

RESULTS OF APPENDIX IV DOWNGRADIENT STATISTICAL COMPARISONS

The sample concentrations from the downgradient wells for each of the detected Appendix IV constituents from the May 2023 assessment monitoring event were compared to their respective GWPS (Attachment A). A sample concentration greater than the GWPS is considered to represent an SSL. Based on previous compliance sampling events and statistical evaluations, interwell comparisons were utilized for downgradient wells and constituents. Based on this statistical evaluation an SSL greater than the GWPS was not identified at the Sedimentation Pond, however, the Sedimentation Pond will remain in Assessment Monitoring.

Enclosure

Attachment A – Assessment Monitoring Statistical Analysis Summary

Attachment A
 Assessment Monitoring Statistical Summary - May 2023
 A.B. Brown Generating Station
 Sedimentation Pond
 Prepared: 25 September 2023

Location ID	Frequency of Detection	Percent Non-Detect	Range of Non-Detect	Mean	50th Percentile (Median)	95th Percentile	Maximum Detect	Variance	Standard Deviation	Coefficient of Variance	CCR MCL/RSL	Report Result Unit	Detection Exceedances (Y/N)	Number of Detection Exceedances	Outlier Presence	Outlier Removed	Trend	Distribution Group	Inter-well Analysis					GWPS																			
																			May 2023 Concentrations (mg/L)	Detect?	Lower Confidence Limits (mg/L)	Upper Tolerance Limit (mg/L)	SSI	Background Limit (Higher of MCL/RSL or Upper Tolerance Limit) (mg/L)	Exceedance above Background at Individual Well	SSL																	
CCR Appendix-IV: Selenium, Total (mg/L)																																											
CCR-BK-1	3/20	85%	0.005-0.005	0.00866	0.01	0.01	0.00134	0.000005262	0.003244	0.7496	0.05	mg/L	N	0	N	N	NA	Non-parametric				0.005		0.050																			
CCR-BK-2	2/20	90%	0.005-0.005	0.00914	0.01	0.01	0.00196	0.000003388	0.002602	0.5692	0.05	mg/L	N	0	Y	N	NA																										
CCR-SP-1	1/18	94%	0.005-0.005	0.00948	0.01	0.01	0.00072	0.000002324	0.002156	0.4546	0.05	mg/L	N	0	N	N	NA		0.005	N					N	No																	
CCR-SP-2	1/18	94%	0.005-0.005	0.00952	0.01	0.01	0.00126	0.000002062	0.00203	0.4268	0.05	mg/L	N	0	N	N	NA		0.005	N					N	No																	
CCR-SP-3	1/18	94%	0.005-0.005	0.0095	0.01	0.01	0.00084	0.000002264	0.002128	0.4484	0.05	mg/L	N	0	N	N	NA		0.005	N					N	No																	
CCR Appendix-IV: Thallium, Total (mg/L)																																											
CCR-BK-1	2/19	89%	0.001-0.001	0.001822	0.002	0.002	0.00054	1.4136E-07	0.0005318	0.5838	0.002	mg/L	N	0	N	N	NA	Non-parametric						0.002																			
CCR-BK-2	3/19	84%	0.001-0.001	0.00173	0.002	0.002	0.00038	2.018E-07	0.0006352	0.7346	0.002	mg/L	N	0	N	N	NA							0.001		0.002																	
CCR-SP-1	2/18	89%	0.001-0.001	0.001792	0.002	0.002	0.000186	1.7998E-07	0.0006	0.67	0.002	mg/L	N	0	N	N	NA		0.001	N					N	No																	
CCR-SP-2	2/18	89%	0.001-0.001	0.001832	0.002	0.002	0.00086	1.258E-07	0.0005016	0.548	0.002	mg/L	N	0	N	N	NA		0.001	N					N	No																	
CCR-SP-3	3/18	83%	0.001-0.001	0.00171	0.002	0.002	0.00044	2.194E-07	0.0006626	0.7752	0.002	mg/L	N	0	N	N	NA		0.001	N					N	No																	

Notes:
 CCR - Coal Combustion Residuals
 MCL - Maximum Concentration Limit
 mg/L - Milligrams per Liter
 NA - Not Applicable
 pCi/L - Picocuries per Liter
 RSL - Regional Screening Level
 SSI - Statistically Significant Increase
 SSL - Statistically Significant Level

APPENDIX B
Field Forms



GROUNDWATER LEVEL MONITORING REPORT

Form FMG 5.1-01
Rev (06-09-09)

Project:	AB Brown Generating Station	Client: SIGECO	File Number: 0129420-037-001-01
Location:	Evansville, SC	Weather: Rain / Overcast	Project Manager: Neal Kochis
Reference:	Top of Casing	Units: ft	Field Representative: F. Reed, A.Wykel
Method:	Dip	Comments: None	

CCR Unit	Monitoring Well ID	Date	Time	Well Dry? (Y/N)	Depth to Water (ft)	Depth to top of pump	Well Bottom (Measured)	Well Bottom (From Table)	Riser Elevation (ft)	Water Elevation (ft)	Remarks	Measured By
AshPond	CCR-BK-1R	5/8/2023	1256	N	61.24	60.49	67.05	64.00	483.39	422.15		AW
	CCR-BK-2	5/8/2023	1240	N	17.62	25.06	-	25.50	430.60	412.98		AW
	CCR-AP-1R	5/8/2023	1451	N	16.28	33.71	-	37.00	467.57	451.29		AW
	CCR-AP-2IR	5/8/2023	830	N	35.83	86.34	-	93.00	468.88	433.05		AW
	CCR-AP-2R	5/8/2023	840	N	44.46	49.52	-	53.30	468.13	423.67		AW
	CCR-AP-3R	5/8/2023	910	N	39.79	40.54	-	47.00	449.13	409.34		AW
	CCR-AP-3I	5/8/2023	1055	N	28.84	69.27	-	77.50	450.35	421.51		AW
	CCR-AP-4	5/8/2023	1509	N	33.93	44.54	-	48.00	475.38	441.45		AW
	CCR-AP-5R	5/8/2023	1103	N	35.80	44.41	-	-	453.14	417.34		AW
	CCR-AP-6	5/8/2023	1330	N	18.53	38.26	-	39.00	461.57	443.04		AW
	CCR-AP-7	5/8/2023	1320	N	34.83	49.77	-	-	488.57	453.74		AW
	CCR-AP-8	5/8/2023	1348	N	1.47	12.83	-	16.20	417.17	415.70		AW
	CCR-AP-9	5/8/2023	1403	N	9.23	26.96	-	35.20	392.51	383.28		AW
	CCR-AP-10	5/8/2023	1510	N	36.25	40.47	-	43.20	474.34	438.09		AW
	CCR-AP-11	5/8/2023	1540	N	10.34	NA	25.21	-	376.72	366.38		AW
	FD-PZ-1	5/8/2023	1600	N	7.25	NA	17.73	-	418.94	411.69		AW
FD-PZ-2	5/8/2023	1655	N	3.12	NA	33.23	-	423.34	420.22		AW	
	MH-1	-	-	-	-	-	-	-	-	-		AW
	MH-2	-	-	-	-	-	-	-	-	-		AW
Landfill	CCR-LF-1	5/8/2023	1147	N	8.37	18.29	-	19.00	435.63	427.26		AW
	CCR-LF-2	5/8/2023	1130	N	27.97	44.34	-	45.00	473.00	445.03		AW
	CCR-LF-3	5/8/2023	1138	N	30.88	34.15	-	35.00	484.75	453.87		AW
	CCR-LF-4	5/8/2023	1307	N	48.30	54.34	-	55.00	478.85	430.55		AW
	CCR-LF-5	5/8/2023	1222	N	21.59	29.93	-	30.00	430.41	408.82		AW
	CCR-LF-6	5/8/2023	1217	N	7.18	8.79	-	9.66	412.05	404.87		AW
Sed Pond	CCR-SP-1	5/8/2023	1205	N	10.89	16.46	-	20.00	403.51	392.62		AW
	CCR-SP-2	5/8/2023	1200	N	14.05	15.26	-	20.00	403.23	389.18		AW
	CCR-SP-3	5/8/2023	1208	N	5.94	15.71	-	20.00	403.57	397.63		AW



LOW FLOW SAMPLING FORM

PROJECT A.B. Brown Generating Station
LOCATION Evansville, Indiana
CLIENT Southern Indiana Gas and Electric Company
CONTRACTOR N/A

H&A FILE NO. 129420
PROJECT MGR. Neal Kochis
FIELD REP. A. Wykel
SAMPLING DATE 05/11/23

Sampling Data: Well Depth as Built: 20.5 ft Well Diameter: 2.0 in Purging Device: Bladder
 Well ID: CCR-SP-3 Well Depth Measured: NA ft Initial Depth To Water: 10.99 ft Field Parameter Device: Horiba U-52
 Start time: 11:15 Depth To Top Of Screen: 10.0 ft Depth Of Pump Intake: 16.46 ft Tubing Present In Well: Yes No
 Finish Time: 12:35 Depth To Bottom Of Scree 20.0 ft Measuring Point: Top of Casing (TOC) Tubing Type: Polyethylene

Elapsed Time (24 hour)	Depth To Water From Casing (ft)	Pump Setting (ml/min) or (gal/min)	Purge Rate (ml/min) or (gal/min)	Cumulative Purge Vol. (liters) or (gal)	Temp-erature (°F) or (°C)	pH	Conduct-ivity (ms/cm)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	ORP/eH (mv)	Comments
Stabilized within →		[100 mL/min] to [500 mL/min]		-	NA	[+/- 0.1]	[+/- 3%]	[+/- 10%]	[+/- 10%]	[+/- 10]	
11:20	11.14	100	100	0	18.9	6.75	2.13	1.9	404	-135	*well pad is cracked
11:25	11.15	100	100	0.5	18.61	6.67	2.16	1.43	351	-142	
11:30	11.20	200	200	1.5	17.61	6.64	2.2	2.29	211	-150	Debris from pump in purge bucket, cleared after 3
11:40	11.24	200	200	2.25	16.78	6.62	2.1	1.76	101	-150	cycles, looked like sediment
11:45	11.28	200	200	3.75	16.73	6.61	2.1	1.6	35.6	-146	
11:50	11.30	200	200	5.25	16.74	6.6	2.1	1.5	25.1	-143	
11:55	11.30	150	150	6	16.74	6.6	2.11	1.53	20	-138	
12:00	11.31	150	150	6.75	16.94	6.6	2.11	1.25	16	-137	
12:05	11.32	150	150	7.5	17.05	6.6	2.11	1.23	10.7	-136	
12:10	11.32	150	150	8.25	17.02	6.6	2.11	1.17	9.7	-135	
12:15	11.32	150	150	9	17.16	6.59	2.11	1.1	8.9	-133	STABLE
											Sample Time: 12:20
											Sample ID: CCR-SP-1-051123

well volume = 3.14 (PI) x radius² x height of water column. 2 in well = 0.163 gal/ft, 3 in = 0.367 gal/ft 4 in = 0.653 gal/ft, 6 in = 1.469 gal/ft, 1 cu. ft. = 7.48 gal, 1 gal = 3.785 L, 1L = 0.264 gal, 0.5L/min = 0.132 gal/min



LOW FLOW SAMPLING FORM

PROJECT A.B. Brown Generating Station
LOCATION Evansville, Indiana
CLIENT Southern Indiana Gas and Electric Company
CONTRACTOR N/A

H&A FILE NO. 129420
PROJECT MGR. Neal Kochis
FIELD REP. F. Reed
SAMPLING DATE 05/11/23

Sampling Data: Well Depth as Built: 25.5 ft Well Diameter: 2.0 in Purging Device: Bladder
 Well ID: CCR-SP-2 Well Depth Measured: 20 ft Initial Depth To Water: 13.91 ft Field Parameter Device: Horiba U-52
 Start time: 8:30 Depth To Top Of Screen: 10.0 ft Depth Of Pump Intake: 15.26 ft Tubing Present In Well: Yes No
 Finish Time: 11:20 Depth To Bottom Of Scree 20.0 ft Measuring Point: Top of Casing (TOC) Tubing Type: Polyethylene

Elapsed Time (24 hour)	Depth To Water From Casing (ft)	Pump Setting (ml/min)	Purge Rate (ml/min)	Cumulative Purge Vol. (liters)	Temperature (°C)	pH	Conductivity (ms/cm)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	ORP/eH (mv)	Comments
Stabilized within →		[100 mL/min] to [500 mL/min]		-	NA	[+/- 0.1]	[+/- 3%]	[+/- 10%]	[+/- 10%]	[+/- 10]	
8:40	14.35	100	100	0.3	16.87	6.64	1.8	0.68	808	-5	
8:45	14.48	100	100	0.5	16.7	6.59	1.81	0.42	780	-20	
8:50	14.60	100	100	0.8	16.66	6.55	1.81	0.27	685	-35	
8:55	14.69	100	100	1.5	16.64	6.55	1.81	0.15	548	-46	
9:00	14.75	100	100	2.0	16.62	6.57	1.8	0.04	383	-53	
9:05	14.83	100	100	2.3	16.58	6.56	1.79	0.00	279	-59	
9:10	14.87	100	100	2.95	16.59	6.58	1.79	0.00	210	-63	
9:15	14.91	100	100	3.5	16.59	6.58	1.79	0.00	160	-66	
9:20	14.91	100	100	3.9	16.64	6.62	1.78	0.00	130	-69	
9:25	14.91	100	100	4.2	16.77	6.61	1.78	0.00	118	-71	
9:30	14.89	100	100	4.8	16.87	6.62	1.77	0.00	90.9	-73	
9:35	14.87	80	80	5.0	16.88	6.62	1.76	0.00	83.1	-74	Sample Time: 10:05
9:40	14.86	80	80	5.3	16.9	6.65	1.75	0.00	70.5	-77	Sample ID: CCR-SP-2-051123
9:45	14.91	100	100	6.0	16.76	6.63	1.75	0.00	58.3	-77	Field Dup: DUP2-051123
9:50	14.96	100	100	6.4	16.79	6.65	1.75	0.00	53.3	-79	
9:55	15.00	100	100	6.9	16.86	6.65	1.75	0.00	47.2	-80	
10:00	15.00	100	100	7.2	16.92	6.64	1.75	0.00	44.9	-81	STABLE
											Depth to water after sampling: 15.18'

well volume = 3.14 (PI) x radius² x height of water column.

2 in well = 0.163 gal/ft, 3 in = 0.367 gal/ft 4 in = 0.653 gal/ft, 6 in = 1.469 gal/ft, 1 cu. ft. = 7.48 gal, 1 gal = 3.785 L, 1L = 0.264 gal, 0.5L/min = 0.132 gal/min

HALEY ALDRICH		GROUNDWATER LEVEL MONITORING REPORT										Form FMG 5.1-01 Rev (06-09-09)
Project:		AB Brown		Client: SIGECO				File Number: 0129420-027				
Location:		Evansville, IN		Weather: Partly Cloudy, 65 °F				Project Manager: Neal Kochis				
Reference:		Top of Casing		Units: ft				Field Representative: F. Reed, R. Elwer				
Method:		Dip		Comments:								
CCR Unit	Monitoring Well ID	Date	Time	Well Dry? (Y/N)	Depth to Water (ft)	Depth to top of pump	Well Bottom (Measured)	Well Bottom (From Table)	Riser Elevation (ft)	Water Elevation (ft)	Remarks	Measured By
AshPond	CCR-BK-1R	11/6/2023	10:32	Y	-	60.49	-	64.00	483.39	-	Water level below the top of the pump	F.Reed
	CCR-BK-2	11/6/2023	10:40	Y	-	25.06	NA	25.50	430.60	-	Water level below the top of the pump	F. Reed
	CCR-AP-1R	11/6/2023	11:11	N	20.73	33.71	-	39.87	467.57	446.84	Dedicated Pump	F.Reed
	CCR-AP-2I	11/6/2023	13:44	N	39.95	86.34	-	64.78	465.79	425.84	Dedicated Pump	F.Reed
	CCR-AP-2R	11/6/2023	13:43	N	48.38	49.52	-	56.03	468.13	419.75	Dedicated Pump	F.Reed
	CCR-AP-3R	11/6/2023	13:05	N	-	40.64	46.03	47.00	449.13	-	Water level below the top of the pump	F.Reed
	CCR-AP-3I	11/6/2023	13:00	N	30.45	69.27	-	77.50	450.35	419.90	Dedicated Pump	F.Reed
	CCR-AP-4	11/6/2023	11:20	N	35.39	44.54	-	50.58	475.38	439.99	Dedicated Pump	F.Reed
	CCR-AP-5R	11/6/2023	13:38	N	36.91	44.41	-	47.14	453.14	416.23	No bolts, well box filled with water	F.Reed
	CCR-AP-6	11/6/2023	10:06	N	20.38	38.26	-	41.67	461.57	441.19	Taken from the original survey height	F.Reed
	CCR-AP-7R	11/6/2023	10:12	N	36.14	49.77	-	56.07	488.57	452.43	Dedicated Pump	F.Reed
	CCR-AP-8	11/6/2023	9:58	N	4.19	12.83	-	19.37	417.17	412.98	Dedicated Pump	F.Reed
	CCR-AP-9	11/6/2023	9:20	N	10.14	26.96	33.55	35.20	392.51	392.51	Dedicated Pump	F.Reed
	CCR-AP-10	11/6/2023	11:23	N	39.17	40.47	-	46.04	474.34	435.17	Dedicated Pump	F.Reed
	CCR-AP-11	11/6/2023	10:50	N	14.37	N/A	25.27	25.27	376.72	362.35	No Pump	R. Elwer
	FD-PZ-1	11/6/2023	13:30	N	7.99	N/A	17.33	-	418.94	410.95	No Pump	R. Elwer
	FD-PZ-2	11/6/2023	12:22	N	5.59	N/A	33.18	-	423.34	417.75	No Pump	F.Reed
	FD-PZ-4	11/6/2023	12:45	N	10.58	N/A	22.85	-	419.19	408.61	No Pump	F.Reed
	HA-PP-1	11/6/2023	15:22	N	3.19	N/A	-	-	381.82	378.63	No Pump	F. Reed
	HA-PP-2	11/6/2023	15:25	N	3.83	N/A	-	-	381.51	377.68	No Pump	F. Reed
	CMA-01S	11/6/2023	13:31	N	31.92	N/A	-	47.31	445.87	413.95	No Pump	F. Reed
	CMA-01I	11/6/2023	13:32	N	32.83	N/A	-	72.45	446.25	413.42	No Pump	F. Reed
	CMA-02S	11/6/2023	13:28	N	26.96	N/A	-	50.85	436.63	409.67	No Pump	F. Reed
	CMA-02I	11/6/2023	13:29	N	26.55	N/A	-	76.18	436.51	409.96	No Pump	F. Reed
	CMA-03S	11/6/2023	13:26	N	29.13	N/A	-	50.95	436.29	407.16	No Pump	F. Reed
	CMA-03I	11/6/2023	13:27	N	28.83	N/A	-	76.65	436.16	407.33	No Pump	F. Reed
	CMA-04S	11/6/2023	13:19	N	25.63	N/A	-	46.98	435.89	410.26	No Pump	F. Reed
	CMA-04I	11/6/2023	13:21	N	28.19	N/A	-	76.56	436.21	408.02	No Pump	F. Reed
CMA-04BR	11/6/2023	13:24	N	19.71	N/A	-	108.21	436.54	416.83	No Pump	F. Reed	

HALEY ALDRICH		GROUNDWATER LEVEL MONITORING REPORT										Form FMG 5.1-01 Rev (06-09-09)
Project:		AB Brown		Client: SIGECO				File Number: 0129420-027				
Location:		Evansville, IN		Weather: Partly Cloudy, 65 °F				Project Manager: Neal Kochis				
Reference:		Top of Casing		Units: ft				Field Representative: F. Reed, R. Elwer				
Method:		Dip		Comments:								
CCR Unit	Monitoring Well ID	Date	Time	Well Dry? (Y/N)	Depth to Water (ft)	Depth to top of pump	Well Bottom (Measured)	Well Bottom (From Table)	Riser Elevation (ft)	Water Elevation (ft)	Remarks	Measured By
Ash Pond	CMA-05S	11/6/2023	13:14	N	25.06	N/A	43.01	42.96	436.26	411.20	No Pump	F. Reed
	CMA-05I	11/6/2023	13:16	N	25.56	N/A	-	67.16	436.52	410.96	No Pump	F. Reed
	CMA-06S	11/6/2023	9:36	N	10.92	N/A	34.12	33.94	392.08	381.16	No Pump	F. Reed
	CMA-06I	11/6/2023	9:39	N	8.68	N/A	59.71	59.55	392.22	383.54	No Pump	F. Reed
	CMA-06BR	11/6/2023	9:41	N	9.45	N/A	79.82	70.55	392.44	382.99	No Pump	F. Reed
	CMA-07I	11/6/2023	11:42	N	22.28	N/A	47.65	47.42	419.95	397.67	No Pump	R. Elwer
	CMA-08I	11/6/2023	11:36	N	42.13	N/A	53.04	52.85	443.25	401.12	No Pump	F. Reed
Landfill	CCR-LF-1	11/6/2023	14:06	N	11.23	18.29	-	19.00	435.63	424.40	Dedicated Pump	F.Reed
	CCR-LF-2	11/6/2023	13:55	N	28.60	44.34	-	45.00	473.00	444.40	Dedicated Pump	F.Reed
	CCR-LF-3	11/6/2023	14:00	N	31.44	34.15	-	35.00	484.75	453.31	Dedicated Pump	F.Reed
	CCR-LF-4	11/6/2023	10:25	N	48.22	54.34	-	55.00	478.85	430.63	Dedicated Pump	F.Reed
	CCR-LF-5	11/6/2023	14:24	N	22.20	29.93	-	30.00	430.41	408.21	Dedicated Pump	F.Reed
	CCR-LF-6	11/6/2023	14:20	N	7.67	8.79	-	9.66	412.05	404.38	Pump gets caught on lid when closing well	F.Reed
Sed Pond	CCR-SP-1	11/6/2023	14:53	N	11.80	16.46	-	20.00	403.51	391.71	Dedicated Pump	F.Reed
	CCR-SP-2	11/6/2023	14:45	N	14.64	15.26	-	20.00	403.23	388.59	PVC bent over pump, had to pry the pump out	F.Reed
	CCR-SP-3	11/6/2023	-	N	-	15.71	-	20.00	403.57	-	Well casing damaged, see photos	F.Reed



LOW FLOW SAMPLING FORM

PROJECT A.B. Brown Generating Station
LOCATION Evansville, Indiana
CLIENT Southern Indiana Gas and Electric Company
CONTRACTOR N/A

H&A FILE NO. 129420
PROJECT MGR. Neal Kochis
FIELD REP. F. Reed
SAMPLING DATE 11/10/23

Sampling Data: Well Depth as Built: 20.5 ft Well Diameter: 2.0 in Purging Device: Peristaltic
 Well ID: CCR-SP-1 Well Depth Measured: 20.25 ft Initial Depth To Water: 10 ft Field Parameter Device: Horiba U-52
 Start time: 7:40 Depth To Top Of Screen: 10.0 ft Depth Of Pump Intake: 15 ft Tubing Present In Well: Yes No
 Finish Time: 8:50 Depth To Bottom Of Scree: 20.0 ft Measuring Point: Top of Casing (TOC) Tubing Type: Polyethylene

Elapsed Time (24 hour)	Depth To Water From Casing (ft)	Pump Setting (ml/min) or (gal/min)	Purge Rate (ml/min) or (gal/min)	Cumulative Purge Vol. (liters) or (gal)	Temperature (°F) or (°C)	pH	Conductivity (ms/cm)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	ORP/eH (mv)	Comments
Stabilized within →		[100 mL/min] to [500 mL/min]		-	NA	[+/- 0.1]	[+/- 3%]	[+/- 10%]	[+/- 10%]	[+/- 10]	
7:55	10.31		200	1.5	24.06	5.38	3.7	1.12	2.3	110	
8:00	10.28		200	2.5	24.53	5.91	3.67	0.42	1.3	42	
8:05	10.32		200	3.25	24.82	5.99	3.64	0.26	1.5	32	
8:10	10.34		200	4.25	24.91	6.04	3.63	0.13	0	28	
8:15	10.36		200	5.5	25.16	6.06	3.61	0.11	0	26	
8:20	10.37		200	7	25.37	6.08	3.59	0.09	0	25	
8:25	10.38		200	8	25.45	6.08	3.58	0.07	0	24	
8:30	10.39		200	9	25.52	6.09	3.56	0.07	0	24	Sample Time: 08:40
8:35	10.4		200	10	25.65	6.1	3.55	0.05	0	23	Sample ID: CCR-SP-1-111023
Well pad is damaged, the water levels were taken from the north side of the PVC with depth below											Field Blank: 08:30
ground surface.											Field Blank ID: FB-2-111023

well volume = 3.14 (PI) x radius² x height of water column. 2 in well = 0.163 gal/ft, 3 in = 0.367 gal/ft 4 in = 0.653 gal/ft, 6 in = 1.469 gal/ft, 1 cu. ft. = 7.48 gal, 1 gal = 3.785 L, 1L = 0.264 gal, 0.5L/min = 0.132 gal/min



LOW FLOW SAMPLING FORM

PROJECT A.B. Brown Generating Station
LOCATION Evansville, Indiana
CLIENT Southern Indiana Gas and Electric Company
CONTRACTOR N/A

H&A FILE NO. 129420
PROJECT MGR. Neal Kochis
FIELD REP. F. Reed
SAMPLING DATE 11/09/23

Sampling Data: Well Depth as Built: 25.5 ft Well Diameter: 2.0 in Purging Device: Bladder
 Well ID: CCR-SP-2 Well Depth Measured: N/A ft Initial Depth To Water: 14.7 ft Field Parameter Device: Horiba U-52
 Start time: 14:00 Depth To Top Of Screen: 10.0 ft Depth Of Pump Intake: 16.56 ft Tubing Present In Well: Yes No
 Finish Time: 15:35 Depth To Bottom Of Scree 20.0 ft Measuring Point: Top of Casing (TOC) Tubing Type: Polyethylene

Elapsed Time (24 hour)	Depth To Water From Casing (ft)	Pump Setting (ml/min) or (gal/min)	Purge Rate (ml/min) or (gal/min)	Cumulative Purge Vol. (liters) or (gal)	Temp-erature (°F) or (°C)	pH	Conduct-ivity (ms/cm)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	ORP/eH (mv)	Comments
Stabilized within →		[100 mL/min] to [500 mL/min]		-	NA	[+/- 0.1]	[+/- 3%]	[+/- 10%]	[+/- 10%]	[+/- 10]	
14:10	15.27		100	1	25.76	6.63	1.69	0.3	182	-44	
14:15	15.27		100	1.9	25.77	6.61	1.7	0.19	193	-51	
14:20	15.34		100	2.2	25.79	6.6	1.71	0.1	183	-57	
14:25	15.43		100	2.8	25.8	6.6	1.72	0.04	145	-62	
14:30	15.5		100	3.2	25.78	6.6	1.72	0.03	112	-64	
14:35	15.62		100	3.8	25.75	6.6	1.72	0.02	88.8	-60	
14:40	15.65		100	4.2	25.72	6.6	1.72	0	75.9	-67	Dup Sample Time: 15:05
14:45	15.68		100	4.8	25.7	6.6	1.72	0	67	-68	Field Dup ID: DUP-2-110923
14:50	15.73		100	5.2	25.68	6.6	1.72	0	59.1	-69	
14:55	15.79		100	5.8	25.65	6.6	1.72	0	52.8	-69	Sample Time: 15:05
15:00	15.85		100	6.2	25.65	6.6	1.72	0	52.3	-69	Sample ID: CCR-SP-2-110923
											The samples were a tinge brown, the field dup was slightly more turbid.

well volume = 3.14 (PI) x radius² x height of water column. 2 in well = 0.163 gal/ft, 3 in = 0.367 gal/ft 4 in = 0.653 gal/ft, 6 in = 1.469 gal/ft, 1 cu. ft. = 7.48 gal, 1 gal = 3.785 L, 1L = 0.264 gal, 0.5L/min = 0.132 gal/min



LOW FLOW SAMPLING FORM

PROJECT A.B. Brown Generating Station
LOCATION Evansville, Indiana
CLIENT Southern Indiana Gas and Electric Company
CONTRACTOR N/A

H&A FILE NO. 129420
PROJECT MGR. Neal Kochis
FIELD REP. F. Reed
SAMPLING DATE 11/09/23

Sampling Data: Well Depth as Built: 20.5 ft Well Diameter: 2.0 in Purging Device: Bladder
 Well ID: CCR-SP-3 Well Depth Measured: N/A ft Initial Depth To Water: 12.01 ft Field Parameter Device: Horiba U-52
 Start time: 11:25 Depth To Top Of Screen: 10.0 ft Depth Of Pump Intake: 15.71 ft Tubing Present In Well: Yes No
 Finish Time: 12:50 Depth To Bottom Of Scree 20.0 ft Measuring Point: Top of Casing (TOC) Tubing Type: Polyethylene

Elapsed Time (24 hour)	Depth To Water From Casing (ft)	Pump Setting (ml/min) or (gal/min)	Purge Rate (ml/min) or (gal/min)	Cumulative Purge Vol. (liters) or (gal)	Temperature (°F) or (°C)	pH	Conductivity (ms/cm)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	ORP/eH (mv)	Comments
Stabilized within →		[100 mL/min] to [500 mL/min]		-	NA	[+/- 0.1]	[+/- 3%]	[+/- 10%]	[+/- 10%]	[+/- 10]	
11:40	12.29		180	0.5	25.58	7.16	0.747	0.82	21.3	-5	
11:45	12.53		180	1	25.7	6.88	0.686	0.19	5.9	-13	
11:50	12.74		180	2.25	25.76	6.8	0.674	0.09	0	-11	
11:55	12.92		160	3	25.79	6.77	0.673	0.22	0.4	-14	
12:00	12.95		100	3.5	25.76	6.76	0.672	0.29	0	-18	
12:05	13.05		100	4	25.75	6.76	0.672	0.38	0	-24	
12:10	13.15		100	4.5	25.7	6.75	0.671	0.45	0	-26	
12:15	13.24		100	5	25.69	6.75	0.671	0.48	0	-25	Sample Time: 12:25
12:20	13.32		100	5.5	25.63	6.74	0.671	0.47	0	-28	Sample ID: CCR-SP-3-110923

well volume = 3.14 (PI) x radius² x height of water column. 2 in well = 0.163 gal/ft, 3 in = 0.367 gal/ft 4 in = 0.653 gal/ft, 6 in = 1.469 gal/ft, 1 cu. ft. = 7.48 gal, 1 gal = 3.785 L, 1L = 0.264 gal, 0.5L/min = 0.132 gal/min

APPENDIX C
Laboratory Analytical Report



ANALYTICAL REPORT

PREPARED FOR

Attn: Todd Plating
Haley & Aldrich, Inc.
400 Augusta Street
Suite 100
Greenville, South Carolina 29601

Generated 6/27/2023 1:09:43 PM

JOB DESCRIPTION

AB Brown Generating Station
SDG NUMBER Sedimentation Pond

JOB NUMBER

180-156542-1

Eurofins Pittsburgh

Job Notes

This report may not be reproduced except in full, and with written approval from the laboratory. The results relate only to the samples tested. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

PA Lab ID: 02-00416

The test results in this report relate only to the samples as received by the laboratory and will meet all requirements of the methodology, with any exceptions noted. This report shall not be reproduced except in full, without the express written approval of the laboratory. All questions should be directed to the Eurofins Pittsburgh Project Manager.

Authorization



Generated
6/27/2023 1:09:43 PM

Authorized for release by
Ken Hayes, Project Manager II
Ken.Hayes@et.eurofinsus.com
(615)301-5035



Table of Contents

Cover Page	1
Table of Contents	3
Case Narrative	4
Definitions/Glossary	6
Certification Summary	7
Sample Summary	9
Method Summary	10
Lab Chronicle	11
Client Sample Results	14
QC Sample Results	19
QC Association Summary	24
Chain of Custody	27
Receipt Checklists	28

Case Narrative

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
SDG: Sedimentation Pond

Job ID: 180-156542-1

Laboratory: Eurofins Pittsburgh

Narrative

Job Narrative 180-156542-1

Receipt

The samples were received on 5/12/2023 9:45 AM. Unless otherwise noted below, the samples arrived in good condition, and, where required, properly preserved and on ice. The temperatures of the 2 coolers at receipt time were 2.6°C and 4.9°C

Gas Flow Proportional Counter

Method 9315_Ra226: Radium-226 Prep Batch 160-612377An LCS/LCSD was inadvertently added to the batch to insure batch precision. Batch contains a sample duplicate (160-50003-B-1 DU) with a standard aliquot of 1000 mL.

Method 9315_Ra226: Radium-228 Prep Batch 160-612446The following sample was prepared at a reduced aliquot due to Matrix: CCR-SP-1-051123 (180-156542-3). A laboratory control sample/ laboratory control sample duplicate (LCS/LCSD) were prepared instead of a sample duplicate (DUP) to demonstrate batch precision.

Method 9315_Ra226: Radium-226 batch 612377Any minimum detectable concentration (MDC), critical value (DLC), or Safe Drinking Water Act detection limit (SDWA DL) is sample-specific unless otherwise stated elsewhere in this narrative. Radiochemistry sample results are reported with the count date/time applied as the Activity Reference Date.CCR-SP-2-051123 (180-156542-1), DUP2-051123 (180-156542-2), CCR-SP-1-051123 (180-156542-3), CCR-SP-3-051123 (180-156542-4), (LCS 160-612377/2-A), (LCSD 160-612377/3-A), (MB 160-612377/1-A), (160-50003-C-1-D) and (160-50003-B-1-B DU)

Method 9320_Ra228: Radium-228 Prep Batch 160-612446The following sample was prepared at a reduced aliquot due to Matrix: CCR-SP-1-051123 (180-156542-3). A laboratory control sample/ laboratory control sample duplicate (LCS/LCSD) were prepared instead of a sample duplicate (DUP) to demonstrate batch precision.

Method 9320_Ra228: Radium-228 Prep Batch 160-612446An LCS/LCSD was inadvertently added to the batch to insure batch precision. Batch contains a sample duplicate (160-50003-B-1 DU) with a standard aliquot of 1000 mL.

Method 9320_Ra228: Radium-228 batch 612446Any minimum detectable concentration (MDC), critical value (DLC), or Safe Drinking Water Act detection limit (SDWA DL) is sample-specific unless otherwise stated elsewhere in this narrative. Radiochemistry sample results are reported with the count date/time applied as the Activity Reference Date.CCR-SP-2-051123 (180-156542-1), DUP2-051123 (180-156542-2), CCR-SP-1-051123 (180-156542-3), CCR-SP-3-051123 (180-156542-4), (LCS 160-612446/2-A), (LCSD 160-612446/3-A), (MB 160-612446/1-A), (160-50003-C-1-C) and (160-50003-B-1-A DU)

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

Rad

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

Narrative

Job Narrative 180-156542-2

Receipt

The samples were received on 5/12/2023 9:45 AM. Unless otherwise noted below, the samples arrived in good condition, and, where required, properly preserved and on ice. The temperatures of the 2 coolers at receipt time were 2.6°C and 4.9°C

HPLC/IC

Method 9056A_ORGFM_28D: Due to the high concentration of sulfate, the matrix spike / matrix spike duplicate (MS/MSD) for analytical batch 180-435094 could not be evaluated for accuracy and precision. The associated laboratory control sample (LCS) met acceptance criteria.

Case Narrative

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
SDG: Sedimentation Pond

Job ID: 180-156542-1 (Continued)

Laboratory: Eurofins Pittsburgh (Continued)

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

Metals

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

General Chemistry

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

1

2

3

4

5

6

7

8

9

10

11

12

13

Definitions/Glossary

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
SDG: Sedimentation Pond

Qualifiers

HPLC/IC

Qualifier	Qualifier Description
4	MS, MSD: The analyte present in the original sample is greater than 4 times the matrix spike concentration; therefore, control limits are not applicable.
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

Metals

Qualifier	Qualifier Description
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

Rad

Qualifier	Qualifier Description
U	Result is less than the sample detection limit.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
α	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CFU	Colony Forming Unit
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MCL	EPA recommended "Maximum Contaminant Level"
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
MPN	Most Probable Number
MQL	Method Quantitation Limit
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
NEG	Negative / Absent
POS	Positive / Present
PQL	Practical Quantitation Limit
PRES	Presumptive
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)
TNTC	Too Numerous To Count

Accreditation/Certification Summary

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
SDG: Sedimentation Pond

Laboratory: Eurofins Pittsburgh

All accreditations/certifications held by this laboratory are listed. Not all accreditations/certifications are applicable to this report.

Authority	Program	Identification Number	Expiration Date
Arkansas DEQ	State	19-033-0	06-25-23
California	State	2891	04-30-24
Connecticut	State	PH-0688	06-25-23
Florida	NELAP	E871008	06-25-23
Georgia	State	PA 02-00416	06-25-23
Illinois	NELAP	004375	06-30-24
Kansas	NELAP	E-10350	06-25-23
Kentucky (UST)	State	162013	04-30-23 *
Kentucky (WW)	State	KY98043	06-25-23
Louisiana	NELAP	04041	06-30-22 *
Louisiana (All)	NELAP	04041	06-25-23
Maine	State	PA00164	03-06-24
Minnesota	NELAP	042-999-482	06-25-23
New Hampshire	NELAP	2030	06-25-23
New Jersey	NELAP	PA005	06-25-23
New York	NELAP	11182	06-25-23
North Carolina (WW/SW)	State	434	12-31-23
North Dakota	State	R-227	04-30-24
Oregon	NELAP	PA-2151	02-06-24
Pennsylvania	NELAP	02-00416	06-25-23
Rhode Island	State	LAO00362	12-31-22 *
South Carolina	State	89014	04-30-23 *
Texas	NELAP	T104704528	06-25-23
US Fish & Wildlife	US Federal Programs	058448	03-31-24
USDA	US Federal Programs	P330-16-00211	06-21-24
Utah	NELAP	PA001462019-8	05-31-24
Virginia	NELAP	10043	06-25-23
West Virginia DEP	State	142	06-25-23
Wisconsin	State	998027800	08-31-23

Laboratory: Eurofins St. Louis

All accreditations/certifications held by this laboratory are listed. Not all accreditations/certifications are applicable to this report.

Authority	Program	Identification Number	Expiration Date
Alaska (UST)	State	20-001	05-06-25
ANAB	Dept. of Defense ELAP	L2305	04-06-25
ANAB	Dept. of Energy	L2305.01	04-06-25
ANAB	ISO/IEC 17025	L2305	04-06-25
Arizona	State	AZ0813	12-08-23
California	Los Angeles County Sanitation Districts	10259	06-30-22 *
California	State	2886	06-30-23
Connecticut	State	PH-0241	03-31-25
Florida	NELAP	E87689	06-30-23
HI - RadChem Recognition	State	n/a	06-30-23
Illinois	NELAP	200023	11-30-23
Iowa	State	373	12-01-24
Kansas	NELAP	E-10236	10-31-23
Kentucky (DW)	State	KY90125	12-31-23
Kentucky (WW)	State	KY90125 (Permit KY0004049)	12-31-23

* Accreditation/Certification renewal pending - accreditation/certification considered valid.

Eurofins Pittsburgh

Accreditation/Certification Summary

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
SDG: Sedimentation Pond

Laboratory: Eurofins St. Louis (Continued)

All accreditations/certifications held by this laboratory are listed. Not all accreditations/certifications are applicable to this report.

Authority	Program	Identification Number	Expiration Date
Louisiana (All)	NELAP	04080	06-30-23
Louisiana (DW)	State	LA011	12-31-23
Maryland	State	310	09-30-23
MI - RadChem Recognition	State	9005	06-30-23
Missouri	State	780	06-30-25
Nevada	State	MO000542020-1	07-31-23
New Jersey	NELAP	MO002	06-30-23
New York	NELAP	11616	03-31-24
North Carolina (DW)	State	29700	07-31-23
North Dakota	State	R-207	06-30-23
Oklahoma	NELAP	9997	08-31-23
Oregon	NELAP	4157	09-01-23
Pennsylvania	NELAP	68-00540	02-28-24
South Carolina	State	85002001	06-30-23
Texas	NELAP	T104704193	07-31-23
US Fish & Wildlife	US Federal Programs	058448	07-31-23
USDA	US Federal Programs	P330-17-00028	05-18-26
Utah	NELAP	MO000542021-14	07-31-23
Virginia	NELAP	10310	06-14-23
Washington	State	C592	08-30-23
West Virginia DEP	State	381	10-31-23

Sample Summary

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
SDG: Sedimentation Pond

<u>Lab Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Collected</u>	<u>Received</u>
180-156542-1	CCR-SP-2-051123	Water	05/11/23 10:05	05/12/23 09:45
180-156542-2	DUP2-051123	Water	05/11/23 10:05	05/12/23 09:45
180-156542-3	CCR-SP-1-051123	Water	05/11/23 12:20	05/12/23 09:45
180-156542-4	CCR-SP-3-051123	Water	05/11/23 10:15	05/12/23 09:45

1

2

3

4

5

6

7

8

9

10

11

12

13

Method Summary

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
SDG: Sedimentation Pond

Method	Method Description	Protocol	Laboratory
9315	Radium-226 (GFPC)	SW846	EET SL
9320	Radium-228 (GFPC)	SW846	EET SL
Ra226_Ra228	Combined Radium-226 and Radium-228	TAL-STL	EET SL
PrecSep_0	Preparation, Precipitate Separation	None	EET SL
PrecSep-21	Preparation, Precipitate Separation (21-Day In-Growth)	None	EET SL

Protocol References:

None = None

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

TAL-STL = TestAmerica Laboratories, St. Louis, Facility Standard Operating Procedure.

Laboratory References:

EET SL = Eurofins St. Louis, 13715 Rider Trail North, Earth City, MO 63045, TEL (314)298-8566

Lab Chronicle

Client: Haley & Aldrich, Inc.
 Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
 SDG: Sedimentation Pond

Client Sample ID: CCR-SP-2-051123

Lab Sample ID: 180-156542-1

Date Collected: 05/11/23 10:05

Matrix: Water

Date Received: 05/12/23 09:45

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A		1	1 mL	1 mL	435094	05/13/23 12:10	SNL	EET PIT
Instrument ID: INTEGRION										
Total Recoverable	Prep	3005A			50 mL	50 mL	436357	05/26/23 13:00	HCY	EET PIT
Total Recoverable	Analysis	EPA 6010D		1			438036	06/14/23 14:43	AAS	EET PIT
Instrument ID: Q										
Total Recoverable	Prep	3005A			50 mL	50 mL	436345	05/26/23 13:00	HCY	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			438772	06/22/23 22:13	KED	EET PIT
Instrument ID: NEMO										
Total Recoverable	Prep	3005A			50 mL	50 mL	436345	05/26/23 13:00	HCY	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			438909	06/23/23 18:35	KED	EET PIT
Instrument ID: NEMO										
Total/NA	Prep	7470A			25 mL	25 mL	436976	06/05/23 10:15	MTW	EET PIT
Total/NA	Analysis	EPA 7470A		1			437135	06/06/23 12:06	MTW	EET PIT
Instrument ID: HGZ										
Total/NA	Analysis	SM 2540C		1	100 mL	100 mL	435349	05/16/23 17:00	LWM	EET PIT
Instrument ID: NOEQUIP										
Total/NA	Prep	PrecSep-21			1000.41 mL	1.0 g	612377	05/19/23 13:41	MLK	EET SL
Total/NA	Analysis	9315		1			616059	06/14/23 10:30	FLC	EET SL
Instrument ID: GFPCPURPLE										
Total/NA	Prep	PrecSep_0			1000.41 mL	1.0 g	612446	05/19/23 13:56	MLK	EET SL
Total/NA	Analysis	9320		1			615739	06/13/23 13:14	FLC	EET SL
Instrument ID: GFPCRED										
Total/NA	Analysis	Ra226_Ra228		1			616090	06/14/23 16:18	SCB	EET SL
Instrument ID: NOEQUIP										

Client Sample ID: DUP2-051123

Lab Sample ID: 180-156542-2

Date Collected: 05/11/23 10:05

Matrix: Water

Date Received: 05/12/23 09:45

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A		1	1 mL	1 mL	435094	05/13/23 13:06	SNL	EET PIT
Instrument ID: INTEGRION										
Total Recoverable	Prep	3005A			50 mL	50 mL	436357	05/26/23 13:00	HCY	EET PIT
Total Recoverable	Analysis	EPA 6010D		1			438036	06/14/23 14:48	AAS	EET PIT
Instrument ID: Q										
Total Recoverable	Prep	3005A			50 mL	50 mL	436345	05/26/23 13:00	HCY	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			438772	06/22/23 22:16	KED	EET PIT
Instrument ID: NEMO										
Total Recoverable	Prep	3005A			50 mL	50 mL	436345	05/26/23 13:00	HCY	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			438909	06/23/23 18:38	KED	EET PIT
Instrument ID: NEMO										
Total/NA	Prep	7470A			25 mL	25 mL	436976	06/05/23 10:15	MTW	EET PIT
Total/NA	Analysis	EPA 7470A		1			437135	06/06/23 12:07	MTW	EET PIT
Instrument ID: HGZ										

Lab Chronicle

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
SDG: Sedimentation Pond

Client Sample ID: DUP2-051123

Lab Sample ID: 180-156542-2

Date Collected: 05/11/23 10:05

Matrix: Water

Date Received: 05/12/23 09:45

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	SM 2540C		1	100 mL	100 mL	435349	05/16/23 17:00	LWM	EET PIT
Total/NA	Prep	PrecSep-21			1000.74 mL	1.0 g	612377	05/19/23 13:41	MLK	EET SL
Total/NA	Analysis	9315		1			616059	06/14/23 10:30	FLC	EET SL
Instrument ID: GFPCPURPLE										
Total/NA	Prep	PrecSep_0			1000.74 mL	1.0 g	612446	05/19/23 13:56	MLK	EET SL
Total/NA	Analysis	9320		1			615739	06/13/23 13:14	FLC	EET SL
Instrument ID: GFPCRED										
Total/NA	Analysis	Ra226_Ra228		1			616090	06/14/23 16:18	SCB	EET SL
Instrument ID: NOEQUIP										

Client Sample ID: CCR-SP-1-051123

Lab Sample ID: 180-156542-3

Date Collected: 05/11/23 12:20

Matrix: Water

Date Received: 05/12/23 09:45

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A		1	1 mL	1 mL	435094	05/13/23 13:24	SNL	EET PIT
Instrument ID: INTEGRION										
Total Recoverable	Prep	3005A			50 mL	50 mL	436357	05/26/23 13:00	HCY	EET PIT
Total Recoverable	Analysis	EPA 6010D		1			438036	06/14/23 14:53	AAS	EET PIT
Instrument ID: Q										
Total Recoverable	Prep	3005A			50 mL	50 mL	436345	05/26/23 13:00	HCY	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			438772	06/22/23 22:19	KED	EET PIT
Instrument ID: NEMO										
Total Recoverable	Prep	3005A			50 mL	50 mL	436345	05/26/23 13:00	HCY	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			438909	06/23/23 18:40	KED	EET PIT
Instrument ID: NEMO										
Total/NA	Prep	7470A			25 mL	25 mL	436976	06/05/23 10:15	MTW	EET PIT
Total/NA	Analysis	EPA 7470A		1			437135	06/06/23 12:08	MTW	EET PIT
Instrument ID: HGZ										
Total/NA	Analysis	SM 2540C		1	100 mL	100 mL	435349	05/16/23 17:00	LWM	EET PIT
Instrument ID: NOEQUIP										
Total/NA	Prep	PrecSep-21			751.55 mL	1.0 g	612377	05/19/23 13:41	MLK	EET SL
Total/NA	Analysis	9315		1			616059	06/14/23 10:30	FLC	EET SL
Instrument ID: GFPCPURPLE										
Total/NA	Prep	PrecSep_0			751.55 mL	1.0 g	612446	05/19/23 13:56	MLK	EET SL
Total/NA	Analysis	9320		1			615739	06/13/23 13:16	FLC	EET SL
Instrument ID: GFPCRED										
Total/NA	Analysis	Ra226_Ra228		1			616090	06/14/23 16:18	SCB	EET SL
Instrument ID: NOEQUIP										

Lab Chronicle

Client: Haley & Aldrich, Inc.
 Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
 SDG: Sedimentation Pond

Client Sample ID: CCR-SP-3-051123

Lab Sample ID: 180-156542-4

Date Collected: 05/11/23 10:15

Matrix: Water

Date Received: 05/12/23 09:45

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A		1	1 mL	1 mL	435094	05/13/23 13:43	SNL	EET PIT
Instrument ID: INTEGRION										
Total Recoverable	Prep	3005A			50 mL	50 mL	436357	05/26/23 13:00	HCY	EET PIT
Total Recoverable	Analysis	EPA 6010D		1			438036	06/14/23 14:59	AAS	EET PIT
Instrument ID: Q										
Total Recoverable	Prep	3005A			50 mL	50 mL	436345	05/26/23 13:00	HCY	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			438772	06/22/23 22:28	KED	EET PIT
Instrument ID: NEMO										
Total Recoverable	Prep	3005A			50 mL	50 mL	436345	05/26/23 13:00	HCY	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			438909	06/23/23 18:43	KED	EET PIT
Instrument ID: NEMO										
Total/NA	Prep	7470A			25 mL	25 mL	436973	06/05/23 10:15	MTW	EET PIT
Total/NA	Analysis	EPA 7470A		1			437135	06/06/23 11:23	MTW	EET PIT
Instrument ID: HGZ										
Total/NA	Analysis	SM 2540C		1	100 mL	100 mL	435349	05/16/23 17:00	LWM	EET PIT
Instrument ID: NOEQUIP										
Total/NA	Prep	PrecSep-21			1007.70 mL	1.0 g	612377	05/19/23 13:41	MLK	EET SL
Total/NA	Analysis	9315		1			616059	06/14/23 10:31	FLC	EET SL
Instrument ID: GFPCPURPLE										
Total/NA	Prep	PrecSep_0			1007.70 mL	1.0 g	612446	05/19/23 13:56	MLK	EET SL
Total/NA	Analysis	9320		1			615739	06/13/23 13:17	FLC	EET SL
Instrument ID: GFPCRED										
Total/NA	Analysis	Ra226_Ra228		1			616090	06/14/23 16:18	SCB	EET SL
Instrument ID: NOEQUIP										

Laboratory References:

EET SL = Eurofins St. Louis, 13715 Rider Trail North, Earth City, MO 63045, TEL (314)298-8566

Analyst References:

Lab: EET PIT

Batch Type: Prep

HCY = Harrison Yaeger

MTW = Michael Wesoloski

Batch Type: Analysis

AAS = Arianna Swick

KED = Katie Dacko

LWM = Leslie McIntire

MTW = Michael Wesoloski

SNL = Sean Lordo

Lab: EET SL

Batch Type: Prep

MLK = Micha Korrinhizer

Batch Type: Analysis

FLC = Fernando Cruz

SCB = Sarah Bernsen

Client Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
SDG: Sedimentation Pond

Client Sample ID: CCR-SP-2-051123

Lab Sample ID: 180-156542-1

Date Collected: 05/11/23 10:05

Matrix: Water

Date Received: 05/12/23 09:45

Method: SW846 EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	60		1.0	0.71	mg/L			05/13/23 12:10	1
Fluoride	0.16		0.10	0.026	mg/L			05/13/23 12:10	1
Sulfate	460		1.0	0.76	mg/L			05/13/23 12:10	1

Method: SW846 EPA 6010D - Metals (ICP) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Boron	270		200	13	ug/L		05/26/23 13:00	06/14/23 14:43	1

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	ND		0.0020	0.00097	mg/L		05/26/23 13:00	06/22/23 22:13	1
Arsenic	0.0080		0.0010	0.00028	mg/L		05/26/23 13:00	06/22/23 22:13	1
Barium	0.11		0.010	0.0031	mg/L		05/26/23 13:00	06/22/23 22:13	1
Beryllium	ND		0.0010	0.00027	mg/L		05/26/23 13:00	06/22/23 22:13	1
Cadmium	ND		0.0010	0.00022	mg/L		05/26/23 13:00	06/22/23 22:13	1
Calcium	250		0.50	0.13	mg/L		05/26/23 13:00	06/22/23 22:13	1
Chromium	ND		0.0020	0.0015	mg/L		05/26/23 13:00	06/22/23 22:13	1
Cobalt	0.00085		0.00050	0.00026	mg/L		05/26/23 13:00	06/23/23 18:35	1
Lead	0.00055	J	0.0010	0.00038	mg/L		05/26/23 13:00	06/22/23 22:13	1
Lithium	0.0054		0.0050	0.0013	mg/L		05/26/23 13:00	06/22/23 22:13	1
Molybdenum	0.00089	J	0.0050	0.00061	mg/L		05/26/23 13:00	06/22/23 22:13	1
Selenium	ND		0.0050	0.00074	mg/L		05/26/23 13:00	06/22/23 22:13	1
Thallium	ND		0.0010	0.00047	mg/L		05/26/23 13:00	06/22/23 22:13	1

Method: SW846 EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		06/05/23 10:15	06/06/23 12:06	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids (SM 2540C)	1200		10	10	mg/L			05/16/23 17:00	1

Method: SW846 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count Uncert. (2σ+/-)	Total Uncert. (2σ+/-)	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
Radium-226	0.0111	U	0.164	0.164	1.00	0.321	pCi/L	05/19/23 13:41	06/14/23 10:30	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	82.5		30 - 110					05/19/23 13:41	06/14/23 10:30	1

Method: SW846 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count Uncert. (2σ+/-)	Total Uncert. (2σ+/-)	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
Radium-228	0.447	U	0.357	0.360	1.00	0.548	pCi/L	05/19/23 13:56	06/13/23 13:14	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	82.5		30 - 110					05/19/23 13:56	06/13/23 13:14	1
Y Carrier	83.4		30 - 110					05/19/23 13:56	06/13/23 13:14	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
SDG: Sedimentation Pond

Client Sample ID: CCR-SP-2-051123

Lab Sample ID: 180-156542-1

Date Collected: 05/11/23 10:05

Matrix: Water

Date Received: 05/12/23 09:45

Method: TAL-STL Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count Uncert. (2σ+/-)	Total Uncert. (2σ+/-)	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
Combined Radium 226 + 228	0.459	U	0.393	0.396	5.00	0.548	pCi/L		06/14/23 16:18	1

Client Sample ID: DUP2-051123

Lab Sample ID: 180-156542-2

Date Collected: 05/11/23 10:05

Matrix: Water

Date Received: 05/12/23 09:45

Method: SW846 EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	62		1.0	0.71	mg/L			05/13/23 13:06	1
Fluoride	0.19		0.10	0.026	mg/L			05/13/23 13:06	1
Sulfate	450		1.0	0.76	mg/L			05/13/23 13:06	1

Method: SW846 EPA 6010D - Metals (ICP) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Boron	260		200	13	ug/L		05/26/23 13:00	06/14/23 14:48	1

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	ND		0.0020	0.00097	mg/L		05/26/23 13:00	06/22/23 22:16	1
Arsenic	0.0076		0.0010	0.00028	mg/L		05/26/23 13:00	06/22/23 22:16	1
Barium	0.11		0.010	0.0031	mg/L		05/26/23 13:00	06/22/23 22:16	1
Beryllium	ND		0.0010	0.00027	mg/L		05/26/23 13:00	06/22/23 22:16	1
Cadmium	ND		0.0010	0.00022	mg/L		05/26/23 13:00	06/22/23 22:16	1
Calcium	240		0.50	0.13	mg/L		05/26/23 13:00	06/22/23 22:16	1
Chromium	ND		0.0020	0.0015	mg/L		05/26/23 13:00	06/22/23 22:16	1
Cobalt	0.00085		0.00050	0.00026	mg/L		05/26/23 13:00	06/23/23 18:38	1
Lead	0.00046	J	0.0010	0.00038	mg/L		05/26/23 13:00	06/22/23 22:16	1
Lithium	0.0049	J	0.0050	0.0013	mg/L		05/26/23 13:00	06/22/23 22:16	1
Molybdenum	0.00069	J	0.0050	0.00061	mg/L		05/26/23 13:00	06/22/23 22:16	1
Selenium	ND		0.0050	0.00074	mg/L		05/26/23 13:00	06/22/23 22:16	1
Thallium	ND		0.0010	0.00047	mg/L		05/26/23 13:00	06/22/23 22:16	1

Method: SW846 EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		06/05/23 10:15	06/06/23 12:07	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids (SM 2540C)	1200		10	10	mg/L			05/16/23 17:00	1

Method: SW846 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count Uncert. (2σ+/-)	Total Uncert. (2σ+/-)	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
Radium-226	0.271	U	0.207	0.209	1.00	0.302	pCi/L	05/19/23 13:41	06/14/23 10:30	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	77.3		30 - 110					05/19/23 13:41	06/14/23 10:30	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
SDG: Sedimentation Pond

Client Sample ID: DUP2-051123

Lab Sample ID: 180-156542-2

Date Collected: 05/11/23 10:05

Matrix: Water

Date Received: 05/12/23 09:45

Method: SW846 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert.	Uncert.						
			(2σ+/-)	(2σ+/-)						
Radium-228	0.290	U	0.386	0.386	1.00	0.644	pCi/L	05/19/23 13:56	06/13/23 13:14	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	77.3		30 - 110					05/19/23 13:56	06/13/23 13:14	1
Y Carrier	82.6		30 - 110					05/19/23 13:56	06/13/23 13:14	1

Method: TAL-STL Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert.	Uncert.						
			(2σ+/-)	(2σ+/-)						
Combined Radium 226 + 228	0.561	U	0.438	0.439	5.00	0.644	pCi/L		06/14/23 16:18	1

Client Sample ID: CCR-SP-1-051123

Lab Sample ID: 180-156542-3

Date Collected: 05/11/23 12:20

Matrix: Water

Date Received: 05/12/23 09:45

Method: SW846 EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	75		1.0	0.71	mg/L			05/13/23 13:24	1
Fluoride	0.083	J	0.10	0.026	mg/L			05/13/23 13:24	1
Sulfate	750		1.0	0.76	mg/L			05/13/23 13:24	1

Method: SW846 EPA 6010D - Metals (ICP) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Boron	400		200	13	ug/L		05/26/23 13:00	06/14/23 14:53	1

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	ND		0.0020	0.00097	mg/L		05/26/23 13:00	06/22/23 22:19	1
Arsenic	0.0039		0.0010	0.00028	mg/L		05/26/23 13:00	06/22/23 22:19	1
Barium	0.10		0.010	0.0031	mg/L		05/26/23 13:00	06/22/23 22:19	1
Beryllium	ND		0.0010	0.00027	mg/L		05/26/23 13:00	06/22/23 22:19	1
Cadmium	ND		0.0010	0.00022	mg/L		05/26/23 13:00	06/22/23 22:19	1
Calcium	260		0.50	0.13	mg/L		05/26/23 13:00	06/22/23 22:19	1
Chromium	ND		0.0020	0.0015	mg/L		05/26/23 13:00	06/22/23 22:19	1
Cobalt	0.0052		0.00050	0.00026	mg/L		05/26/23 13:00	06/23/23 18:40	1
Lead	0.00057	J	0.0010	0.00038	mg/L		05/26/23 13:00	06/22/23 22:19	1
Lithium	0.0046	J	0.0050	0.0013	mg/L		05/26/23 13:00	06/22/23 22:19	1
Molybdenum	0.00091	J	0.0050	0.00061	mg/L		05/26/23 13:00	06/22/23 22:19	1
Selenium	ND		0.0050	0.00074	mg/L		05/26/23 13:00	06/22/23 22:19	1
Thallium	ND		0.0010	0.00047	mg/L		05/26/23 13:00	06/22/23 22:19	1

Method: SW846 EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		06/05/23 10:15	06/06/23 12:08	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids (SM 2540C)	1700		10	10	mg/L			05/16/23 17:00	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
SDG: Sedimentation Pond

Client Sample ID: CCR-SP-1-051123

Lab Sample ID: 180-156542-3

Date Collected: 05/11/23 12:20

Matrix: Water

Date Received: 05/12/23 09:45

Method: SW846 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count Uncert. (2σ+/-)	Total Uncert. (2σ+/-)	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
Radium-226	0.128	U	0.209	0.210	1.00	0.364	pCi/L	05/19/23 13:41	06/14/23 10:30	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	88.0		30 - 110					05/19/23 13:41	06/14/23 10:30	1

Method: SW846 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count Uncert. (2σ+/-)	Total Uncert. (2σ+/-)	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
Radium-228	0.00321	U	0.381	0.381	1.00	0.722	pCi/L	05/19/23 13:56	06/13/23 13:16	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	88.0		30 - 110					05/19/23 13:56	06/13/23 13:16	1
Y Carrier	82.3		30 - 110					05/19/23 13:56	06/13/23 13:16	1

Method: TAL-STL Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count Uncert. (2σ+/-)	Total Uncert. (2σ+/-)	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
Combined Radium 226 + 228	0.131	U	0.435	0.435	5.00	0.722	pCi/L		06/14/23 16:18	1

Client Sample ID: CCR-SP-3-051123

Lab Sample ID: 180-156542-4

Date Collected: 05/11/23 10:15

Matrix: Water

Date Received: 05/12/23 09:45

Method: SW846 EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	10		1.0	0.71	mg/L			05/13/23 13:43	1
Fluoride	0.30		0.10	0.026	mg/L			05/13/23 13:43	1
Sulfate	24		1.0	0.76	mg/L			05/13/23 13:43	1

Method: SW846 EPA 6010D - Metals (ICP) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Boron	16	J	200	13	ug/L		05/26/23 13:00	06/14/23 14:59	1

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	ND		0.0020	0.00097	mg/L		05/26/23 13:00	06/22/23 22:28	1
Arsenic	0.0037		0.0010	0.00028	mg/L		05/26/23 13:00	06/22/23 22:28	1
Barium	0.072		0.010	0.0031	mg/L		05/26/23 13:00	06/22/23 22:28	1
Beryllium	ND		0.0010	0.00027	mg/L		05/26/23 13:00	06/22/23 22:28	1
Cadmium	ND		0.0010	0.00022	mg/L		05/26/23 13:00	06/22/23 22:28	1
Calcium	87		0.50	0.13	mg/L		05/26/23 13:00	06/22/23 22:28	1
Chromium	ND		0.0020	0.0015	mg/L		05/26/23 13:00	06/22/23 22:28	1
Cobalt	0.0010		0.00050	0.00026	mg/L		05/26/23 13:00	06/23/23 18:43	1
Lead	ND		0.0010	0.00038	mg/L		05/26/23 13:00	06/22/23 22:28	1
Lithium	ND		0.0050	0.0013	mg/L		05/26/23 13:00	06/22/23 22:28	1
Molybdenum	0.0036	J	0.0050	0.00061	mg/L		05/26/23 13:00	06/22/23 22:28	1
Selenium	ND		0.0050	0.00074	mg/L		05/26/23 13:00	06/22/23 22:28	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.
 Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
 SDG: Sedimentation Pond

Client Sample ID: CCR-SP-3-051123

Lab Sample ID: 180-156542-4

Date Collected: 05/11/23 10:15

Matrix: Water

Date Received: 05/12/23 09:45

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Thallium	ND		0.0010	0.00047	mg/L		05/26/23 13:00	06/22/23 22:28	1

Method: SW846 EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		06/05/23 10:15	06/06/23 11:23	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids (SM 2540C)	410		10	10	mg/L			05/16/23 17:00	1

Method: SW846 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Uncert. (2σ+/-)						
Radium-226	0.178	U	0.164	0.165	1.00	0.251	pCi/L	05/19/23 13:41	06/14/23 10:31	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	95.3		30 - 110					05/19/23 13:41	06/14/23 10:31	1

Method: SW846 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Uncert. (2σ+/-)						
Radium-228	0.151	U	0.299	0.299	1.00	0.520	pCi/L	05/19/23 13:56	06/13/23 13:17	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	95.3		30 - 110					05/19/23 13:56	06/13/23 13:17	1
Y Carrier	82.9		30 - 110					05/19/23 13:56	06/13/23 13:17	1

Method: TAL-STL Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Uncert. (2σ+/-)						
Combined Radium 226 + 228	0.329	U	0.341	0.342	5.00	0.520	pCi/L		06/14/23 16:18	1

QC Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
SDG: Sedimentation Pond

Method: EPA 9056A - Anions, Ion Chromatography

Lab Sample ID: MB 180-435094/6
Matrix: Water
Analysis Batch: 435094

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	ND		1.0	0.71	mg/L			05/13/23 11:18	1
Fluoride	ND		0.10	0.026	mg/L			05/13/23 11:18	1
Sulfate	ND		1.0	0.76	mg/L			05/13/23 11:18	1

Lab Sample ID: LCS 180-435094/7
Matrix: Water
Analysis Batch: 435094

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Chloride	50.0	50.3		mg/L		101	80 - 120
Fluoride	2.50	2.35		mg/L		94	80 - 120
Sulfate	50.0	49.9		mg/L		100	80 - 120

Lab Sample ID: 180-156542-1 MS
Matrix: Water
Analysis Batch: 435094

Client Sample ID: CCR-SP-2-051123
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
Chloride	60		50.0	107		mg/L		93	80 - 120
Fluoride	0.16		2.50	2.47		mg/L		92	80 - 120
Sulfate	460		50.0	494	4	mg/L		62	80 - 120

Lab Sample ID: 180-156542-1 MSD
Matrix: Water
Analysis Batch: 435094

Client Sample ID: CCR-SP-2-051123
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
Chloride	60		50.0	107		mg/L		93	80 - 120	0	15
Fluoride	0.16		2.50	2.52		mg/L		94	80 - 120	2	15
Sulfate	460		50.0	494	4	mg/L		63	80 - 120	0	15

Method: EPA 6010D - Metals (ICP)

Lab Sample ID: MB 180-436357/1-A
Matrix: Water
Analysis Batch: 438036

Client Sample ID: Method Blank
Prep Type: Total Recoverable
Prep Batch: 436357

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Boron	ND		200	13	ug/L		05/26/23 13:00	06/14/23 14:01	1

Lab Sample ID: LCS 180-436357/2-A
Matrix: Water
Analysis Batch: 438036

Client Sample ID: Lab Control Sample
Prep Type: Total Recoverable
Prep Batch: 436357

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Boron	1250	1340		ug/L		107	80 - 120

Eurofins Pittsburgh

QC Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
SDG: Sedimentation Pond

Method: EPA 6020A - Metals (ICP/MS)

Lab Sample ID: MB 180-436345/1-A
Matrix: Water
Analysis Batch: 438772

Client Sample ID: Method Blank
Prep Type: Total Recoverable
Prep Batch: 436345

Analyte	MB	MB	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Antimony	ND		0.0020	0.00097	mg/L		05/26/23 13:00	06/22/23 21:56	1
Arsenic	ND		0.0010	0.00028	mg/L		05/26/23 13:00	06/22/23 21:56	1
Barium	ND		0.010	0.0031	mg/L		05/26/23 13:00	06/22/23 21:56	1
Beryllium	ND		0.0010	0.00027	mg/L		05/26/23 13:00	06/22/23 21:56	1
Cadmium	ND		0.0010	0.00022	mg/L		05/26/23 13:00	06/22/23 21:56	1
Calcium	ND		0.50	0.13	mg/L		05/26/23 13:00	06/22/23 21:56	1
Chromium	ND		0.0020	0.0015	mg/L		05/26/23 13:00	06/22/23 21:56	1
Lead	ND		0.0010	0.00038	mg/L		05/26/23 13:00	06/22/23 21:56	1
Lithium	ND		0.0050	0.0013	mg/L		05/26/23 13:00	06/22/23 21:56	1
Molybdenum	ND		0.0050	0.00061	mg/L		05/26/23 13:00	06/22/23 21:56	1
Selenium	ND		0.0050	0.00074	mg/L		05/26/23 13:00	06/22/23 21:56	1
Thallium	ND		0.0010	0.00047	mg/L		05/26/23 13:00	06/22/23 21:56	1

Lab Sample ID: MB 180-436345/1-A
Matrix: Water
Analysis Batch: 438909

Client Sample ID: Method Blank
Prep Type: Total Recoverable
Prep Batch: 436345

Analyte	MB	MB	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Cobalt	ND		0.00050	0.00026	mg/L		05/26/23 13:00	06/23/23 18:29	1

Lab Sample ID: LCS 180-436345/2-A
Matrix: Water
Analysis Batch: 438772

Client Sample ID: Lab Control Sample
Prep Type: Total Recoverable
Prep Batch: 436345

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Arsenic	1.00	0.810		mg/L		81	80 - 120
Barium	1.00	0.895		mg/L		89	80 - 120
Beryllium	0.500	0.485		mg/L		97	80 - 120
Cadmium	0.500	0.427		mg/L		85	80 - 120
Calcium	25.0	24.5		mg/L		98	80 - 120
Chromium	0.500	0.422		mg/L		84	80 - 120
Lead	0.500	0.438		mg/L		88	80 - 120
Lithium	0.500	0.502		mg/L		100	80 - 120
Molybdenum	0.500	0.445		mg/L		89	80 - 120
Selenium	1.00	0.981		mg/L		98	80 - 120
Thallium	1.00	0.859		mg/L		86	80 - 120

Lab Sample ID: LCS 180-436345/2-A
Matrix: Water
Analysis Batch: 438909

Client Sample ID: Lab Control Sample
Prep Type: Total Recoverable
Prep Batch: 436345

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits

QC Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
SDG: Sedimentation Pond

Method: EPA 7470A - Mercury (CVAA)

Lab Sample ID: MB 180-436973/1-A
Matrix: Water
Analysis Batch: 437135

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 436973

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		06/05/23 10:15	06/06/23 11:16	1

Lab Sample ID: LCS 180-436973/2-A
Matrix: Water
Analysis Batch: 437135

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 436973

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Mercury	0.00250	0.00259		mg/L		104	80 - 120

Lab Sample ID: MB 180-436976/1-A
Matrix: Water
Analysis Batch: 437135

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 436976

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		06/05/23 10:15	06/06/23 12:00	1

Lab Sample ID: LCS 180-436976/2-A
Matrix: Water
Analysis Batch: 437135

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 436976

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Mercury	0.00250	0.00250		mg/L		100	80 - 120

Method: SM 2540C - Solids, Total Dissolved (TDS)

Lab Sample ID: MB 180-435349/1
Matrix: Water
Analysis Batch: 435349

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids	ND		10	10	mg/L			05/16/23 17:00	1

Lab Sample ID: LCS 180-435349/2
Matrix: Water
Analysis Batch: 435349

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Total Dissolved Solids	580	570		mg/L		98	85 - 115

Method: 9315 - Radium-226 (GFPC)

Lab Sample ID: MB 160-612377/1-A
Matrix: Water
Analysis Batch: 616059

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 612377

Analyte	MB Result	MB Qualifier	Count Uncert. (2σ+/-)	Total Uncert. (2σ+/-)	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
Radium-226	0.09217	U	0.151	0.151	1.00	0.263	pCi/L	05/19/23 13:41	06/14/23 08:18	1

Eurofins Pittsburgh

QC Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
SDG: Sedimentation Pond

Method: 9315 - Radium-226 (GFPC) (Continued)

Lab Sample ID: MB 160-612377/1-A
Matrix: Water
Analysis Batch: 616059

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 612377

	<i>MB</i>	<i>MB</i>							
<i>Carrier</i>	<i>%Yield</i>	<i>Qualifier</i>	<i>Limits</i>		<i>Prepared</i>	<i>Analyzed</i>	<i>Dil Fac</i>		
Ba Carrier	96.0		30 - 110		05/19/23 13:41	06/14/23 08:18	1		

Lab Sample ID: LCS 160-612377/2-A
Matrix: Water
Analysis Batch: 616059

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 612377

<i>Analyte</i>	<i>Spike Added</i>	<i>LCS Result</i>	<i>LCS Qual</i>	<i>Total Uncert. (2σ+/-)</i>	<i>RL</i>	<i>MDC</i>	<i>Unit</i>	<i>%Rec</i>	<i>%Rec Limits</i>	
Radium-226	11.3	10.18		1.25	1.00	0.275	pCi/L	90	75 - 125	

	<i>LCS</i>	<i>LCS</i>							
<i>Carrier</i>	<i>%Yield</i>	<i>Qualifier</i>	<i>Limits</i>						
Ba Carrier	93.8		30 - 110						

Lab Sample ID: LCSD 160-612377/3-A
Matrix: Water
Analysis Batch: 616059

Client Sample ID: Lab Control Sample Dup
Prep Type: Total/NA
Prep Batch: 612377

<i>Analyte</i>	<i>Spike Added</i>	<i>LCSD Result</i>	<i>LCSD Qual</i>	<i>Total Uncert. (2σ+/-)</i>	<i>RL</i>	<i>MDC</i>	<i>Unit</i>	<i>%Rec</i>	<i>%Rec Limits</i>	<i>RER</i>	<i>RER Limit</i>
Radium-226	11.3	10.89		1.28	1.00	0.246	pCi/L	96	75 - 125	0.28	1

	<i>LCSD</i>	<i>LCSD</i>							
<i>Carrier</i>	<i>%Yield</i>	<i>Qualifier</i>	<i>Limits</i>						
Ba Carrier	97.0		30 - 110						

Method: 9320 - Radium-228 (GFPC)

Lab Sample ID: MB 160-612446/1-A
Matrix: Water
Analysis Batch: 615817

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 612446

<i>Analyte</i>	<i>MB Result</i>	<i>MB Qualifier</i>	<i>Count Uncert. (2σ+/-)</i>	<i>Total Uncert. (2σ+/-)</i>	<i>RL</i>	<i>MDC</i>	<i>Unit</i>	<i>Prepared</i>	<i>Analyzed</i>	<i>Dil Fac</i>
Radium-228	0.3112	U	0.307	0.309	1.00	0.494	pCi/L	05/19/23 13:56	06/13/23 12:52	1

	<i>MB</i>	<i>MB</i>							
<i>Carrier</i>	<i>%Yield</i>	<i>Qualifier</i>	<i>Limits</i>		<i>Prepared</i>	<i>Analyzed</i>	<i>Dil Fac</i>		
Ba Carrier	96.0		30 - 110		05/19/23 13:56	06/13/23 12:52	1		
Y Carrier	83.4		30 - 110		05/19/23 13:56	06/13/23 12:52	1		

Lab Sample ID: LCS 160-612446/2-A
Matrix: Water
Analysis Batch: 615817

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 612446

<i>Analyte</i>	<i>Spike Added</i>	<i>LCS Result</i>	<i>LCS Qual</i>	<i>Total Uncert. (2σ+/-)</i>	<i>RL</i>	<i>MDC</i>	<i>Unit</i>	<i>%Rec</i>	<i>%Rec Limits</i>	
Radium-228	8.12	7.337		1.06	1.00	0.448	pCi/L	90	75 - 125	

Eurofins Pittsburgh

QC Sample Results

Client: Haley & Aldrich, Inc.
 Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
 SDG: Sedimentation Pond

Method: 9320 - Radium-228 (GFPC) (Continued)

Lab Sample ID: LCS 160-612446/2-A
Matrix: Water
Analysis Batch: 615817

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 612446

Carrier	LCS		Limits
	%Yield	Qualifier	
Ba Carrier	93.8		30 - 110
Y Carrier	85.4		30 - 110

Lab Sample ID: LCSD 160-612446/3-A
Matrix: Water
Analysis Batch: 615817

Client Sample ID: Lab Control Sample Dup
Prep Type: Total/NA
Prep Batch: 612446

Analyte	Spike Added	LCSD Result	LCSD Qual	Total Uncert. (2σ+/-)	RL	MDC	Unit	%Rec	%Rec		RER
									Limits	RER	Limit
Radium-228	8.12	7.685		1.09	1.00	0.442	pCi/L	95	75 - 125	0.16	1

Carrier	LCSD		Limits
	%Yield	Qualifier	
Ba Carrier	97.0		30 - 110
Y Carrier	83.4		30 - 110

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13

QC Association Summary

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
SDG: Sedimentation Pond

HPLC/IC

Analysis Batch: 435094

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-156542-1	CCR-SP-2-051123	Total/NA	Water	EPA 9056A	
180-156542-2	DUP2-051123	Total/NA	Water	EPA 9056A	
180-156542-3	CCR-SP-1-051123	Total/NA	Water	EPA 9056A	
180-156542-4	CCR-SP-3-051123	Total/NA	Water	EPA 9056A	
MB 180-435094/6	Method Blank	Total/NA	Water	EPA 9056A	
LCS 180-435094/7	Lab Control Sample	Total/NA	Water	EPA 9056A	
180-156542-1 MS	CCR-SP-2-051123	Total/NA	Water	EPA 9056A	
180-156542-1 MSD	CCR-SP-2-051123	Total/NA	Water	EPA 9056A	

Metals

Prep Batch: 436345

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-156542-1	CCR-SP-2-051123	Total Recoverable	Water	3005A	
180-156542-2	DUP2-051123	Total Recoverable	Water	3005A	
180-156542-3	CCR-SP-1-051123	Total Recoverable	Water	3005A	
180-156542-4	CCR-SP-3-051123	Total Recoverable	Water	3005A	
MB 180-436345/1-A	Method Blank	Total Recoverable	Water	3005A	
LCS 180-436345/2-A	Lab Control Sample	Total Recoverable	Water	3005A	

Prep Batch: 436357

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-156542-1	CCR-SP-2-051123	Total Recoverable	Water	3005A	
180-156542-2	DUP2-051123	Total Recoverable	Water	3005A	
180-156542-3	CCR-SP-1-051123	Total Recoverable	Water	3005A	
180-156542-4	CCR-SP-3-051123	Total Recoverable	Water	3005A	
MB 180-436357/1-A	Method Blank	Total Recoverable	Water	3005A	
LCS 180-436357/2-A	Lab Control Sample	Total Recoverable	Water	3005A	

Prep Batch: 436973

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-156542-4	CCR-SP-3-051123	Total/NA	Water	7470A	
MB 180-436973/1-A	Method Blank	Total/NA	Water	7470A	
LCS 180-436973/2-A	Lab Control Sample	Total/NA	Water	7470A	

Prep Batch: 436976

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-156542-1	CCR-SP-2-051123	Total/NA	Water	7470A	
180-156542-2	DUP2-051123	Total/NA	Water	7470A	
180-156542-3	CCR-SP-1-051123	Total/NA	Water	7470A	
MB 180-436976/1-A	Method Blank	Total/NA	Water	7470A	
LCS 180-436976/2-A	Lab Control Sample	Total/NA	Water	7470A	

Analysis Batch: 437135

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-156542-1	CCR-SP-2-051123	Total/NA	Water	EPA 7470A	436976
180-156542-2	DUP2-051123	Total/NA	Water	EPA 7470A	436976
180-156542-3	CCR-SP-1-051123	Total/NA	Water	EPA 7470A	436976
180-156542-4	CCR-SP-3-051123	Total/NA	Water	EPA 7470A	436973
MB 180-436973/1-A	Method Blank	Total/NA	Water	EPA 7470A	436973
MB 180-436976/1-A	Method Blank	Total/NA	Water	EPA 7470A	436976

Eurofins Pittsburgh

QC Association Summary

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
SDG: Sedimentation Pond

Metals (Continued)

Analysis Batch: 437135 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
LCS 180-436973/2-A	Lab Control Sample	Total/NA	Water	EPA 7470A	436973
LCS 180-436976/2-A	Lab Control Sample	Total/NA	Water	EPA 7470A	436976

Analysis Batch: 438036

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-156542-1	CCR-SP-2-051123	Total Recoverable	Water	EPA 6010D	436357
180-156542-2	DUP2-051123	Total Recoverable	Water	EPA 6010D	436357
180-156542-3	CCR-SP-1-051123	Total Recoverable	Water	EPA 6010D	436357
180-156542-4	CCR-SP-3-051123	Total Recoverable	Water	EPA 6010D	436357
MB 180-436357/1-A	Method Blank	Total Recoverable	Water	EPA 6010D	436357
LCS 180-436357/2-A	Lab Control Sample	Total Recoverable	Water	EPA 6010D	436357

Analysis Batch: 438772

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-156542-1	CCR-SP-2-051123	Total Recoverable	Water	EPA 6020A	436345
180-156542-2	DUP2-051123	Total Recoverable	Water	EPA 6020A	436345
180-156542-3	CCR-SP-1-051123	Total Recoverable	Water	EPA 6020A	436345
180-156542-4	CCR-SP-3-051123	Total Recoverable	Water	EPA 6020A	436345
MB 180-436345/1-A	Method Blank	Total Recoverable	Water	EPA 6020A	436345
LCS 180-436345/2-A	Lab Control Sample	Total Recoverable	Water	EPA 6020A	436345

Analysis Batch: 438909

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-156542-1	CCR-SP-2-051123	Total Recoverable	Water	EPA 6020A	436345
180-156542-2	DUP2-051123	Total Recoverable	Water	EPA 6020A	436345
180-156542-3	CCR-SP-1-051123	Total Recoverable	Water	EPA 6020A	436345
180-156542-4	CCR-SP-3-051123	Total Recoverable	Water	EPA 6020A	436345
MB 180-436345/1-A	Method Blank	Total Recoverable	Water	EPA 6020A	436345
LCS 180-436345/2-A	Lab Control Sample	Total Recoverable	Water	EPA 6020A	436345

General Chemistry

Analysis Batch: 435349

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-156542-1	CCR-SP-2-051123	Total/NA	Water	SM 2540C	
180-156542-2	DUP2-051123	Total/NA	Water	SM 2540C	
180-156542-3	CCR-SP-1-051123	Total/NA	Water	SM 2540C	
180-156542-4	CCR-SP-3-051123	Total/NA	Water	SM 2540C	
MB 180-435349/1	Method Blank	Total/NA	Water	SM 2540C	
LCS 180-435349/2	Lab Control Sample	Total/NA	Water	SM 2540C	

Rad

Prep Batch: 612377

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-156542-1	CCR-SP-2-051123	Total/NA	Water	PrecSep-21	
180-156542-2	DUP2-051123	Total/NA	Water	PrecSep-21	
180-156542-3	CCR-SP-1-051123	Total/NA	Water	PrecSep-21	
180-156542-4	CCR-SP-3-051123	Total/NA	Water	PrecSep-21	
MB 160-612377/1-A	Method Blank	Total/NA	Water	PrecSep-21	
LCS 160-612377/2-A	Lab Control Sample	Total/NA	Water	PrecSep-21	
LCSD 160-612377/3-A	Lab Control Sample Dup	Total/NA	Water	PrecSep-21	

Eurofins Pittsburgh

QC Association Summary

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-156542-1
SDG: Sedimentation Pond

Rad

Prep Batch: 612446

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-156542-1	CCR-SP-2-051123	Total/NA	Water	PrecSep_0	
180-156542-2	DUP2-051123	Total/NA	Water	PrecSep_0	
180-156542-3	CCR-SP-1-051123	Total/NA	Water	PrecSep_0	
180-156542-4	CCR-SP-3-051123	Total/NA	Water	PrecSep_0	
MB 160-612446/1-A	Method Blank	Total/NA	Water	PrecSep_0	
LCS 160-612446/2-A	Lab Control Sample	Total/NA	Water	PrecSep_0	
LCSD 160-612446/3-A	Lab Control Sample Dup	Total/NA	Water	PrecSep_0	

Client Information
 Client Contact: Britton Hundley
 Company: Haley & Aldrich, Inc
 Address: 400 Augusta Street Suite 100
 City: Greenville
 State/Zip: SC, 29601
 Phone: 864-214-8750(Ext)
 Email: BHundley@haleyaldrich.com
 Project Name: AB Brown Generating Station
 Site: Sedimentation Pond

Sampler: Haley & Aldrich
 Lab PM: Hayes, Ken
 E-Mail: Ken.Hayes@eurofins.com
 Carrier Tracking No(s): 180-91208-15023 1
 State of Origin: TN
 Page: 1 of 4
 Job #: 0129420-037-001-01

Due Date Requested: STANDARD
 TAT Requested (days): STANDARD
 Compliance Project: Yes No
 PO #: 0129420-037-001-01
 WC #: 0129420-037-001-01
 Project #: 18016014
 SSO#:

Sample Identification	Sample Date	Sample Time	Sample Type (G=comp, G=grab, Br-Tissue, Ash)	Matrix (Water, Seawater, Overwater)	Field Filtered Sample (Yes or No)		Perform MS/MSD (Yes or No)		Total Number of containers	Special Instructions/Note:
					Yes	No	Yes	No		
CCR-SP-2-051123	5/11/23	1005	WG	Water	N	X	N	X	6	
DUP2-051123		1005	WG	Water	N	X	N	X	6	
CCR-SP-1-051123		1220	WG	Water	N	X	N	X	6	
CCR-SP-3-051123		1015		Water	N	X	N	X	6	

Possible Hazard Identification
 Non-Hazard Flammable Skin Irritant Poison B Unknown Radiological

Deliverable Requested: I, II, III, IV, Other (specify)

Empty Kit Relinquished by

Relinquished by: Francis Runk
 Date/Time: 5/11/23 1700
 Company: H&A

Relinquished by
 Date/Time
 Company

Custody Seals Intact: Yes No
 Custody Seal No

Received by: [Signature]
 Date/Time: 5-12-23 0945
 Company: Eurofins

Received by
 Date/Time
 Company

Cooler Temperature(s) °C and Other Remarks

Analysis Requested: 9040C, 9056A_ORGFM_28D
 6020A, 7470A
 2540C_Calcd - Local Method
 9315_Ra226 - Standard Target List
 9320_Ra228 - Standard Target List
 Ra226Ra228_GFPC - Local Method
 6010D - (MOD) Boron

Special Instructions/Note:
 180-156542 Chain of Custody

Barcode:

180-156542 Chain of Custody

Sample Disposal (A fee may be assessed if samples are retained longer than 1 month)
 Return To Client Disposal By Lab Archive For _____ Months

Special Instructions/QC Requirements

Method of Shipment:

Received by: [Signature]
 Date/Time: 5-12-23 0945
 Company: Eurofins

Received by
 Date/Time
 Company

Cooler Temperature(s) °C and Other Remarks

Login Sample Receipt Checklist

Client: Haley & Aldrich, Inc.

Job Number: 180-156542-2
SDG Number: Sedimentation Pond

Login Number: 156542

List Number: 1

Creator: Kovitch, Christina M

List Source: Eurofins Pittsburgh

Question	Answer	Comment
Radioactivity wasn't checked or is < /= background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is <6mm (1/4").	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	





ANALYTICAL REPORT

PREPARED FOR

Attn: Todd Plating
Haley & Aldrich, Inc.
400 Augusta Street
Suite 100
Greenville, South Carolina 29601

Generated 12/21/2023 8:27:29 AM

JOB DESCRIPTION

AB Brown Generating Station
Sedimentation Pond

JOB NUMBER

180-165231-1

Eurofins Pittsburgh

Job Notes

This report may not be reproduced except in full, and with written approval from the laboratory. The results relate only to the samples tested. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

PA Lab ID: 02-00416

The test results in this report relate only to the samples as received by the laboratory and will meet all requirements of the methodology, with any exceptions noted. This report shall not be reproduced except in full, without the express written approval of the laboratory. All questions should be directed to the Eurofins Pittsburgh Project Manager.

Authorization



Generated
12/21/2023 8:27:29 AM

Authorized for release by
Andy Johnson, Senior Project Manager
Andy.Johnson@et.eurofinsus.com
(615)818-9567



Table of Contents

Cover Page	1
Table of Contents	3
Case Narrative	4
Definitions/Glossary	6
Certification Summary	7
Sample Summary	9
Method Summary	10
Lab Chronicle	11
Client Sample Results	15
QC Sample Results	25
QC Association Summary	32
Chain of Custody	35
Receipt Checklists	38

Case Narrative

Client: Haley & Aldrich, Inc.
Project: AB Brown Generating Station

Job ID: 180-165231-1

Job ID: 180-165231-1

Eurofins Pittsburgh

Job Narrative 180-165231-1

Analytical test results meet all requirements of the associated regulatory program listed on the Accreditation/Certification Summary Page unless otherwise noted under the individual analysis. Data qualifiers are applied to indicate exceptions. Noncompliant quality control (QC) is further explained in narrative comments.

- Matrix QC may not be reported if insufficient sample or site-specific QC samples were not submitted. In these situations, to demonstrate precision and accuracy at a batch level, a LCS/LCSD may be performed, unless otherwise specified in the method.
- Surrogate and/or isotope dilution analyte recoveries (if applicable) which are outside of the QC window are confirmed unless attributed to a dilution or otherwise noted in the narrative.

Regulated compliance samples (e.g. SDWA, NPDES) must comply with the associated agency requirements/permits.

Receipt

The samples were received on 11/11/2023 8:29 AM. Unless otherwise noted below, the samples arrived in good condition, and, where required, properly preserved and on ice. The temperature of the cooler at receipt time was 3.5°C

HPLC/IC

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

Metals

Method 6010D: The post digestion spike % recovery for boron associated with batch 180-452389 was outside the control limits. The associated sample is: CCR-SP-3-110923 (180-165231-1).

Method 6020A: The linear range check (LRC) failed for several analytes for samples CCR-SP-3-110923 (180-165231-1), DUP-2-110923 (180-165231-3), FB-2-111023 (180-165231-4) and CCR-SP-1-111023 (180-165231-5) and results were substantiated by a secondary verification; the Calibration Standard, the LCS, or CCV. Results are reported, as is, with this narrative.

Method 6020A: The following samples were diluted to bring the concentration of target analytes within the calibration range: CCR-SP-3-110923 (180-165231-1[MS]), CCR-SP-3-110923 (180-165231-1[MSD]), (LCS 180-452039/2-A), (180-165231-E-1-D PDS ^5) and (180-165231-E-1-D SD ^5). Elevated reporting limits (RLs) are provided.

Method 6020A: The following samples were diluted to bring the concentration of target analytes within the calibration range: CCR-SP-3-110923 (180-165231-1[MS]), CCR-SP-3-110923 (180-165231-1[MSD]) and (LCS 180-452039/2-A ^5). Elevated reporting limits (RLs) are provided.

Method 6020A: The linear range check (LRC) failed for boron for samples CCR-SP-3-110923 (180-165231-1), CCR-SP-2-110923 (180-165231-2), DUP-2-110923 (180-165231-3), FB-2-111023 (180-165231-4) and CCR-SP-1-111023 (180-165231-5) and results were substantiated by a secondary verification; the Calibration Standard, the LCS, or CCV. Results are reported, as is, with this narrative.

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

General Chemistry

Method 2540C_Calcd: The sample did not reach a stable weight following 3 cycles of heating, cooling, and desiccation. The cycle 3 weight was used to calculate the Total Dissolved Solids (TDS) for the sample result. CCR-SP-2-110923 (180-165231-2), DUP-2-110923 (180-165231-3), FB-2-111023 (180-165231-4) and CCR-SP-1-111023 (180-165231-5)

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

Gas Flow Proportional Counter

Method 9320_Ra228: Radium-228 batch 637222

The detection goal was not met for the following sample(s). Sample was prepped at a reduced volume due to the presence of matrix interferences: DUP-2-110923 (180-165231-3). Analytical results are reported with the detection limit achieved.

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

Eurofins Pittsburgh

Case Narrative

Client: Haley & Aldrich, Inc.
Project: AB Brown Generating Station

Job ID: 180-165231-1

Job ID: 180-165231-1 (Continued)

Eurofins Pittsburgh

Rad

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13

Definitions/Glossary

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
SDG: Sedimentation Pond

Qualifiers

HPLC/IC

Qualifier	Qualifier Description
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

Metals

Qualifier	Qualifier Description
^5-	Linear Range Check (LRC) is outside acceptance limits, low biased.
^5+	Linear Range Check (LRC) is outside acceptance limits, high biased.
F1	MS and/or MSD recovery exceeds control limits.
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

General Chemistry

Qualifier	Qualifier Description
HF	Parameter with a holding time of 15 minutes. Test performed by laboratory at client's request. Sample was analyzed outside of hold time.

Rad

Qualifier	Qualifier Description
G	The Sample MDC is greater than the requested RL.
U	Result is less than the sample detection limit.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
¤	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CFU	Colony Forming Unit
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MCL	EPA recommended "Maximum Contaminant Level"
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
MPN	Most Probable Number
MQL	Method Quantitation Limit
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
NEG	Negative / Absent
POS	Positive / Present
PQL	Practical Quantitation Limit
PRES	Presumptive
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)
TNTC	Too Numerous To Count

Accreditation/Certification Summary

Client: Haley & Aldrich, Inc.
 Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
 SDG: Sedimentation Pond

Laboratory: Eurofins Pittsburgh

All accreditations/certifications held by this laboratory are listed. Not all accreditations/certifications are applicable to this report.

Authority	Program	Identification Number	Expiration Date
Arkansas DEQ	State	19-033-0	06-27-24
California	State	2891	04-30-24
Connecticut	State	PH-0688	12-12-23
Florida	NELAP	E871008	12-12-23
Georgia	State	PA 02-00416	12-12-23
Illinois	NELAP	004375	12-12-23
Kansas	NELAP	E-10350	12-12-23
Kentucky (UST)	State	162013	04-30-23 *
Kentucky (WW)	State	KY98043	12-31-23
Louisiana	NELAP	04041	06-30-22 *
Louisiana (All)	NELAP	04041	12-12-23
Maine	State	PA00164	03-06-24
Minnesota	NELAP	042-999-482	12-12-23
New Hampshire	NELAP	2030	12-12-23
New Jersey	NELAP	PA005	12-12-23
New York	NELAP	11182	12-12-23
North Carolina (WW/SW)	State	434	12-31-23
North Dakota	State	R-227	04-30-24
Oregon	NELAP	PA-2151	02-06-24
Pennsylvania	NELAP	02-00416	12-12-23
Rhode Island	State	LAO00362	12-31-22 *
South Carolina	State	89014	04-30-23 *
Texas	NELAP	T104704528	12-12-23
US Fish & Wildlife	US Federal Programs	058448	03-31-24
USDA	US Federal Programs	P330-16-00211	04-11-26
Utah	NELAP	PA001462019-8	05-31-24
Virginia	NELAP	10043	12-12-23
West Virginia DEP	State	142	01-31-24
Wisconsin	State	998027800	08-31-24

Laboratory: Eurofins St. Louis

All accreditations/certifications held by this laboratory are listed. Not all accreditations/certifications are applicable to this report.

Authority	Program	Identification Number	Expiration Date
Alaska (UST)	State	20-001	05-06-25
ANAB	Dept. of Defense ELAP	L2305	04-06-25
ANAB	Dept. of Energy	L2305.01	04-06-25
ANAB	ISO/IEC 17025	L2305	04-06-25
Arizona	State	AZ0813	12-08-24
California	Los Angeles County Sanitation Districts	10259	06-30-22 *
California	State	2886	06-30-24
Connecticut	State	PH-0241	03-31-25
Florida	NELAP	E87689	06-30-24
HI - RadChem Recognition	State	n/a	06-30-24
Illinois	NELAP	200023	11-30-24
Iowa	State	373	12-01-24
Kansas	NELAP	E-10236	10-31-24
Kentucky (DW)	State	KY90125	12-31-23
Kentucky (WW)	State	KY90125 (Permit KY0004049)	12-31-23

* Accreditation/Certification renewal pending - accreditation/certification considered valid.

Eurofins Pittsburgh

Accreditation/Certification Summary

Client: Haley & Aldrich, Inc.
 Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
 SDG: Sedimentation Pond

Laboratory: Eurofins St. Louis (Continued)

All accreditations/certifications held by this laboratory are listed. Not all accreditations/certifications are applicable to this report.

Authority	Program	Identification Number	Expiration Date
Louisiana	NELAP	04080	06-30-22 *
Louisiana (All)	NELAP	04080	06-30-24
Louisiana (DW)	State	LA011	12-31-23
Maryland	State	310	09-30-24
Massachusetts	State	M-MO054	06-30-24
MI - RadChem Recognition	State	9005	06-30-24
Missouri	State	780	06-30-25
Nevada	State	MO000542020-1	07-31-24
New Jersey	NELAP	MO002	06-30-24
New Mexico	State	MO00054	06-30-24
New York	NELAP	11616	03-31-24
North Carolina (DW)	State	29700	07-31-24
North Dakota	State	R-207	06-30-24
Oklahoma	NELAP	9997	08-31-24
Oregon	NELAP	4157	09-01-24
Pennsylvania	NELAP	68-00540	02-28-24
South Carolina	State	85002001	06-30-24
Texas	NELAP	T104704193	07-31-24
US Fish & Wildlife	US Federal Programs	058448	07-31-24
USDA	US Federal Programs	P330-17-00028	05-18-26
Utah	NELAP	MO000542021-14	07-31-24
Virginia	NELAP	10310	06-15-25
Washington	State	C592	08-30-24
West Virginia DEP	State	381	12-31-23

* Accreditation/Certification renewal pending - accreditation/certification considered valid.



Sample Summary

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
SDG: Sedimentation Pond

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
180-165231-1	CCR-SP-3-110923	Water	11/09/23 12:25	11/11/23 08:29
180-165231-2	CCR-SP-2-110923	Water	11/09/23 15:05	11/11/23 08:29
180-165231-3	DUP-2-110923	Water	11/09/23 00:00	11/11/23 08:29
180-165231-4	FB-2-111023	Water	11/10/23 08:30	11/11/23 08:29
180-165231-5	CCR-SP-1-111023	Water	11/10/23 08:40	11/11/23 08:29

1

2

3

4

5

6

7

8

9

10

11

12

13

Method Summary

Client: Haley & Aldrich, Inc.
 Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
 SDG: Sedimentation Pond

Method	Method Description	Protocol	Laboratory
EPA 9056A	Anions, Ion Chromatography	SW846	EET PIT
EPA 6010D	Metals (ICP)	SW846	EET PIT
EPA 6020A	Metals (ICP/MS)	SW846	EET PIT
EPA 7470A	Mercury (CVAA)	SW846	EET PIT
EPA 9040C	pH	SW846	EET PIT
SM 2540C	Solids, Total Dissolved (TDS)	SM	EET PIT
9315	Radium-226 (GFPC)	SW846	EET SL
9320	Radium-228 (GFPC)	SW846	EET SL
Ra226_Ra228	Combined Radium-226 and Radium-228	TAL-STL	EET SL
3005A	Preparation, Total Recoverable or Dissolved Metals	SW846	EET PIT
7470A	Preparation, Mercury	SW846	EET PIT
PrecSep_0	Preparation, Precipitate Separation	None	EET SL
PrecSep-21	Preparation, Precipitate Separation (21-Day In-Growth)	None	EET SL

Protocol References:

- None = None
- SM = "Standard Methods For The Examination Of Water And Wastewater"
- SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.
- TAL-STL = TestAmerica Laboratories, St. Louis, Facility Standard Operating Procedure.

Laboratory References:

- EET PIT = Eurofins Pittsburgh, 301 Alpha Drive, RIDC Park, Pittsburgh, PA 15238, TEL (412)963-7058
- EET SL = Eurofins St. Louis, 13715 Rider Trail North, Earth City, MO 63045, TEL (314)298-8566



Lab Chronicle

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
SDG: Sedimentation Pond

Client Sample ID: CCR-SP-3-110923

Lab Sample ID: 180-165231-1

Date Collected: 11/09/23 12:25

Matrix: Water

Date Received: 11/11/23 08:29

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A		1	1 mL	1 mL	452001	11/15/23 19:24	M1D	EET PIT
Instrument ID: INTEGRION										
Total Recoverable	Prep	3005A			50 mL	50 mL	452038	11/16/23 08:37	SJM	EET PIT
Total Recoverable	Analysis	EPA 6010D		1			452389	11/17/23 19:32	RJR	EET PIT
Instrument ID: C										
Total Recoverable	Prep	3005A			50 mL	50 mL	452039	11/16/23 08:37	SJM	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			452395	11/17/23 17:36	S1Z	EET PIT
Instrument ID: NEMO										
Total Recoverable	Prep	3005A			50 mL	50 mL	452039	11/16/23 08:37	SJM	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			452607	11/21/23 14:45	S1Z	EET PIT
Instrument ID: NEMO										
Total/NA	Prep	7470A			25 mL	25 mL	452480	11/21/23 10:15	RJR	EET PIT
Total/NA	Analysis	EPA 7470A		1			452922	11/28/23 09:14	MTW	EET PIT
Instrument ID: HGZ										
Total/NA	Analysis	EPA 9040C		1			452193	11/16/23 14:00	BAB	EET PIT
Instrument ID: OZ										
Total/NA	Analysis	SM 2540C		1	100 mL	100 mL	452200	11/16/23 18:14	LWM	EET PIT
Instrument ID: NOEQUIP										
Total/NA	Prep	PrecSep-21			990.54 mL	1.0 g	637221	11/16/23 10:32	KAC	EET SL
Total/NA	Analysis	9315		1			641229	12/18/23 14:12	EMH	EET SL
Instrument ID: GFPCPURPLE										
Total/NA	Prep	PrecSep_0			990.54 mL	1.0 g	637222	11/16/23 10:39	KAC	EET SL
Total/NA	Analysis	9320		1			640878	12/15/23 16:25	FLC	EET SL
Instrument ID: GFPCRED										
Total/NA	Analysis	Ra226_Ra228		1			641297	12/18/23 23:24	EMH	EET SL
Instrument ID: NOEQUIP										

Client Sample ID: CCR-SP-2-110923

Lab Sample ID: 180-165231-2

Date Collected: 11/09/23 15:05

Matrix: Water

Date Received: 11/11/23 08:29

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A		1	1 mL	1 mL	452001	11/16/23 08:38	M1D	EET PIT
Instrument ID: INTEGRION										
Total Recoverable	Prep	3005A			50 mL	50 mL	452038	11/16/23 08:37	SJM	EET PIT
Total Recoverable	Analysis	EPA 6010D		1			452389	11/17/23 19:57	RJR	EET PIT
Instrument ID: C										
Total Recoverable	Prep	3005A			50 mL	50 mL	452039	11/16/23 08:37	SJM	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			452395	11/17/23 17:51	S1Z	EET PIT
Instrument ID: NEMO										
Total Recoverable	Prep	3005A			50 mL	50 mL	452039	11/16/23 08:37	SJM	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			452607	11/21/23 14:57	S1Z	EET PIT
Instrument ID: NEMO										

Lab Chronicle

Client: Haley & Aldrich, Inc.
 Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
 SDG: Sedimentation Pond

Client Sample ID: CCR-SP-2-110923

Lab Sample ID: 180-165231-2

Date Collected: 11/09/23 15:05

Matrix: Water

Date Received: 11/11/23 08:29

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	7470A			25 mL	25 mL	452480	11/21/23 10:15	RJR	EET PIT
Total/NA	Analysis	EPA 7470A		1			452922	11/28/23 09:17	MTW	EET PIT
Instrument ID: HGZ										
Total/NA	Analysis	EPA 9040C		1			452193	11/16/23 14:24	BAB	EET PIT
Instrument ID: OZ										
Total/NA	Analysis	SM 2540C		1	100 mL	100 mL	452200	11/16/23 18:14	LWM	EET PIT
Instrument ID: NOEQUIP										
Total/NA	Prep	PrecSep-21			746.90 mL	1.0 g	637221	11/16/23 10:32	KAC	EET SL
Total/NA	Analysis	9315		1			641229	12/18/23 14:12	EMH	EET SL
Instrument ID: GFPCPURPLE										
Total/NA	Prep	PrecSep_0			746.90 mL	1.0 g	637222	11/16/23 10:39	KAC	EET SL
Total/NA	Analysis	9320		1			640878	12/15/23 16:28	FLC	EET SL
Instrument ID: GFPCRED										
Total/NA	Analysis	Ra226_Ra228		1			641297	12/18/23 23:24	EMH	EET SL
Instrument ID: NOEQUIP										

Client Sample ID: DUP-2-110923

Lab Sample ID: 180-165231-3

Date Collected: 11/09/23 00:00

Matrix: Water

Date Received: 11/11/23 08:29

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A		1	1 mL	1 mL	452140	11/16/23 17:24	M1D	EET PIT
Instrument ID: INTEGRION										
Total Recoverable	Prep	3005A			50 mL	50 mL	452038	11/16/23 08:37	SJM	EET PIT
Total Recoverable	Analysis	EPA 6010D		1			452389	11/17/23 20:02	RJR	EET PIT
Instrument ID: C										
Total Recoverable	Prep	3005A			50 mL	50 mL	452039	11/16/23 08:37	SJM	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			452395	11/17/23 18:10	S1Z	EET PIT
Instrument ID: NEMO										
Total Recoverable	Prep	3005A			50 mL	50 mL	452039	11/16/23 08:37	SJM	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			452607	11/21/23 15:00	S1Z	EET PIT
Instrument ID: NEMO										
Total/NA	Prep	7470A			25 mL	25 mL	452480	11/21/23 10:15	RJR	EET PIT
Total/NA	Analysis	EPA 7470A		1			452922	11/28/23 09:18	MTW	EET PIT
Instrument ID: HGZ										
Total/NA	Analysis	EPA 9040C		1			452193	11/16/23 14:09	BAB	EET PIT
Instrument ID: OZ										
Total/NA	Analysis	SM 2540C		1	100 mL	100 mL	452200	11/16/23 18:14	LWM	EET PIT
Instrument ID: NOEQUIP										
Total/NA	Prep	PrecSep-21			492.09 mL	1.0 g	637221	11/16/23 10:32	KAC	EET SL
Total/NA	Analysis	9315		1			641229	12/18/23 14:12	EMH	EET SL
Instrument ID: GFPCPURPLE										
Total/NA	Prep	PrecSep_0			492.09 mL	1.0 g	637222	11/16/23 10:39	KAC	EET SL
Total/NA	Analysis	9320		1			640878	12/15/23 16:28	FLC	EET SL
Instrument ID: GFPCRED										

Eurofins Pittsburgh

Lab Chronicle

Client: Haley & Aldrich, Inc.
 Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
 SDG: Sedimentation Pond

Client Sample ID: DUP-2-110923
Date Collected: 11/09/23 00:00
Date Received: 11/11/23 08:29

Lab Sample ID: 180-165231-3
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	Ra226_Ra228		1			641297	12/18/23 23:24	EMH	EET SL

Client Sample ID: FB-2-111023
Date Collected: 11/10/23 08:30
Date Received: 11/11/23 08:29

Lab Sample ID: 180-165231-4
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A Instrument ID: INTEGRION		1	1 mL	1 mL	452140	11/16/23 17:05	M1D	EET PIT
Total Recoverable	Prep	3005A			50 mL	50 mL	452038	11/16/23 08:37	SJM	EET PIT
Total Recoverable	Analysis	EPA 6010D Instrument ID: C		1			452389	11/17/23 20:08	RJR	EET PIT
Total Recoverable	Prep	3005A			50 mL	50 mL	452039	11/16/23 08:37	SJM	EET PIT
Total Recoverable	Analysis	EPA 6020A Instrument ID: NEMO		1			452395	11/17/23 18:12	S1Z	EET PIT
Total Recoverable	Prep	3005A			50 mL	50 mL	452039	11/16/23 08:37	SJM	EET PIT
Total Recoverable	Analysis	EPA 6020A Instrument ID: NEMO		1			452607	11/21/23 15:03	S1Z	EET PIT
Total/NA	Prep	7470A			25 mL	25 mL	452480	11/21/23 10:15	RJR	EET PIT
Total/NA	Analysis	EPA 7470A Instrument ID: HGZ		1			452922	11/28/23 09:19	MTW	EET PIT
Total/NA	Analysis	EPA 9040C Instrument ID: OZ		1			452345	11/17/23 13:46	BAB	EET PIT
Total/NA	Analysis	SM 2540C Instrument ID: NOEQUIP		1	100 mL	100 mL	452200	11/16/23 18:14	LWM	EET PIT
Total/NA	Prep	PrecSep-21			993.94 mL	1.0 g	637221	11/16/23 10:32	KAC	EET SL
Total/NA	Analysis	9315 Instrument ID: GFPCPURPLE		1			641229	12/18/23 14:12	EMH	EET SL
Total/NA	Prep	PrecSep_0			993.94 mL	1.0 g	637222	11/16/23 10:39	KAC	EET SL
Total/NA	Analysis	9320 Instrument ID: GFPCRED		1			640878	12/15/23 16:28	FLC	EET SL
Total/NA	Analysis	Ra226_Ra228 Instrument ID: NOEQUIP		1			641297	12/18/23 23:24	EMH	EET SL

Client Sample ID: CCR-SP-1-111023
Date Collected: 11/10/23 08:40
Date Received: 11/11/23 08:29

Lab Sample ID: 180-165231-5
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A Instrument ID: INTEGRION		1	1 mL	1 mL	452001	11/16/23 00:19	M1D	EET PIT
Total Recoverable	Prep	3005A			50 mL	50 mL	452038	11/16/23 08:37	SJM	EET PIT
Total Recoverable	Analysis	EPA 6010D Instrument ID: C		1			452389	11/17/23 20:13	RJR	EET PIT

Lab Chronicle

Client: Haley & Aldrich, Inc.
 Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
 SDG: Sedimentation Pond

Client Sample ID: CCR-SP-1-111023

Lab Sample ID: 180-165231-5

Date Collected: 11/10/23 08:40

Matrix: Water

Date Received: 11/11/23 08:29

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total Recoverable	Prep	3005A			50 mL	50 mL	452039	11/16/23 08:37	SJM	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			452395	11/17/23 18:16	S1Z	EET PIT
Instrument ID: NEMO										
Total Recoverable	Prep	3005A			50 mL	50 mL	452039	11/16/23 08:37	SJM	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			452607	11/21/23 15:06	S1Z	EET PIT
Instrument ID: NEMO										
Total/NA	Prep	7470A			25 mL	25 mL	452480	11/21/23 10:15	RJR	EET PIT
Total/NA	Analysis	EPA 7470A		1			452922	11/28/23 09:24	MTW	EET PIT
Instrument ID: HGZ										
Total/NA	Analysis	EPA 9040C		1			452193	11/16/23 13:46	BAB	EET PIT
Instrument ID: OZ										
Total/NA	Analysis	SM 2540C		1	50 mL	100 mL	452200	11/16/23 18:14	LWM	EET PIT
Instrument ID: NOEQUIP										
Total/NA	Prep	PrecSep-21			993.47 mL	1.0 g	637221	11/16/23 10:32	KAC	EET SL
Total/NA	Analysis	9315		1			641229	12/18/23 14:12	EMH	EET SL
Instrument ID: GFPCPURPLE										
Total/NA	Prep	PrecSep_0			993.47 mL	1.0 g	637222	11/16/23 10:39	KAC	EET SL
Total/NA	Analysis	9320		1			640878	12/15/23 16:28	FLC	EET SL
Instrument ID: GFPCRED										
Total/NA	Analysis	Ra226_Ra228		1			641297	12/18/23 23:24	EMH	EET SL
Instrument ID: NOEQUIP										

Laboratory References:

EET PIT = Eurofins Pittsburgh, 301 Alpha Drive, RIDC Park, Pittsburgh, PA 15238, TEL (412)963-7058

EET SL = Eurofins St. Louis, 13715 Rider Trail North, Earth City, MO 63045, TEL (314)298-8566

Analyst References:

Lab: EET PIT

Batch Type: Prep

RJR = Ron Rosenbaum

SJM = Shannon Mueller

Batch Type: Analysis

BAB = Brooke Batyi

LWM = Leslie McIntire

M1D = Maureen Donlin

MTW = Michael Wesoloski

RJR = Ron Rosenbaum

S1Z = Sage Ziviello

Lab: EET SL

Batch Type: Prep

KAC = Kevin Cox

Batch Type: Analysis

EMH = Elizabeth Hoerchler

FLC = Fernando Cruz

Client Sample Results

Client: Haley & Aldrich, Inc.
 Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
 SDG: Sedimentation Pond

Client Sample ID: CCR-SP-3-110923

Lab Sample ID: 180-165231-1

Date Collected: 11/09/23 12:25

Matrix: Water

Date Received: 11/11/23 08:29

Method: SW846 EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	6.2		1.0	0.71	mg/L			11/15/23 19:24	1
Fluoride	0.33		0.10	0.026	mg/L			11/15/23 19:24	1
Sulfate	3.8		1.0	0.76	mg/L			11/15/23 19:24	1

Method: SW846 EPA 6010D - Metals (ICP) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Boron	ND		200	33	ug/L		11/16/23 08:37	11/17/23 19:32	1

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	ND	^5+	0.0020	0.00097	mg/L		11/16/23 08:37	11/17/23 17:36	1
Arsenic	0.0085		0.0010	0.00028	mg/L		11/16/23 08:37	11/21/23 14:45	1
Barium	0.062	^5+	0.010	0.0031	mg/L		11/16/23 08:37	11/17/23 17:36	1
Beryllium	ND		0.0010	0.00027	mg/L		11/16/23 08:37	11/21/23 14:45	1
Cadmium	ND	^5+	0.0010	0.00022	mg/L		11/16/23 08:37	11/17/23 17:36	1
Calcium	77	F1	0.50	0.13	mg/L		11/16/23 08:37	11/17/23 17:36	1
Chromium	ND		0.0020	0.0015	mg/L		11/16/23 08:37	11/17/23 17:36	1
Cobalt	0.00050		0.00050	0.00026	mg/L		11/16/23 08:37	11/17/23 17:36	1
Lead	ND		0.0010	0.00038	mg/L		11/16/23 08:37	11/17/23 17:36	1
Lithium	ND	^5+	0.0050	0.0013	mg/L		11/16/23 08:37	11/17/23 17:36	1
Molybdenum	0.0037	J	0.0050	0.00061	mg/L		11/16/23 08:37	11/17/23 17:36	1
Selenium	ND		0.0050	0.00074	mg/L		11/16/23 08:37	11/17/23 17:36	1
Thallium	ND		0.0010	0.00047	mg/L		11/16/23 08:37	11/17/23 17:36	1

Method: SW846 EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		11/21/23 10:15	11/28/23 09:14	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids (SM 2540C)	370		10	10	mg/L			11/16/23 18:14	1

Analyte	Result	Qualifier	RL	RL	Unit	D	Prepared	Analyzed	Dil Fac
pH (SW846 EPA 9040C)	7.3	HF	0.1	0.1	SU			11/16/23 14:00	1

Method: SW846 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count		RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Total Uncert. (2σ+/-)						
Radium-226	0.0188	U	0.105	0.105	1.00	0.197	pCi/L	11/16/23 10:32	12/18/23 14:12	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	96.9		30 - 110					11/16/23 10:32	12/18/23 14:12	1

Method: SW846 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count		RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Total Uncert. (2σ+/-)						
Radium-228	0.413	U	0.372	0.374	1.00	0.590	pCi/L	11/16/23 10:39	12/15/23 16:25	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	96.9		30 - 110					11/16/23 10:39	12/15/23 16:25	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.
 Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
 SDG: Sedimentation Pond

Client Sample ID: CCR-SP-3-110923

Lab Sample ID: 180-165231-1

Date Collected: 11/09/23 12:25

Matrix: Water

Date Received: 11/11/23 08:29

Method: SW846 9320 - Radium-228 (GFPC) (Continued)

Carrier	%Yield	Qualifier	Limits	Prepared	Analyzed	Dil Fac
Y Carrier	78.5		30 - 110	11/16/23 10:39	12/15/23 16:25	1

Method: TAL-STL Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count Uncert. (2σ+/-)	Total Uncert. (2σ+/-)	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
Combined Radium 226 + 228	0.432	U	0.387	0.388	5.00	0.590	pCi/L		12/18/23 23:24	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13

Client Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
SDG: Sedimentation Pond

Client Sample ID: CCR-SP-2-110923

Lab Sample ID: 180-165231-2

Date Collected: 11/09/23 15:05

Matrix: Water

Date Received: 11/11/23 08:29

Method: SW846 EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	69		1.0	0.71	mg/L			11/16/23 08:38	1
Fluoride	0.20		0.10	0.026	mg/L			11/16/23 08:38	1
Sulfate	410		1.0	0.76	mg/L			11/16/23 08:38	1

Method: SW846 EPA 6010D - Metals (ICP) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Boron	ND		200	33	ug/L		11/16/23 08:37	11/17/23 19:57	1

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	ND	^5+	0.0020	0.00097	mg/L		11/16/23 08:37	11/17/23 17:51	1
Arsenic	0.0061		0.0010	0.00028	mg/L		11/16/23 08:37	11/21/23 14:57	1
Barium	0.13	^5+	0.010	0.0031	mg/L		11/16/23 08:37	11/17/23 17:51	1
Beryllium	ND		0.0010	0.00027	mg/L		11/16/23 08:37	11/21/23 14:57	1
Cadmium	ND	^5+	0.0010	0.00022	mg/L		11/16/23 08:37	11/17/23 17:51	1
Calcium	220		0.50	0.13	mg/L		11/16/23 08:37	11/17/23 17:51	1
Chromium	0.0015	J	0.0020	0.0015	mg/L		11/16/23 08:37	11/17/23 17:51	1
Cobalt	0.0010		0.00050	0.00026	mg/L		11/16/23 08:37	11/17/23 17:51	1
Lead	0.00095	J	0.0010	0.00038	mg/L		11/16/23 08:37	11/17/23 17:51	1
Lithium	0.0064	^5+	0.0050	0.0013	mg/L		11/16/23 08:37	11/17/23 17:51	1
Molybdenum	0.0014	J	0.0050	0.00061	mg/L		11/16/23 08:37	11/17/23 17:51	1
Selenium	ND		0.0050	0.00074	mg/L		11/16/23 08:37	11/17/23 17:51	1
Thallium	ND		0.0010	0.00047	mg/L		11/16/23 08:37	11/17/23 17:51	1

Method: SW846 EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		11/21/23 10:15	11/28/23 09:17	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids (SM 2540C)	1200		10	10	mg/L			11/16/23 18:14	1

Analyte	Result	Qualifier	RL	RL	Unit	D	Prepared	Analyzed	Dil Fac
pH (SW846 EPA 9040C)	7.2	HF	0.1	0.1	SU			11/16/23 14:24	1

Method: SW846 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count Uncert. (2σ+/-)	Total Uncert. (2σ+/-)	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
Radium-226	0.324		0.184	0.186	1.00	0.238	pCi/L	11/16/23 10:32	12/18/23 14:12	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	85.3		30 - 110					11/16/23 10:32	12/18/23 14:12	1

Method: SW846 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count Uncert. (2σ+/-)	Total Uncert. (2σ+/-)	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
Radium-228	0.119	U	0.439	0.439	1.00	0.795	pCi/L	11/16/23 10:39	12/15/23 16:28	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	85.3		30 - 110					11/16/23 10:39	12/15/23 16:28	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.
 Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
 SDG: Sedimentation Pond

Client Sample ID: CCR-SP-2-110923

Lab Sample ID: 180-165231-2

Date Collected: 11/09/23 15:05

Matrix: Water

Date Received: 11/11/23 08:29

Method: SW846 9320 - Radium-228 (GFPC) (Continued)

<u>Carrier</u>	<u>%Yield</u>	<u>Qualifier</u>	<u>Limits</u>	<u>Prepared</u>	<u>Analyzed</u>	<u>Dil Fac</u>
Y Carrier	78.1		30 - 110	11/16/23 10:39	12/15/23 16:28	1

Method: TAL-STL Ra226_Ra228 - Combined Radium-226 and Radium-228

<u>Analyte</u>	<u>Result</u>	<u>Qualifier</u>	<u>Count Uncert. (2σ+/-)</u>	<u>Total Uncert. (2σ+/-)</u>	<u>RL</u>	<u>MDC</u>	<u>Unit</u>	<u>Prepared</u>	<u>Analyzed</u>	<u>Dil Fac</u>
Combined Radium 226 + 228	0.443	U	0.476	0.477	5.00	0.795	pCi/L		12/18/23 23:24	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13

Client Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
SDG: Sedimentation Pond

Client Sample ID: DUP-2-110923

Lab Sample ID: 180-165231-3

Date Collected: 11/09/23 00:00

Matrix: Water

Date Received: 11/11/23 08:29

Method: SW846 EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	70		1.0	0.71	mg/L			11/16/23 17:24	1
Fluoride	0.19		0.10	0.026	mg/L			11/16/23 17:24	1
Sulfate	420		1.0	0.76	mg/L			11/16/23 17:24	1

Method: SW846 EPA 6010D - Metals (ICP) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Boron	ND		200	33	ug/L		11/16/23 08:37	11/17/23 20:02	1

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	ND	^5+	0.0020	0.00097	mg/L		11/16/23 08:37	11/17/23 18:10	1
Arsenic	0.0077		0.0010	0.00028	mg/L		11/16/23 08:37	11/21/23 15:00	1
Barium	0.14	^5+	0.010	0.0031	mg/L		11/16/23 08:37	11/17/23 18:10	1
Beryllium	ND		0.0010	0.00027	mg/L		11/16/23 08:37	11/21/23 15:00	1
Cadmium	ND	^5+	0.0010	0.00022	mg/L		11/16/23 08:37	11/17/23 18:10	1
Calcium	220		0.50	0.13	mg/L		11/16/23 08:37	11/17/23 18:10	1
Chromium	0.0041		0.0020	0.0015	mg/L		11/16/23 08:37	11/17/23 18:10	1
Cobalt	0.0019		0.00050	0.00026	mg/L		11/16/23 08:37	11/17/23 18:10	1
Lead	0.0027		0.0010	0.00038	mg/L		11/16/23 08:37	11/17/23 18:10	1
Lithium	0.0078	^5+	0.0050	0.0013	mg/L		11/16/23 08:37	11/17/23 18:10	1
Molybdenum	0.0017	J	0.0050	0.00061	mg/L		11/16/23 08:37	11/17/23 18:10	1
Selenium	ND		0.0050	0.00074	mg/L		11/16/23 08:37	11/17/23 18:10	1
Thallium	ND		0.0010	0.00047	mg/L		11/16/23 08:37	11/17/23 18:10	1

Method: SW846 EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		11/21/23 10:15	11/28/23 09:18	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids (SM 2540C)	1200		10	10	mg/L			11/16/23 18:14	1
Analyte	Result	Qualifier	RL	RL	Unit	D	Prepared	Analyzed	Dil Fac
pH (SW846 EPA 9040C)	7.0	HF	0.1	0.1	SU			11/16/23 14:09	1

Method: SW846 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert.	Uncert.						
			(2σ+/-)	(2σ+/-)						
Radium-226	0.471		0.286	0.289	1.00	0.387	pCi/L	11/16/23 10:32	12/18/23 14:12	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	84.1		30 - 110					11/16/23 10:32	12/18/23 14:12	1

Method: SW846 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert.	Uncert.						
			(2σ+/-)	(2σ+/-)						
Radium-228	0.370	U G	0.688	0.689	1.00	1.19	pCi/L	11/16/23 10:39	12/15/23 16:28	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	84.1		30 - 110					11/16/23 10:39	12/15/23 16:28	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.
 Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
 SDG: Sedimentation Pond

Client Sample ID: DUP-2-110923

Lab Sample ID: 180-165231-3

Date Collected: 11/09/23 00:00

Matrix: Water

Date Received: 11/11/23 08:29

Method: SW846 9320 - Radium-228 (GFPC) (Continued)

Carrier	%Yield	Qualifier	Limits	Prepared	Analyzed	Dil Fac
Y Carrier	78.5		30 - 110	11/16/23 10:39	12/15/23 16:28	1

Method: TAL-STL Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count Uncert. (2σ+/-)	Total Uncert. (2σ+/-)	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
Combined Radium 226 + 228	0.841	U	0.745	0.747	5.00	1.19	pCi/L		12/18/23 23:24	1



Client Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
SDG: Sedimentation Pond

Client Sample ID: FB-2-111023

Lab Sample ID: 180-165231-4

Date Collected: 11/10/23 08:30

Matrix: Water

Date Received: 11/11/23 08:29

Method: SW846 EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	ND		1.0	0.71	mg/L			11/16/23 17:05	1
Fluoride	0.027	J	0.10	0.026	mg/L			11/16/23 17:05	1
Sulfate	ND		1.0	0.76	mg/L			11/16/23 17:05	1

Method: SW846 EPA 6010D - Metals (ICP) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Boron	ND		200	33	ug/L		11/16/23 08:37	11/17/23 20:08	1

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	ND	^5+	0.0020	0.00097	mg/L		11/16/23 08:37	11/17/23 18:12	1
Arsenic	ND		0.0010	0.00028	mg/L		11/16/23 08:37	11/21/23 15:03	1
Barium	ND	^5+	0.010	0.0031	mg/L		11/16/23 08:37	11/17/23 18:12	1
Beryllium	ND		0.0010	0.00027	mg/L		11/16/23 08:37	11/21/23 15:03	1
Cadmium	ND	^5+	0.0010	0.00022	mg/L		11/16/23 08:37	11/17/23 18:12	1
Calcium	ND		0.50	0.13	mg/L		11/16/23 08:37	11/17/23 18:12	1
Chromium	ND		0.0020	0.0015	mg/L		11/16/23 08:37	11/17/23 18:12	1
Cobalt	ND		0.00050	0.00026	mg/L		11/16/23 08:37	11/17/23 18:12	1
Lead	ND		0.0010	0.00038	mg/L		11/16/23 08:37	11/17/23 18:12	1
Lithium	ND	^5+	0.0050	0.0013	mg/L		11/16/23 08:37	11/17/23 18:12	1
Molybdenum	ND		0.0050	0.00061	mg/L		11/16/23 08:37	11/17/23 18:12	1
Selenium	ND		0.0050	0.00074	mg/L		11/16/23 08:37	11/17/23 18:12	1
Thallium	ND		0.0010	0.00047	mg/L		11/16/23 08:37	11/17/23 18:12	1

Method: SW846 EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		11/21/23 10:15	11/28/23 09:19	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids (SM 2540C)	ND		10	10	mg/L			11/16/23 18:14	1
Analyte	Result	Qualifier	RL	RL	Unit	D	Prepared	Analyzed	Dil Fac
pH (SW846 EPA 9040C)	5.6	HF	0.1	0.1	SU			11/17/23 13:46	1

Method: SW846 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert.	Uncert.						
			(2σ+/-)	(2σ+/-)						
Radium-226	-0.0259	U	0.0406	0.0407	1.00	0.119	pCi/L	11/16/23 10:32	12/18/23 14:12	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	96.4		30 - 110					11/16/23 10:32	12/18/23 14:12	1

Method: SW846 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert.	Uncert.						
			(2σ+/-)	(2σ+/-)						
Radium-228	0.631		0.354	0.359	1.00	0.505	pCi/L	11/16/23 10:39	12/15/23 16:28	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	96.4		30 - 110					11/16/23 10:39	12/15/23 16:28	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.
 Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
 SDG: Sedimentation Pond

Client Sample ID: FB-2-111023

Lab Sample ID: 180-165231-4

Date Collected: 11/10/23 08:30

Matrix: Water

Date Received: 11/11/23 08:29

Method: SW846 9320 - Radium-228 (GFPC) (Continued)

Carrier	%Yield	Qualifier	Limits	Prepared	Analyzed	Dil Fac
Y Carrier	85.2		30 - 110	11/16/23 10:39	12/15/23 16:28	1

Method: TAL-STL Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count Uncert. (2σ+/-)	Total Uncert. (2σ+/-)	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
Combined Radium 226 + 228	0.606		0.356	0.361	5.00	0.505	pCi/L		12/18/23 23:24	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13

Client Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
SDG: Sedimentation Pond

Client Sample ID: CCR-SP-1-111023

Lab Sample ID: 180-165231-5

Date Collected: 11/10/23 08:40

Matrix: Water

Date Received: 11/11/23 08:29

Method: SW846 EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	54		1.0	0.71	mg/L			11/16/23 00:19	1
Fluoride	0.064	J	0.10	0.026	mg/L			11/16/23 00:19	1
Sulfate	560		1.0	0.76	mg/L			11/16/23 00:19	1

Method: SW846 EPA 6010D - Metals (ICP) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Boron	410		200	33	ug/L		11/16/23 08:37	11/17/23 20:13	1

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	ND	^5+	0.0020	0.00097	mg/L		11/16/23 08:37	11/17/23 18:16	1
Arsenic	0.0025		0.0010	0.00028	mg/L		11/16/23 08:37	11/21/23 15:06	1
Barium	0.063	^5+	0.010	0.0031	mg/L		11/16/23 08:37	11/17/23 18:16	1
Beryllium	ND		0.0010	0.00027	mg/L		11/16/23 08:37	11/21/23 15:06	1
Cadmium	0.00028	J ^5+	0.0010	0.00022	mg/L		11/16/23 08:37	11/17/23 18:16	1
Calcium	360		0.50	0.13	mg/L		11/16/23 08:37	11/17/23 18:16	1
Chromium	ND		0.0020	0.0015	mg/L		11/16/23 08:37	11/17/23 18:16	1
Cobalt	0.011		0.00050	0.00026	mg/L		11/16/23 08:37	11/17/23 18:16	1
Lead	ND		0.0010	0.00038	mg/L		11/16/23 08:37	11/17/23 18:16	1
Lithium	0.0058	^5+	0.0050	0.0013	mg/L		11/16/23 08:37	11/17/23 18:16	1
Molybdenum	0.0014	J	0.0050	0.00061	mg/L		11/16/23 08:37	11/17/23 18:16	1
Selenium	ND		0.0050	0.00074	mg/L		11/16/23 08:37	11/17/23 18:16	1
Thallium	ND		0.0010	0.00047	mg/L		11/16/23 08:37	11/17/23 18:16	1

Method: SW846 EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		11/21/23 10:15	11/28/23 09:24	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids (SM 2540C)	2800		20	20	mg/L			11/16/23 18:14	1

Analyte	Result	Qualifier	RL	RL	Unit	D	Prepared	Analyzed	Dil Fac
pH (SW846 EPA 9040C)	6.9	HF	0.1	0.1	SU			11/16/23 13:46	1

Method: SW846 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count Uncert. (2σ+/-)	Total Uncert. (2σ+/-)	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
Radium-226	0.0396	U	0.0999	0.100	1.00	0.183	pCi/L	11/16/23 10:32	12/18/23 14:12	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	86.9		30 - 110					11/16/23 10:32	12/18/23 14:12	1

Method: SW846 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count Uncert. (2σ+/-)	Total Uncert. (2σ+/-)	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
Radium-228	0.410	U	0.378	0.380	1.00	0.599	pCi/L	11/16/23 10:39	12/15/23 16:28	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	86.9		30 - 110					11/16/23 10:39	12/15/23 16:28	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.
 Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
 SDG: Sedimentation Pond

Client Sample ID: CCR-SP-1-111023

Lab Sample ID: 180-165231-5

Date Collected: 11/10/23 08:40

Matrix: Water

Date Received: 11/11/23 08:29

Method: SW846 9320 - Radium-228 (GFPC) (Continued)

<u>Carrier</u>	<u>%Yield</u>	<u>Qualifier</u>	<u>Limits</u>	<u>Prepared</u>	<u>Analyzed</u>	<u>Dil Fac</u>
Y Carrier	81.1		30 - 110	11/16/23 10:39	12/15/23 16:28	1

Method: TAL-STL Ra226_Ra228 - Combined Radium-226 and Radium-228

<u>Analyte</u>	<u>Result</u>	<u>Qualifier</u>	<u>Count Uncert. (2σ+/-)</u>	<u>Total Uncert. (2σ+/-)</u>	<u>RL</u>	<u>MDC</u>	<u>Unit</u>	<u>Prepared</u>	<u>Analyzed</u>	<u>Dil Fac</u>
Combined Radium 226 + 228	0.450	U	0.391	0.393	5.00	0.599	pCi/L		12/18/23 23:24	1



QC Sample Results

Client: Haley & Aldrich, Inc.
 Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
 SDG: Sedimentation Pond

Method: EPA 9056A - Anions, Ion Chromatography

Lab Sample ID: MB 180-452001/43
 Matrix: Water
 Analysis Batch: 452001

Client Sample ID: Method Blank
 Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	ND		1.0	0.71	mg/L			11/16/23 01:33	1
Fluoride	ND		0.10	0.026	mg/L			11/16/23 01:33	1
Sulfate	ND		1.0	0.76	mg/L			11/16/23 01:33	1

Lab Sample ID: MB 180-452001/6
 Matrix: Water
 Analysis Batch: 452001

Client Sample ID: Method Blank
 Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	ND		1.0	0.71	mg/L			11/15/23 11:25	1
Fluoride	ND		0.10	0.026	mg/L			11/15/23 11:25	1
Sulfate	ND		1.0	0.76	mg/L			11/15/23 11:25	1

Lab Sample ID: LCS 180-452001/44
 Matrix: Water
 Analysis Batch: 452001

Client Sample ID: Lab Control Sample
 Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Chloride	50.0	49.9		mg/L		100	80 - 120
Fluoride	2.50	2.56		mg/L		102	80 - 120
Sulfate	50.0	49.5		mg/L		99	80 - 120

Lab Sample ID: LCS 180-452001/7
 Matrix: Water
 Analysis Batch: 452001

Client Sample ID: Lab Control Sample
 Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Chloride	50.0	49.1		mg/L		98	80 - 120
Fluoride	2.50	2.52		mg/L		101	80 - 120
Sulfate	50.0	48.8		mg/L		98	80 - 120

Lab Sample ID: 180-165231-1 MS
 Matrix: Water
 Analysis Batch: 452001

Client Sample ID: CCR-SP-3-110923
 Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
Chloride	6.2		50.0	54.5		mg/L		97	80 - 120
Fluoride	0.33		2.50	2.69		mg/L		95	80 - 120
Sulfate	3.8		50.0	52.2		mg/L		97	80 - 120

Lab Sample ID: 180-165231-1 MSD
 Matrix: Water
 Analysis Batch: 452001

Client Sample ID: CCR-SP-3-110923
 Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
Chloride	6.2		50.0	54.3		mg/L		96	80 - 120	0	15
Fluoride	0.33		2.50	2.69		mg/L		94	80 - 120	0	15
Sulfate	3.8		50.0	52.0		mg/L		96	80 - 120	0	15

Eurofins Pittsburgh

QC Sample Results

Client: Haley & Aldrich, Inc.
 Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
 SDG: Sedimentation Pond

Method: EPA 9056A - Anions, Ion Chromatography (Continued)

Lab Sample ID: MB 180-452140/6
Matrix: Water
Analysis Batch: 452140

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	ND		1.0	0.71	mg/L			11/16/23 14:37	1
Fluoride	ND		0.10	0.026	mg/L			11/16/23 14:37	1
Sulfate	ND		1.0	0.76	mg/L			11/16/23 14:37	1

Lab Sample ID: LCS 180-452140/7
Matrix: Water
Analysis Batch: 452140

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Chloride	50.0	49.9		mg/L		100	80 - 120
Fluoride	2.50	2.53		mg/L		101	80 - 120
Sulfate	50.0	49.8		mg/L		100	80 - 120

Method: EPA 6010D - Metals (ICP)

Lab Sample ID: MB 180-452038/1-A
Matrix: Water
Analysis Batch: 452389

Client Sample ID: Method Blank
Prep Type: Total Recoverable
Prep Batch: 452038

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Boron	ND		200	33	ug/L		11/16/23 08:37	11/17/23 18:56	1

Lab Sample ID: LCS 180-452038/2-A
Matrix: Water
Analysis Batch: 452389

Client Sample ID: Lab Control Sample
Prep Type: Total Recoverable
Prep Batch: 452038

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Boron	1250	1300		ug/L		104	80 - 120

Lab Sample ID: 180-165231-1 MS
Matrix: Water
Analysis Batch: 452389

Client Sample ID: CCR-SP-3-110923
Prep Type: Total Recoverable
Prep Batch: 452038

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
Boron	ND		1250	1360		ug/L		109	75 - 125

Lab Sample ID: 180-165231-1 MSD
Matrix: Water
Analysis Batch: 452389

Client Sample ID: CCR-SP-3-110923
Prep Type: Total Recoverable
Prep Batch: 452038

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
Boron	ND		1250	1330		ug/L		107	75 - 125	2	20

QC Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
SDG: Sedimentation Pond

Method: EPA 6020A - Metals (ICP/MS)

Lab Sample ID: MB 180-452039/1-A
Matrix: Water
Analysis Batch: 452395

Client Sample ID: Method Blank
Prep Type: Total Recoverable
Prep Batch: 452039

Analyte	MB	MB	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Antimony	ND	^5+	0.0020	0.00097	mg/L		11/16/23 08:37	11/17/23 17:22	1
Barium	ND	^5+	0.010	0.0031	mg/L		11/16/23 08:37	11/17/23 17:22	1
Cadmium	ND	^5+	0.0010	0.00022	mg/L		11/16/23 08:37	11/17/23 17:22	1
Calcium	ND		0.50	0.13	mg/L		11/16/23 08:37	11/17/23 17:22	1
Chromium	ND		0.0020	0.0015	mg/L		11/16/23 08:37	11/17/23 17:22	1
Cobalt	ND		0.00050	0.00026	mg/L		11/16/23 08:37	11/17/23 17:22	1
Lead	ND		0.0010	0.00038	mg/L		11/16/23 08:37	11/17/23 17:22	1
Lithium	ND	^5+	0.0050	0.0013	mg/L		11/16/23 08:37	11/17/23 17:22	1
Molybdenum	ND		0.0050	0.00061	mg/L		11/16/23 08:37	11/17/23 17:22	1
Selenium	ND		0.0050	0.00074	mg/L		11/16/23 08:37	11/17/23 17:22	1
Thallium	ND		0.0010	0.00047	mg/L		11/16/23 08:37	11/17/23 17:22	1

Lab Sample ID: MB 180-452039/1-A
Matrix: Water
Analysis Batch: 452607

Client Sample ID: Method Blank
Prep Type: Total Recoverable
Prep Batch: 452039

Analyte	MB	MB	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Arsenic	ND		0.0010	0.00028	mg/L		11/16/23 08:37	11/21/23 14:30	1
Beryllium	ND		0.0010	0.00027	mg/L		11/16/23 08:37	11/21/23 14:30	1

Lab Sample ID: LCS 180-452039/2-A
Matrix: Water
Analysis Batch: 452395

Client Sample ID: Lab Control Sample
Prep Type: Total Recoverable
Prep Batch: 452039

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Barium	1.00	0.914	^5+	mg/L		91	80 - 120
Cadmium	0.500	0.513	^5+	mg/L		103	80 - 120
Calcium	25.0	29.0		mg/L		116	80 - 120
Chromium	0.500	0.520		mg/L		104	80 - 120
Cobalt	0.500	0.537		mg/L		107	80 - 120
Lead	0.500	0.515		mg/L		103	80 - 120
Lithium	0.500	0.508	^5+	mg/L		102	80 - 120
Molybdenum	0.500	0.533		mg/L		107	80 - 120
Selenium	1.00	0.970		mg/L		97	80 - 120
Thallium	1.00	1.04		mg/L		104	80 - 120

Lab Sample ID: LCS 180-452039/2-A ^5
Matrix: Water
Analysis Batch: 452607

Client Sample ID: Lab Control Sample
Prep Type: Total Recoverable
Prep Batch: 452039

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Beryllium	0.500	0.518		mg/L		104	80 - 120
Boron	1.25	1.06	^5-	mg/L		85	80 - 120

QC Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
SDG: Sedimentation Pond

Method: EPA 6020A - Metals (ICP/MS) (Continued)

Lab Sample ID: 180-165231-1 MS
Matrix: Water
Analysis Batch: 452395

Client Sample ID: CCR-SP-3-110923
Prep Type: Total Recoverable
Prep Batch: 452039

Analyte	Sample	Sample	Spike	MS	MS	Unit	D	%Rec	%Rec	
	Result	Qualifier		Result	Qualifier				Limits	RPD
Antimony	ND	^5+	0.250	0.267	^5+	mg/L		107	75 - 125	
Barium	0.062	^5+	1.00	0.979	^5+	mg/L		92	75 - 125	
Cadmium	ND	^5+	0.500	0.524	^5+	mg/L		105	75 - 125	
Calcium	77	F1	25.0	120	F1	mg/L		173	75 - 125	
Chromium	ND		0.500	0.521		mg/L		104	75 - 125	
Cobalt	0.00050		0.500	0.563		mg/L		113	75 - 125	
Lead	ND		0.500	0.529		mg/L		106	75 - 125	
Lithium	ND	^5+	0.500	0.515	^5+	mg/L		103	75 - 125	
Molybdenum	0.0037	J	0.500	0.561		mg/L		111	75 - 125	
Selenium	ND		1.00	0.972		mg/L		97	75 - 125	
Thallium	ND		1.00	1.06		mg/L		106	75 - 125	

Lab Sample ID: 180-165231-1 MS
Matrix: Water
Analysis Batch: 452607

Client Sample ID: CCR-SP-3-110923
Prep Type: Total Recoverable
Prep Batch: 452039

Analyte	Sample	Sample	Spike	MS	MS	Unit	D	%Rec	%Rec	
	Result	Qualifier		Result	Qualifier				Limits	RPD
Arsenic	0.0085		1.00	1.01		mg/L		100	75 - 125	
Beryllium	ND		0.500	0.510		mg/L		102	75 - 125	
Boron	0.24	^5-	1.25	1.43	^5-	mg/L		95	75 - 125	

Lab Sample ID: 180-165231-1 MSD
Matrix: Water
Analysis Batch: 452395

Client Sample ID: CCR-SP-3-110923
Prep Type: Total Recoverable
Prep Batch: 452039

Analyte	Sample	Sample	Spike	MSD	MSD	Unit	D	%Rec	%Rec		RPD	
	Result	Qualifier		Result	Qualifier				Limits	RPD	Limit	
Antimony	ND	^5+	0.250	0.265	^5+	mg/L		106	75 - 125	1	20	
Barium	0.062	^5+	1.00	0.952	^5+	mg/L		89	75 - 125	3	20	
Cadmium	ND	^5+	0.500	0.517	^5+	mg/L		103	75 - 125	1	20	
Calcium	77	F1	25.0	120	F1	mg/L		170	75 - 125	1	20	
Chromium	ND		0.500	0.512		mg/L		102	75 - 125	2	20	
Cobalt	0.00050		0.500	0.544		mg/L		109	75 - 125	3	20	
Lead	ND		0.500	0.520		mg/L		104	75 - 125	2	20	
Lithium	ND	^5+	0.500	0.510	^5+	mg/L		102	75 - 125	1	20	
Molybdenum	0.0037	J	0.500	0.546		mg/L		108	75 - 125	3	20	
Selenium	ND		1.00	0.982		mg/L		98	75 - 125	1	20	
Thallium	ND		1.00	1.07		mg/L		107	75 - 125	1	20	

Lab Sample ID: 180-165231-1 MSD
Matrix: Water
Analysis Batch: 452607

Client Sample ID: CCR-SP-3-110923
Prep Type: Total Recoverable
Prep Batch: 452039

Analyte	Sample	Sample	Spike	MSD	MSD	Unit	D	%Rec	%Rec		RPD	
	Result	Qualifier		Result	Qualifier				Limits	RPD	Limit	
Arsenic	0.0085		1.00	1.00		mg/L		99	75 - 125	1	20	
Beryllium	ND		0.500	0.504		mg/L		101	75 - 125	1	20	
Boron	0.24	^5-	1.25	1.34	^5-	mg/L		88	75 - 125	6	20	

QC Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
SDG: Sedimentation Pond

Method: EPA 7470A - Mercury (CVAA)

Lab Sample ID: MB 180-452480/1-A
Matrix: Water
Analysis Batch: 452922

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 452480

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		11/21/23 10:15	11/28/23 08:56	1

Lab Sample ID: LCS 180-452480/2-A
Matrix: Water
Analysis Batch: 452922

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 452480

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Mercury	0.00250	0.00243		mg/L		97	80 - 120

Lab Sample ID: 180-165231-1 MS
Matrix: Water
Analysis Batch: 452922

Client Sample ID: CCR-SP-3-110923
Prep Type: Total/NA
Prep Batch: 452480

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
Mercury	ND		0.00100	0.000897		mg/L		90	75 - 125

Lab Sample ID: 180-165231-1 MSD
Matrix: Water
Analysis Batch: 452922

Client Sample ID: CCR-SP-3-110923
Prep Type: Total/NA
Prep Batch: 452480

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
Mercury	ND		0.00100	0.000911		mg/L		91	75 - 125	2	20

Method: EPA 9040C - pH

Lab Sample ID: LCS 180-452193/24
Matrix: Water
Analysis Batch: 452193

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
pH	7.00	7.0		SU		100	99 - 101

Lab Sample ID: 180-165231-1 DU
Matrix: Water
Analysis Batch: 452193

Client Sample ID: CCR-SP-3-110923
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	DU Result	DU Qualifier	Unit	D	RPD	RPD Limit
pH	7.3	HF	7.3	HF	SU		0.3	2

Lab Sample ID: LCS 180-452345/1
Matrix: Water
Analysis Batch: 452345

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
pH	7.00	7.0		SU		100	99 - 101

QC Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
SDG: Sedimentation Pond

Method: SM 2540C - Solids, Total Dissolved (TDS)

Lab Sample ID: MB 180-452200/1
Matrix: Water
Analysis Batch: 452200

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids	ND		10	10	mg/L			11/16/23 18:14	1

Lab Sample ID: LCS 180-452200/2
Matrix: Water
Analysis Batch: 452200

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Total Dissolved Solids	336	322		mg/L		96	85 - 115

Lab Sample ID: 180-165231-1 DU
Matrix: Water
Analysis Batch: 452200

Client Sample ID: CCR-SP-3-110923
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	DU Result	DU Qualifier	Unit	D	RPD	RPD Limit
Total Dissolved Solids	370		363		mg/L		1	10

Method: 9315 - Radium-226 (GFPC)

Lab Sample ID: MB 160-637221/1-A
Matrix: Water
Analysis Batch: 641268

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 637221

Analyte	MB Result	MB Qualifier	Count Uncert. (2σ+/-)	Total Uncert. (2σ+/-)	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
Radium-226	0.2180		0.140	0.142	1.00	0.196	pCi/L	11/16/23 10:32	12/18/23 14:14	1
Carrier	MB %Yield	MB Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	101		30 - 110					11/16/23 10:32	12/18/23 14:14	1

Lab Sample ID: LCS 160-637221/2-A
Matrix: Water
Analysis Batch: 641268

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 637221

Analyte	Spike Added	LCS Result	LCS Qual	Total Uncert. (2σ+/-)	RL	MDC	Unit	%Rec	%Rec Limits
Radium-226	11.3	9.796		1.09	1.00	0.148	pCi/L	86	75 - 125
Carrier	LCS %Yield	LCS Qualifier	Limits						
Ba Carrier	101		30 - 110						

Lab Sample ID: 180-165231-1 DU
Matrix: Water
Analysis Batch: 641229

Client Sample ID: CCR-SP-3-110923
Prep Type: Total/NA
Prep Batch: 637221

Analyte	Sample Result	Sample Qual	DU Result	DU Qual	Total Uncert. (2σ+/-)	RL	MDC	Unit	RER	RER Limit
Radium-226	0.0188	U	0.05994	U	0.0967	1.00	0.167	pCi/L	0.20	1

Eurofins Pittsburgh

QC Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
SDG: Sedimentation Pond

Method: 9315 - Radium-226 (GFPC) (Continued)

Lab Sample ID: 180-165231-1 DU
Matrix: Water
Analysis Batch: 641229

Client Sample ID: CCR-SP-3-110923
Prep Type: Total/NA
Prep Batch: 637221

		DU	DU
Carrier	%Yield	Qualifier	Limits
Ba Carrier	94.3		30 - 110

Method: 9320 - Radium-228 (GFPC)

Lab Sample ID: MB 160-637222/1-A
Matrix: Water
Analysis Batch: 640878

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 637222

Analyte	MB MB		Count Uncert. (2σ+/-)	Total Uncert. (2σ+/-)	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
	Result	Qualifier								
Radium-228	0.1039	U	0.319	0.319	1.00	0.576	pCi/L	11/16/23 10:39	12/15/23 18:35	1
Carrier	%Yield	Qualifier	Limits		Prepared	Analyzed	Dil Fac			
Ba Carrier	101		30 - 110		11/16/23 10:39	12/15/23 18:35	1			
Y Carrier	84.5		30 - 110		11/16/23 10:39	12/15/23 18:35	1			

Lab Sample ID: LCS 160-637222/2-A
Matrix: Water
Analysis Batch: 640878

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 637222

Analyte	Spike Added	LCS Result	LCS Qual	Total Uncert. (2σ+/-)	RL	MDC	Unit	%Rec	%Rec Limits
Carrier	%Yield	Qualifier	Limits						
Ba Carrier	101		30 - 110						
Y Carrier	78.9		30 - 110						

Lab Sample ID: 180-165231-1 DU
Matrix: Water
Analysis Batch: 640878

Client Sample ID: CCR-SP-3-110923
Prep Type: Total/NA
Prep Batch: 637222

Analyte	Sample Sample		DU DU		Total Uncert. (2σ+/-)	RL	MDC	Unit	RER	RER Limit
	Result	Qual	Result	Qual						
Radium-228	0.413	U	0.3942	U	0.366	1.00	0.578	pCi/L	0.03	1
Carrier	%Yield	Qualifier	Limits							
Ba Carrier	94.3		30 - 110							
Y Carrier	74.8		30 - 110							

QC Association Summary

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
SDG: Sedimentation Pond

HPLC/IC

Analysis Batch: 452001

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-165231-1	CCR-SP-3-110923	Total/NA	Water	EPA 9056A	
180-165231-2	CCR-SP-2-110923	Total/NA	Water	EPA 9056A	
180-165231-5	CCR-SP-1-111023	Total/NA	Water	EPA 9056A	
MB 180-452001/43	Method Blank	Total/NA	Water	EPA 9056A	
MB 180-452001/6	Method Blank	Total/NA	Water	EPA 9056A	
LCS 180-452001/44	Lab Control Sample	Total/NA	Water	EPA 9056A	
LCS 180-452001/7	Lab Control Sample	Total/NA	Water	EPA 9056A	
180-165231-1 MS	CCR-SP-3-110923	Total/NA	Water	EPA 9056A	
180-165231-1 MSD	CCR-SP-3-110923	Total/NA	Water	EPA 9056A	

Analysis Batch: 452140

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-165231-3	DUP-2-110923	Total/NA	Water	EPA 9056A	
180-165231-4	FB-2-111023	Total/NA	Water	EPA 9056A	
MB 180-452140/6	Method Blank	Total/NA	Water	EPA 9056A	
LCS 180-452140/7	Lab Control Sample	Total/NA	Water	EPA 9056A	

Metals

Prep Batch: 452038

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-165231-1	CCR-SP-3-110923	Total Recoverable	Water	3005A	
180-165231-2	CCR-SP-2-110923	Total Recoverable	Water	3005A	
180-165231-3	DUP-2-110923	Total Recoverable	Water	3005A	
180-165231-4	FB-2-111023	Total Recoverable	Water	3005A	
180-165231-5	CCR-SP-1-111023	Total Recoverable	Water	3005A	
MB 180-452038/1-A	Method Blank	Total Recoverable	Water	3005A	
LCS 180-452038/2-A	Lab Control Sample	Total Recoverable	Water	3005A	
180-165231-1 MS	CCR-SP-3-110923	Total Recoverable	Water	3005A	
180-165231-1 MSD	CCR-SP-3-110923	Total Recoverable	Water	3005A	

Prep Batch: 452039

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-165231-1	CCR-SP-3-110923	Total Recoverable	Water	3005A	
180-165231-2	CCR-SP-2-110923	Total Recoverable	Water	3005A	
180-165231-3	DUP-2-110923	Total Recoverable	Water	3005A	
180-165231-4	FB-2-111023	Total Recoverable	Water	3005A	
180-165231-5	CCR-SP-1-111023	Total Recoverable	Water	3005A	
MB 180-452039/1-A	Method Blank	Total Recoverable	Water	3005A	
LCS 180-452039/2-A	Lab Control Sample	Total Recoverable	Water	3005A	
LCS 180-452039/2-A ^5	Lab Control Sample	Total Recoverable	Water	3005A	
180-165231-1 MS	CCR-SP-3-110923	Total Recoverable	Water	3005A	
180-165231-1 MSD	CCR-SP-3-110923	Total Recoverable	Water	3005A	

Analysis Batch: 452389

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-165231-1	CCR-SP-3-110923	Total Recoverable	Water	EPA 6010D	452038
180-165231-2	CCR-SP-2-110923	Total Recoverable	Water	EPA 6010D	452038
180-165231-3	DUP-2-110923	Total Recoverable	Water	EPA 6010D	452038
180-165231-4	FB-2-111023	Total Recoverable	Water	EPA 6010D	452038
180-165231-5	CCR-SP-1-111023	Total Recoverable	Water	EPA 6010D	452038

Eurofins Pittsburgh

QC Association Summary

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
SDG: Sedimentation Pond

Metals (Continued)

Analysis Batch: 452389 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
MB 180-452038/1-A	Method Blank	Total Recoverable	Water	EPA 6010D	452038
LCS 180-452038/2-A	Lab Control Sample	Total Recoverable	Water	EPA 6010D	452038
180-165231-1 MS	CCR-SP-3-110923	Total Recoverable	Water	EPA 6010D	452038
180-165231-1 MSD	CCR-SP-3-110923	Total Recoverable	Water	EPA 6010D	452038

Analysis Batch: 452395

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-165231-1	CCR-SP-3-110923	Total Recoverable	Water	EPA 6020A	452039
180-165231-2	CCR-SP-2-110923	Total Recoverable	Water	EPA 6020A	452039
180-165231-3	DUP-2-110923	Total Recoverable	Water	EPA 6020A	452039
180-165231-4	FB-2-111023	Total Recoverable	Water	EPA 6020A	452039
180-165231-5	CCR-SP-1-111023	Total Recoverable	Water	EPA 6020A	452039
MB 180-452039/1-A	Method Blank	Total Recoverable	Water	EPA 6020A	452039
LCS 180-452039/2-A	Lab Control Sample	Total Recoverable	Water	EPA 6020A	452039
180-165231-1 MS	CCR-SP-3-110923	Total Recoverable	Water	EPA 6020A	452039
180-165231-1 MSD	CCR-SP-3-110923	Total Recoverable	Water	EPA 6020A	452039

Prep Batch: 452480

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-165231-1	CCR-SP-3-110923	Total/NA	Water	7470A	
180-165231-2	CCR-SP-2-110923	Total/NA	Water	7470A	
180-165231-3	DUP-2-110923	Total/NA	Water	7470A	
180-165231-4	FB-2-111023	Total/NA	Water	7470A	
180-165231-5	CCR-SP-1-111023	Total/NA	Water	7470A	
MB 180-452480/1-A	Method Blank	Total/NA	Water	7470A	
LCS 180-452480/2-A	Lab Control Sample	Total/NA	Water	7470A	
180-165231-1 MS	CCR-SP-3-110923	Total/NA	Water	7470A	
180-165231-1 MSD	CCR-SP-3-110923	Total/NA	Water	7470A	

Analysis Batch: 452607

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-165231-1	CCR-SP-3-110923	Total Recoverable	Water	EPA 6020A	452039
180-165231-2	CCR-SP-2-110923	Total Recoverable	Water	EPA 6020A	452039
180-165231-3	DUP-2-110923	Total Recoverable	Water	EPA 6020A	452039
180-165231-4	FB-2-111023	Total Recoverable	Water	EPA 6020A	452039
180-165231-5	CCR-SP-1-111023	Total Recoverable	Water	EPA 6020A	452039
MB 180-452039/1-A	Method Blank	Total Recoverable	Water	EPA 6020A	452039
LCS 180-452039/2-A ^5	Lab Control Sample	Total Recoverable	Water	EPA 6020A	452039
180-165231-1 MS	CCR-SP-3-110923	Total Recoverable	Water	EPA 6020A	452039
180-165231-1 MSD	CCR-SP-3-110923	Total Recoverable	Water	EPA 6020A	452039

Analysis Batch: 452922

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-165231-1	CCR-SP-3-110923	Total/NA	Water	EPA 7470A	452480
180-165231-2	CCR-SP-2-110923	Total/NA	Water	EPA 7470A	452480
180-165231-3	DUP-2-110923	Total/NA	Water	EPA 7470A	452480
180-165231-4	FB-2-111023	Total/NA	Water	EPA 7470A	452480
180-165231-5	CCR-SP-1-111023	Total/NA	Water	EPA 7470A	452480
MB 180-452480/1-A	Method Blank	Total/NA	Water	EPA 7470A	452480
LCS 180-452480/2-A	Lab Control Sample	Total/NA	Water	EPA 7470A	452480
180-165231-1 MS	CCR-SP-3-110923	Total/NA	Water	EPA 7470A	452480

Eurofins Pittsburgh

QC Association Summary

Client: Haley & Aldrich, Inc.
Project/Site: AB Brown Generating Station

Job ID: 180-165231-1
SDG: Sedimentation Pond

Metals (Continued)

Analysis Batch: 452922 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-165231-1 MSD	CCR-SP-3-110923	Total/NA	Water	EPA 7470A	452480

General Chemistry

Analysis Batch: 452193

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-165231-1	CCR-SP-3-110923	Total/NA	Water	EPA 9040C	
180-165231-2	CCR-SP-2-110923	Total/NA	Water	EPA 9040C	
180-165231-3	DUP-2-110923	Total/NA	Water	EPA 9040C	
180-165231-5	CCR-SP-1-111023	Total/NA	Water	EPA 9040C	
LCS 180-452193/24	Lab Control Sample	Total/NA	Water	EPA 9040C	
180-165231-1 DU	CCR-SP-3-110923	Total/NA	Water	EPA 9040C	

Analysis Batch: 452200

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-165231-1	CCR-SP-3-110923	Total/NA	Water	SM 2540C	
180-165231-2	CCR-SP-2-110923	Total/NA	Water	SM 2540C	
180-165231-3	DUP-2-110923	Total/NA	Water	SM 2540C	
180-165231-4	FB-2-111023	Total/NA	Water	SM 2540C	
180-165231-5	CCR-SP-1-111023	Total/NA	Water	SM 2540C	
MB 180-452200/1	Method Blank	Total/NA	Water	SM 2540C	
LCS 180-452200/2	Lab Control Sample	Total/NA	Water	SM 2540C	
180-165231-1 DU	CCR-SP-3-110923	Total/NA	Water	SM 2540C	

Analysis Batch: 452345

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-165231-4	FB-2-111023	Total/NA	Water	EPA 9040C	
LCS 180-452345/1	Lab Control Sample	Total/NA	Water	EPA 9040C	

Rad

Prep Batch: 637221

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-165231-1	CCR-SP-3-110923	Total/NA	Water	PrecSep-21	
180-165231-2	CCR-SP-2-110923	Total/NA	Water	PrecSep-21	
180-165231-3	DUP-2-110923	Total/NA	Water	PrecSep-21	
180-165231-4	FB-2-111023	Total/NA	Water	PrecSep-21	
180-165231-5	CCR-SP-1-111023	Total/NA	Water	PrecSep-21	
MB 160-637221/1-A	Method Blank	Total/NA	Water	PrecSep-21	
LCS 160-637221/2-A	Lab Control Sample	Total/NA	Water	PrecSep-21	
180-165231-1 DU	CCR-SP-3-110923	Total/NA	Water	PrecSep-21	

Prep Batch: 637222

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-165231-1	CCR-SP-3-110923	Total/NA	Water	PrecSep_0	
180-165231-2	CCR-SP-2-110923	Total/NA	Water	PrecSep_0	
180-165231-3	DUP-2-110923	Total/NA	Water	PrecSep_0	
180-165231-4	FB-2-111023	Total/NA	Water	PrecSep_0	
180-165231-5	CCR-SP-1-111023	Total/NA	Water	PrecSep_0	
MB 160-637222/1-A	Method Blank	Total/NA	Water	PrecSep_0	
LCS 160-637222/2-A	Lab Control Sample	Total/NA	Water	PrecSep_0	
180-165231-1 DU	CCR-SP-3-110923	Total/NA	Water	PrecSep_0	

Eurofins Pittsburgh

NOV 11

966 10/04 MWI

FedEx® Saturday Delivery

151966 10/04 MWI

FedEx



180-165231 Waybill

Uncorrected temp
Thermometer ID

3.9 °C
22

CF: -0.4 Initials PM
PT-WI-SR-001 effective 11/8/18

ORIGIN ID: GTYA (864) 214-8759
TRAVIS PEAY
A.B. BROWN GENERATING STATION
8511 WELBORN ROAD
MOUNT VERNON, IN 47620
UNITED STATES US

SHIP DATE: 30OCT23
ACTWGT: 45.00 LB MAN
CAD: 0129689/CAFE3511

TO **CAMPBELL RECEIVING**
EUROFINS ENVIRONMENT TESTING NE
301 ALPHA DRIVE
RIDC PARK
PITTSBURGH PA 152382907

(412) 963-7068
THU: PG: REF: DEPT:

RMA: III III III



FedEx Express



SATURDAY 12:00P
PRIORITY OVERNIGHT

FedEx
TRK# **6772 2899 3980**
0221

XO AGCA

15238
PA-US
EXP 09/24

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13

Login Sample Receipt Checklist

Client: Haley & Aldrich, Inc.

Job Number: 180-165231-1
SDG Number: Sedimentation Pond

Login Number: 165231

List Number: 1

Creator: Abernathy, Eric L

List Source: Eurofins Pittsburgh

Question	Answer	Comment
Radioactivity wasn't checked or is \leq background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is <math><6\text{mm}</math> (1/4").	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	False	Sample splitting required for subcontract purposes.
Residual Chlorine Checked.	N/A	



Login Sample Receipt Checklist

Client: Haley & Aldrich, Inc.

Job Number: 180-165231-1
SDG Number: Sedimentation Pond

Login Number: 165231

List Number: 2

Creator: Pinette, Meadow L

List Source: Eurofins St. Louis

List Creation: 11/14/23 02:19 PM

Question	Answer	Comment
Radioactivity wasn't checked or is \leq background as measured by a survey meter.	True	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	N/A	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is <math><6\text{mm}</math> (1/4").	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

